

Coleman Creek Consulting, Inc.

**DRINKING WATER LEAD SAMPLING**  
OF  
**BONANZA SCHOOLS**  
31601 MISSION STREET, BONANZA, OREGON  
FOR  
**KLAMATH COUNTY SCHOOL DISTRICT**

**INTRODUCTION**


Coleman Creek Consulting, Inc. (CCC) was retained by Klamath County School District (KCSD) to perform representative lead drinking water sampling of Bonanza Schools at the above address. The purpose of the lead drinking water sampling was to determine the concentration of lead in representative drinking water sources and compare with regulatory standards. In 2017, Education Service Districts were required to adopt a Healthy and Safe Schools Plan, including provisions for testing and reducing exposure to elevated levels of lead in water used for drinking and food preparation.

**LEAD DRINKING WATER SAMPLING REQUIREMENTS**

Guidelines for sampling lead in water were established by the Oregon Health Authority. Water sampling is to occur after water sits overnight in the pipes without being used, and must be sampled after a day occupied by students or building occupants. All water sources are to be sampled, with the exception of water used for heating, sanitation, irrigation, and science sinks for grades 6 and up with non-potable water signs. Initial testing is required to be performed by 2020, and every 6 years thereafter, according to a testing schedule determined by the Oregon Department of Education.

**SAMPLE LOCATION DETERMINATION/SAMPLE PREP**

David W. Fawcett of CCC contacted Bill Schroeder, Head Custodian at Bonanza Schools, and discussed the objectives of the lead drinking water program. Mr. Schroeder reviewed the School buildings for water sources and identified by type on a building floor plan. Mr. Fawcett and Mr. Schroeder discussed the drinking water sources by phone, and Mr. Fawcett created a Site Sample Record Sheet describing each drinking water source by type and location. Mr. Fawcett identified each source by number (B1-B95), and identified each source number on a floor plan diagram of the school buildings. There was no sample B33 or B43 collected. Mr. Fawcett delivered the following sampling materials to Mr. Schroeder October 25, 2023: Numbered sample containers, Site Sample Record Sheet filled out with Sample Number, Sample Type, and Location. Mr. Schroeder was instructed in proper sampling technique, including sampling prior to water system use by other school occupants, fill sample container immediately from faucet opening, and recording time of water sampling on the Site Sample Record Sheets (pages 3-7).



# Coleman Creek Consulting, Inc.

## **DRINKING WATER SAMPLING**

Mr. Schroeder collected lead drinking water samples from the drinking water sources identified in Bonanza Schools October 26, 2023. See Site Sample Record Sheets (pages 3-7) for a description of the drinking water sources sampled. See Drinking Water Sample Location Diagram in Appendix A for a visual review of all drinking water sample locations. The drinking water samples were collected in the early morning, ensuring that the sample source had not been in use since the previous day. The samples were placed in a cooler. Mr. Fawcett picked up the samples collected by Mr. Schroeder October 26, 2023, and transported to Neilson Research Corporation in Medford, Oregon.

## **DRINKING WATER LEAD RESULTS AND TESTING SUMMARY SHEETS**

The ninety-three (93) drinking water samples collected were analyzed for lead using EPA Method 200.8. See Neilson Research Corporation Analytical Report in Appendix B. Drinking Water Testing Summary Sheets (pages 8-14) indicate the lead in drinking water concentrations for the fifty-seven (93) samples collected from the Gilchrist Schools were reported ranging from <0.515 to 27.5 parts per billion (ppb).


## **CONCLUSIONS**

Ninety-three (93) drinking water samples were collected from drinking water sources at Bonanza Schools prior to use that day by building occupants, and after a day the facility was occupied. The lead concentrations reported were all below the 15 ppb lead action level in water, with the exception of sample B46 (26.5 ppb), and B47 (27.5 ppb), both sinks in the Girl's restroom at Room 39.

## **RECOMMENDATIONS**

Coleman Creek Consulting, Inc. recommends replacing the faucets associated with samples B46 and B47, and resampling for lead concentration. CCC recommends continuing the lead drinking water sampling schedule in the future. Coleman Creek Consulting, Inc. appreciates the opportunity to continue to perform environmental sampling and consulting services to Klamath County School District.

David W. Fawcett  
Director of Consulting Services



# Coleman Creek Consulting, Inc.


## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Bonanza School  
ADDRESS: 31601 Mission Street  
Bonanza, Oregon

DATE: 10-26-23  
SAMPLER: Bill Schroeder

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
23-120G.B1	DW	Kitchen Left Sink	0450
23-120G.B2	DW	Kitchen Right Sink	0450
23-120G.B3	DW	Kitchen Bath Sink	0450
23-120G.B4	DW	Cafeteria Drinking Fountain	0450
23-120G.B5	DW	Showcase Sink	0452
23-120G.B6	DW	Showcase Drinking Fountain	0452
23-120G.B7	DW	Boy's Hall RR at Room 48 Left Sink	0456
23-120G.B8	DW	Boy's Hall RR at Room 48 Middle Sink	0456
23-120G.B9	DW	Boy's Hall RR at Room 48 Right Sink	0456
23-120G.B10	DW	Girl's Hall RR at Room 48 Left Sink	0500
23-120G.B11	DW	Girl's Hall RR at Room 48 Middle Sink	0500
23-120G.B12	DW	Girl's Hall RR at Room 48 Right Sink	0500
23-120G.B13	DW	Hall Drinking Fountain at Room 46	0503
23-120G.B14	DW	Hall Drinking Fountain Bottle Fill at Room 46	0503
23-120G.B15	DW	Room 51 Left Sink	0507
23-120G.B16	DW	Room 51 Left Left Middle Sink	0507
23-120G.B17	DW	Room 51 Home Sink	0507
23-120G.B18	DW	Room 51 EC Sink	0507
23-120G.B19	DW	Room 51 Right Right Middle Sink	0507
23-120G.B20	DW	Room 51 Right Sink	0507

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle M = Middle



# Coleman Creek Consulting, Inc.


## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Bonanza School  
ADDRESS: 31601 Mission Street  
Bonanza, Oregon

DATE: 10-26-23  
SAMPLER: Bill Schroeder

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
23-120G.B21	DW	Room 21 Left Sink	0520
23-120G.B22	DW	Room 21 Left Left Left Left Middle Sink	0520
23-120G.B23	DW	Room 21 Left Left Left Middle	0520
23-120G.B24	DW	Room 21 Left Left Middle	0520
23-120G.B25	DW	Room 21 Left Middle Sink (Mrs. McGregor)	0520
23-120G.B26	DW	Room 21 Middle Sink (Mrs. McGregor)	0520
23-120G.B27	DW	Room 21 Right Middle Sink	0520
23-120G.B28	DW	Room 21 Right Right Middle Sink	0520
23-120G.B29	DW	Room 21 Right Right Right Middle Sink	0520
23-120G.B30	DW	Room 21 Right Right Right Right Middle Sink	0520
23-120G.B31	DW	Room 21 Right Sink	0520
23-120G.B32	DW	Room Between 43 and 44, Left Sink	0528
23-120G.B34	DW	Room Between 43 and 44, Right Sink	0528
23-120G.B35	DW	Room 42 Office Sink	0528
23-120G.B36	DW	Hall Drinking Fountain at Room 39	0528
23-120G.B37	DW	Hall Drinking Fountain Bottle Fill at Room 39	0528
23-120G.B38	DW	Room 43 Left Sink (Mr. Decker)	0531
23-120G.B39	DW	Room 43 Left Middle (Mr. Decker)	0531
23-120G.B40	DW	Room 43 Left Left Middle Sink	0531

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle M = Middle



# Coleman Creek Consulting, Inc.


## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Bonanza School  
ADDRESS: 31601 Mission Street  
Bonanza, Oregon

DATE: 10-26-23  
SAMPLER: Bill Schroeder

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
23-120G.B41	DW	Room 36 Drinking Fountain	0551
23-120G.B42	DW	Kitchen Right Sink	0708
23-120G.B44	DW	Room 43 Right Sink	0538
23-120G.B45	DW	Girl's Hall RR at Room 39, Left Sink	0539
23-120G.B46	DW	Girl's Hall RR at Room 39, Middle Sink	0539
23-120G.B47	DW	Girl's Hall RR at Room 39, Right Sink	0539
23-120G.B48	DW	Boy's Hall RR at Room 39, Left Sink	0533
23-120G.B49	DW	Boy's Hall RR at Room 39, Middle Sink	0533
23-120G.B50	DW	Boy's Hall RR at Room 39, Right Sink	0533
23-120G.B51	DW	Room 54 Sink (Mrs Mitchell)	0543
23-120G.B52	DW	Greenhouse Sink	0544
23-120G.B53	DW	Room 36 Sink (Metal Shop)	0544
23-120G.B54	DW	Hall Drinking Fountain at Room 24	0550
23-120G.B55	DW	Hall Drinking Fountain Bottle Fill at Room 24	0554
23-120G.B56	DW	Boy's Hall Bath at Room 23, Left Sink	0555
23-120G.B57	DW	Boy's Hall Bath at Room 23, Middle Sink	0555
23-120G.B58	DW	Boy's Hall Bath at Room 23, Right Sink	0555
23-120G.B59	DW	Girl's Locker Room Drinking Fountain	0604
23-120G.B60	DW	Girl's Locker Room Left Sink	0604

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle M = Middle



# Coleman Creek Consulting, Inc.


## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Bonanza School  
ADDRESS: 31601 Mission Street  
Bonanza, Oregon

DATE: 10-26-23  
SAMPLER: Bill Schroeder

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
23-120G.B61	DW	Girl's Locker Room Middle Sink	0604
23-120G.B62	DW	Girl's Locker Room Office Sink	0604
23-120G.B63	DW	Concession Sink	0604
23-120G.B64	DW	Boy's Locker Room Left Sink	0606
23-120G.B65	DW	Boy's Locker Room Middle Sink	0606
23-120G.B66	DW	Boy's Locker Room Office Sink	0606
23-120G.B67	DW	Gym Drinking Fountain	0604
23-120G.B68	DW	Gym Drinking Fountain Bottle Filler	0604
23-120G.B69	DW	Hall Drinking Fountain at Gym	0606
23-120G.B70	DW	Hall Drinking Fountain Bottle Filler at Gym	0606
23-120G.B71	DW	Room 21 Left Sink	0610
23-120G.B72	DW	Room 21 Sick Room Sink	0610
23-120G.B73	DW	Boy's Hall RR at Room 5 Left Sink	0612
23-120G.B74	DW	Boy's Hall RR at Room 5 Middle Sink	0612
23-120G.B75	DW	Boy's Hall RR at Room 5 Right Sink	0612
23-120G.B76	DW	Girl's Hall RR at Room 5 Left Sink	0612
23-120G.B77	DW	Girl's Hall RR at Room 5 Middle Sink	0612
23-120G.B78	DW	Girl's Hall RR at Room 5 Right Sink	0612
23-120G.B79	DW	Room 5 Sink (Helms)	0612
23-120G.B80	DW	Small Gym Left Sink (Birls)	0618

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle M = Middle



# Coleman Creek Consulting, Inc.


## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Bonanza School  
ADDRESS: 31601 Mission Street  
Bonanza, Oregon

DATE: 10-26-23  
SAMPLER: Bill Schroeder

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
23-120G.B81	DW	Small Gym Boys Sink	0618
23-120G.B82	DW	FFA Trailer Left Sink	0624
23-120G.B83	DW	FFA Trailer Middle Sink	0624
23-120G.B84	DW	FFA Trailer Right Sink	0624
23-120G.B85	DW	Room 29 Staff Room Sink	0627
23-120G.B86	DW	Girl's Hall RR at Room 30 Left Sink	0628
23-120G.B87	DW	Girl's Hall RR at Room 30 Middle Sink	0628
23-120G.B88	DW	Girl's Hall RR at Room 30 Right Sink	0628
23-120G.B89	DW	Room 12 Sink (Northcuff)	0630
23-120G.B90	DW	Hall Drinking Fountain at Room 12	0630
23-120G.B91	DW	Hall Drinking Fountain Bottle Filler at Room 12	0630
23-120G.B92	DW	Football Field Concession Sink	0641
23-120G.B93	DW	Football Field Girl's RR Sink	0642
23-120G.B94	DW	Football Field Boy's RR Sink	0645
23-120G.B95	DW	Football Field Outside Drinking Fountain, Boys Bathroom	0645

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle M = Middle



# Coleman Creek Consulting, Inc.

## DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District  
 DISTRICT ID#: 467  
 SCHOOL NAME: Bonanza Jr./Sr. High School  
 BUILDING NAME: Bonanza Jr./Sr. High School  
 BUILDING ID#: 20571500


Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
23-120G.B1	Kitchen Left Sink	20571500-001KF	10-26-23	0.906		0.906
23-120G.B2	Kitchen Right Sink	20571500-002KF	10-26-23	0.522		0.522
23-120G.B3	Kitchen Bath Sink	20571500-003SF	10-26-23	4.01		4.01
23-120G.B4	Cafeteria Drinking Fountain	20571500-004DW	10-26-23	1.32		1.32
23-120G.B5	Showcase Sink	20571500-005SF	10-26-23	<0.515		<0.515
23-120G.B6	Showcase Drinking Fountain	20571500-006DW	10-26-23	<0.515		<0.515
23-120G.B7	Boy's Hall RR at Room 48 Left Sink	20571500-007BF	10-26-23	<0.515		<0.515
23-120G.B8	Boy's Hall RR at Room 48 Mid Sink	20571500-008BF	10-26-23	<0.515		<0.515
23-120G.B9	Boy's Hall RR at Room 48 Right Sink	20571500-009BF	10-26-23	<0.515		<0.515
23-120G.B10	Girl's Hall RR at Room 48 Left Sink	20571500-010BF	10-26-23	<0.515		<0.515
23-120G.B11	Girl's Hall RR at Room 48 Mid Sink	20571500-011BF	10-26-23	<0.515		<0.515
23-120G.B12	Girl's Hall RR at Room 48 Right Sink	20571500-012BF	10-26-23	<0.515		<0.515
23-120G.B13	Hall Drinking Fountain at Room 46	20571500-013DW	10-26-23	<0.515		<0.515
23-120G.B14	Hall DF Bottle Fill at Room 46	20571500-014WB	10-26-23	<0.515		<0.515
23-120G.B15	Room 51 Left Sink	20571500-015CF	10-26-23	0.896		0.896
23-120G.B16	Room 51 Left Left Middle Sink	20571500-016CF	10-26-23	2.27		2.27
23-120G.B17	Room 51 Home Sink	20571500-017CF	10-26-23	0.967		0.967
23-120G.B18	Room 51 EC Sink	20571500-018CF	10-26-23	0.942		0.942
23-120G.B19	Room 51 Right Right Middle Sink	20571500-019CF	10-26-23	0.788		0.788
23-120G.B20	Room 51 Right Sink	20571500-020CF	10-26-23	0.766		0.766
23-120G.B21	Room 21 Left Sink	20571500-021CF	10-26-23	2.79		2.79
23-120G.B22	Room 21 L L L Left Middle Sink	20571500-022CF	10-26-23	3.37		3.37
23-120G.B23	Room 21 Left Left Left Middle	20571500-023CF	10-26-23	8.79		8.79
23-120G.B24	Room 21 Left Left Middle	20571500-024CF	10-26-23	6.30		6.30
23-120G.B25	Room 21 Left Middle Sink	20571500-025CF	10-26-23	6.66		6.66
23-120G.B26	Room 21 Middle Sink	20571500-026CF	10-26-23	5.07		5.07
23-120G.B27	Room 21 Right Middle Sink	20571500-027CF	10-26-23	4.84		4.84
23-120G.B28	Room 21 Right Right Middle Sink	20571500-028CF	10-26-23	5.28		5.28
23-120G.B29	Room 21 Right Right Right Mid Sink	20571500-029CF	10-26-23	6.65		6.65
23-120G.B30	Room 21 R R R Right Middle Sink	20571500-030CF	10-26-23	6.49		6.49
23-120G.B31	Room 21 Right Sink	20571500-031CF	10-26-23	4.26		4.26
23-120G.B32	Room Between 43 and 44, Left Sink	20571500-032SF	10-26-23	8.47		8.47

Fixture ID Coding:

**Bold Indicates Test Result >15 ppb**

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler  
 CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet  
 KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)






## DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District  
 DISTRICT ID#: 467  
 SCHOOL NAME: Bonanza Jr./Sr. High School  
 BUILDING NAME: Bonanza Jr./Sr. High School  
 BUILDING ID#: 20571500

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
23-120G.B34	Room Between 43 and 44, R Sink	20571500-034SF	10-26-23	3.24		3.24
23-120G.B35	Room 42 Office Sink	20571500-035SF	10-26-23	2.14		2.14
23-120G.B36	Hall Drinking Fountain at Room 39	20571500-036DW	10-26-23	<0.515		<0.515
23-120G.B37	Hall DF Bottle Fill at Room 39	20571500-037WB	10-26-23	<0.515		<0.515
23-120G.B38	Room 43 Left Sink (Mr. Decker)	20571500-038CF	10-26-23	7.14		7.14
23-120G.B39	Room 43 Left Middle (Mr. Decker)	20571500-039CF	10-26-23	8.92		8.92
23-120G.B40	Room 43 Left Left Middle Sink	20571500-040CF	10-26-23	1.32		1.32
23-120G.B41	Room 36 Drinking Fountain	20571500-041DW	10-26-23	0.568		0.568
23-120G.B42	Kitchen Right Sink	20571500-042KF	10-26-23	1.64		1.64
23-120G.B44	Room 43 Right Sink	20571500-044CF	10-26-23	<0.515		<0.515
23-120G.B45	Girl's Hall RR at Room 39, L Sink	20571500-045BF	10-26-23	0.920		0.920
23-120G.B46	Girl's Hall RR at Room 39, M Sink	20571500-046BF	10-26-23	<b>26.5</b>		
23-120G.B47	Girl's Hall RR at Room 39, R Sink	20571500-047BF	10-26-23	<b>27.5</b>		
23-120G.B48	Boy's Hall RR at Room 39, L Sink	20571500-048BF	10-26-23	1.14		1.14
23-120G.B49	Boy's Hall RR at Room 39, M Sink	20571500-049BF	10-26-23	1.25		1.25
23-120G.B50	Boy's Hall RR at Room 39, R Sink	20571500-050BF	10-26-23	1.06		1.06
23-120G.B51	Room 54 Sink (Mrs Mitchell)	20571500-051CF	10-26-23	2.28		2.28
23-120G.B52	Greenhouse Sink	20571500-052CF	10-26-23	3.69		3.69
23-120G.B54	Hall Drinking Fountain at Room 24	20571500-054DW	10-26-23	<0.515		<0.515
23-120G.B55	Hall DF Bottle Fill at Room 24	20571500-055WB	10-26-23	<0.515		<0.515
23-120G.B56	Boy's Hall Bath at Room 23, L Sink	20571500-056BF	10-26-23	2.94		2.94
23-120G.B57	Boy Hall Bath at Room 23, M Sink	20571500-057BF	10-26-23	1.56		1.56
23-120G.B58	Boy Hall Bath at Room 23, R Sink	20571500-058BF	10-26-23	2.88		2.88
23-120G.B59	Girl's Locker Room DF	20571500-059DW	10-26-23	1.38		1.38
23-120G.B60	Girl's Locker Room Left Sink	20571500-060BF	10-26-23	0.775		0.775
23-120G.B61	Girl's Locker Room Middle Sink	20571500-061BF	10-26-23	<0.515		<0.515
23-120G.B62	Girl's Locker Room Office Sink	20571500-062SF	10-26-23	<0.515		<0.515
23-120G.B63	Concession Sink	20571500-063SF	10-26-23	<0.515		<0.515

Fixture ID Coding:

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler  
 CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet  
 KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)




## DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District  
 DISTRICT ID#: 467  
 SCHOOL NAME: Bonanza Jr./Sr. High School  
 BUILDING NAME: Bonanza Jr./Sr. High School  
 BUILDING ID#: 20571500

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
23-120G.B64	Boy's Locker Room Left Sink	20571500-064BF	10-26-23	<0.515		<0.515
23-120G.B65	Boy's Locker Room Middle Sink	20571500-065BF	10-26-23	<0.515		<0.515
23-120G.B66	Boy's Locker Room Office Sink	20571500-066SF	10-26-23	<0.515		<0.515
23-120G.B67	Gym Drinking Fountain	20571500-067DW	10-26-23	<0.515		<0.515
23-120G.B68	Gym Drinking Fountain WB	20571500-068WB	10-26-23	<0.515		<0.515
23-120G.B69	Hall Drinking Fountain at Gym	20571500-069DW	10-26-23	<0.515		<0.515
23-120G.B70	Hall Drinking Fountain WB at Gym	20571500-070WB	10-26-23	<0.515		<0.515
23-120G.B71	Room 21 Left Sink	20571500-071CF	10-26-23	2.46		2.46
23-120G.B72	Room 21 Sick Room Sink	20571500-072CF	10-26-23	<0.515		<0.515
23-120G.B73	Boy's Hall RR at Room 5 Left Sink	20571500-073BF	10-26-23	<0.515		<0.515
23-120G.B74	Boy's Hall RR at Room 5 Mid Sink	20571500-074BF	10-26-23	<0.515		<0.515
23-120G.B75	Boy's Hall RR at Room 5 R Sink	20571500-075BF	10-26-23	0.521		0.521
23-120G.B76	Girl's Hall RR at Room 5 Left Sink	20571500-076BF	10-26-23	0.826		0.826
23-120G.B77	Girl's Hall RR at Room 5 Mid Sink	20571500-077BF	10-26-23	0.565		0.565
23-120G.B78	Girl's Hall RR at Room 5 R Sink	20571500-078BF	10-26-23	0.531		0.531
23-120G.B79	Room 5 Sink (Helms)	20571500-079CF	10-26-23	1.83		1.83
23-120G.B80	Small Gym Left Sink (Girls)	20571500-080CF	10-26-23	1.40		1.40
23-120G.B81	Small Gym Boys Sink	20571500-081BF	10-26-23	4.42		4.42
23-120G.B85	Room 29 Staff Room Sink	20571500-085SF	10-26-23	<0.515		<0.515
23-120G.B86	Girl's Hall RR at Room 30 L Sink	20571500-086BF	10-26-23	2.12		2.12
23-120G.B87	Girl's Hall RR at Room 30 M Sink	20571500-087BF	10-26-23	1.36		1.36
23-120G.B88	Girl's Hall RR at Room 30 R Sink	20571500-088BF	10-26-23	1.10		1.10
23-120G.B89	Room 12 Sink (Northcuff)	20571500-089CF	10-26-23	1.23		1.23
23-120G.B90	Hall Drinking Fountain at Room 12	20571500-090DW	10-26-23	<0.515		<0.515
23-120G.B91	Hall DF WB at Room 12	20571500-091WB	10-26-23	<0.515		<0.515

Fixture ID Coding:

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler  
 CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet  
 KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)



# Coleman Creek Consulting, Inc.


## DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District  
 DISTRICT ID#: 467  
 SCHOOL NAME: Bonanza Jr./Sr. High School  
 BUILDING NAME: Shop  
 BUILDING ID#: 20571503

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
23-120G.B53	Shop Room 36 Sink	20571503-053CF	10-26-23	0.825		0.825

Fixture ID Coding:

DW = Drinking Water Fountain   WC = Water Cooler   WB = Water Bottle Filler  
 CF = Classroom Faucet   BF = Bathroom Faucet   SF = Staff/Office Faucet  
 KF = Kitchen/Food Prep   OS = Outside Spigot   OT = Other (Specify)



# Coleman Creek Consulting, Inc.


## DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District  
 DISTRICT ID#: 467  
 SCHOOL NAME: Bonanza Jr./Sr. High School  
 BUILDING NAME: FFA Trailer  
 BUILDING ID#: 20571501

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
23-120G.B82	FFA Trailer Left Sink	20571501-050CF	10-26-23	<0.515		<0.515
23-120G.B83	FFA Trailer Middle Sink	20571501-051CF	10-26-23	0.593		0.593
23-120G.B84	FFA Trailer Right Sink	20571501-052CF	10-26-23	0.568		0.568

Fixture ID Coding:

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler  
 CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet  
 KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)



# Coleman Creek Consulting, Inc.

## DRINKING WATER TESTING SUMMARY SHEET


DISTRICT NAME: Klamath County School District  
 DISTRICT ID#: 467  
 SCHOOL NAME: Bonanza Jr./Sr. High School  
 BUILDING NAME: Concessions  
 BUILDING ID#: 20571504

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
23-120G.B92	Concessions Sink	20571504-092SF	10-26-23	<0.515		<0.515

Fixture ID Coding:

**Bold Indicates Test Result >15 ppb**

DW = Drinking Water Fountain    WC = Water Cooler    WB = Water Bottle Filler  
 CF = Classroom Faucet    BF = Bathroom Faucet    SF = Staff/Office Faucet  
 KF = Kitchen/Food Prep    OS = Outside Spigot    OT = Other (Specify)



# Coleman Creek Consulting, Inc.

## DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District  
 DISTRICT ID#: 467  
 SCHOOL NAME: Bonanza Jr./Sr. High School  
 BUILDING NAME: Stadium  
 BUILDING ID#: 20571502

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
23-120G.B93	Girl's Restroom Sink	20571502-002BF	10-26-23	1.77		1.77
23-120G.B94	Boy's Restroom Sink	20571502-003BF	10-26-23	3.44		3.44
23-120G.B95	Outside Drinking Fountain, Boys RR	20571502-032DW	10-26-23	<0.515		<0.515

Fixture ID Coding:


**Bold Indicates Test Result >15 ppb**

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler  
 CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet  
 KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)

**APPENDIX A**

**DRINKING WATER SAMPLE LOCATION  
DIAGRAM**

# Bonanza Schools Map

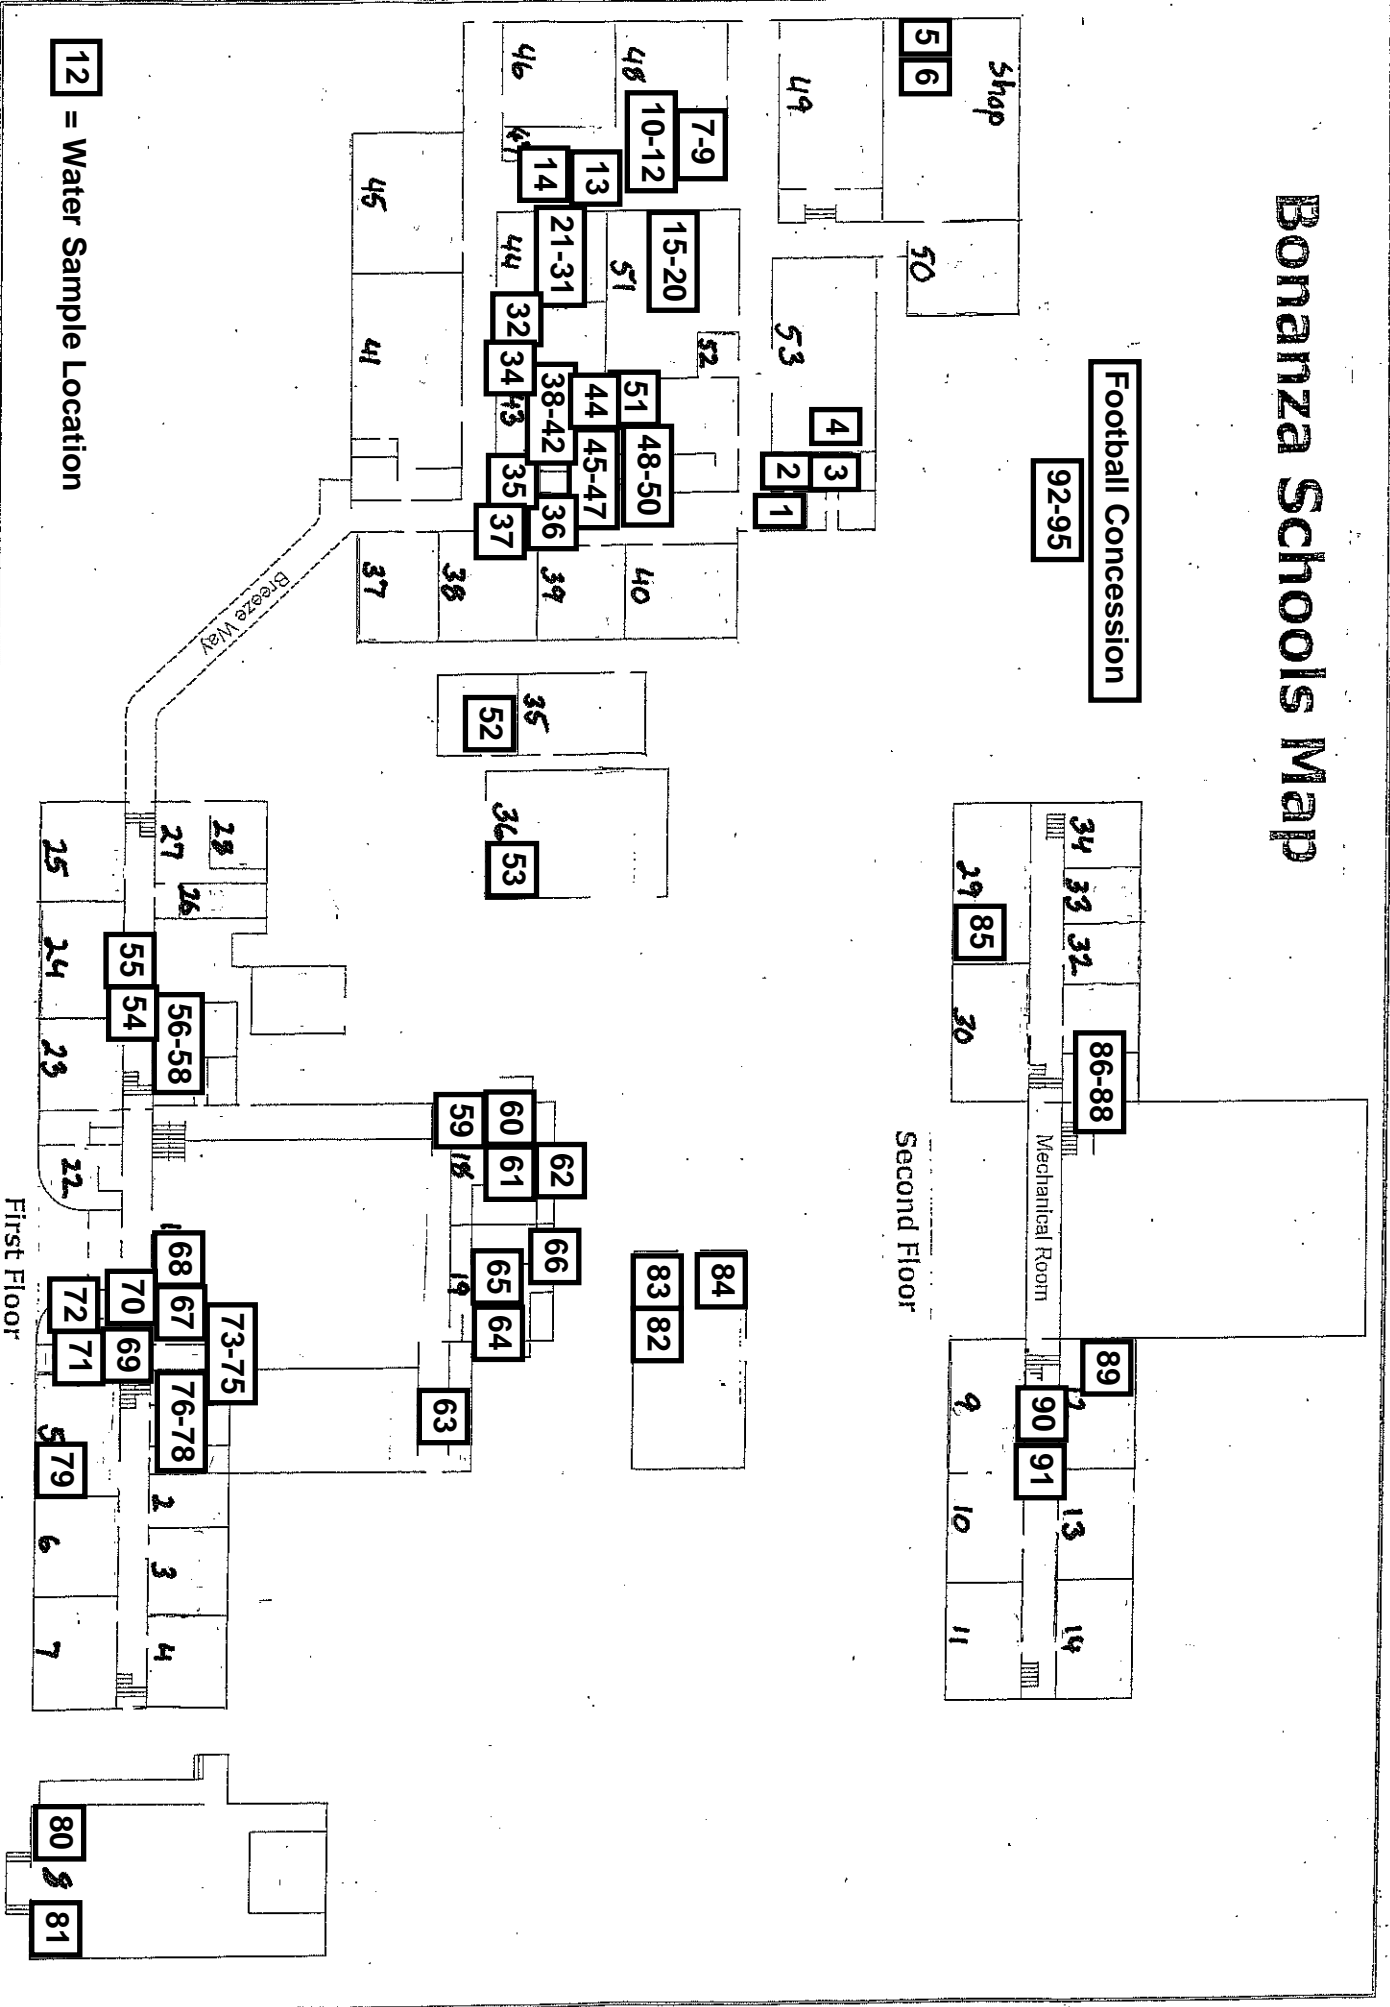



**APPENDIX B**

**NEILSON RESEARCH CORPORATION  
ANALYTICAL REPORT**



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

November 09, 2023

Dave Fawcett  
Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520  
TEL: (541) 535-7108  
FAX (541) 535-8795

RE: 23-120G Bonanza School Leads

Order No.: 23101124

Dear Dave Fawcett:

Neilson Research Corporation received 93 sample(s) on 10/26/2023 for the analyses presented in the following report.

The results relate only to the parameters tested or to the sample as received by the laboratory. This report shall not be reproduced except in full, without the written approval of Neilson Research Corporation. If you have any questions regarding these test results, please feel free to call.

Sincerely,  
Neilson Research Corporation

Tamra Schmedemann  
Senior Project Manager  
245 S Grape St  
Medford, OR 97501



Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: [www.nrclabs.com](http://www.nrclabs.com)

## Case Narrative

WO#: 23101124  
Date: 11/9/2023

---

**CLIENT:** Coleman Creek Consulting  
**Project:** 23-120G Bonanza School Leads

---

The analyses were performed according to the guidelines in the Neilson Research Corporation Quality Assurance Program. This report contains analytical results for the sample(s) as received by the laboratory.

Neilson Research Corporation certifies that this report is in compliance with the requirements of NELAP. No unusual difficulties were experienced during analysis of this batch except as noted below or qualified with data flags on the reports.

---

Original



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-01      Client Sample ID: 23-120G.B1  
 Collection Date: 10/26/2023 4:50:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Kitchen Left Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.906		0.515	ppb	1	11/1/2023	15.0	A	

**Lab ID:** 23101124-02      Client Sample ID: 23-120G.B2  
 Collection Date: 10/26/2023 4:50:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Kitchen Middle Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.522		0.515	ppb	1	11/1/2023	15.0	A	

**Lab ID:** 23101124-03      Client Sample ID: 23-120G.B3  
 Collection Date: 10/26/2023 4:50:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Kitchen Right Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	4.01		0.515	ppb	1	11/1/2023	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-04      Client Sample ID: 23-120G.B4  
 Collection Date: 10/26/2023 4:50:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Cafeteria DF

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	1.32		0.515	ppb	1	11/1/2023	15.0	A	

**Lab ID:** 23101124-05      Client Sample ID: 23-120G.B5  
 Collection Date: 10/26/2023 4:52:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Showcase Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/1/2023	15.0	A	

**Lab ID:** 23101124-06      Client Sample ID: 23-120G.B6  
 Collection Date: 10/26/2023 4:52:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Showcase DF

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/1/2023	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-07      Client Sample ID: 23-120G.B7  
 Collection Date: 10/26/2023 4:56:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Boy's Hall RR Rm 48 L Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst:	CBB
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/1/2023	15.0	A	

**Lab ID:** 23101124-08      Client Sample ID: 23-120G.B8  
 Collection Date: 10/26/2023 4:56:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Boy's Hall RR Rm 48 M Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst:	CBB
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/1/2023	15.0	A	

**Lab ID:** 23101124-09      Client Sample ID: 23-120G.B9  
 Collection Date: 10/26/2023 4:56:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Boy's Hall RR Rm 48 R Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst:	CBB
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/1/2023	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-10      Client Sample ID: 23-120G.B10  
 Collection Date: 10/26/2023 5:00:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Girl's Hall RR Rm 48 L Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	11/1/2023	15.0	A

**Lab ID:** 23101124-11      Client Sample ID: 23-120G.B11  
 Collection Date: 10/26/2023 5:00:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Girl's Hall RR Rm 48 M Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.68		0.515	ppb	1	11/1/2023	15.0	A

**Lab ID:** 23101124-12      Client Sample ID: 23-120G.B12  
 Collection Date: 10/26/2023 5:00:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Girl's Hall RR Rm 48 R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	11/1/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-13      Client Sample ID: 23-120G.B13  
 Collection Date: 10/26/2023 5:03:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 46 Hall DF

Trace Metals by EPA 200.8 ICP-MS								Analyst:	CBB
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/1/2023	15.0	A	

**Lab ID:** 23101124-14      Client Sample ID: 23-120G.B14  
 Collection Date: 10/26/2023 5:03:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 46 Hall DF Btl Filler at Rm 46

Trace Metals by EPA 200.8 ICP-MS								Analyst:	CBB
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/1/2023	15.0	A	

**Lab ID:** 23101124-15      Client Sample ID: 23-120G.B15  
 Collection Date: 10/26/2023 5:07:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 51 L Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst:	CBB
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.896		0.515	ppb	1	11/1/2023	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits





Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-16      Client Sample ID: 23-120G.B16  
 Collection Date: 10/26/2023 5:07:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 51 LL Middle Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.27		0.515	ppb	1	11/1/2023	15.0	A

**Lab ID:** 23101124-17      Client Sample ID: 23-120G.B17  
 Collection Date: 10/26/2023 5:07:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 51 L Middle Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.967		0.515	ppb	1	11/1/2023	15.0	A

**Lab ID:** 23101124-18      Client Sample ID: 23-120G.B18  
 Collection Date: 10/26/2023 5:07:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 51 R Middle Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.942		0.515	ppb	1	11/1/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-19      Client Sample ID: 23-120G.B19  
 Collection Date: 10/26/2023 5:07:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 51 R R Middle Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.788		0.515	ppb	1	11/1/2023	15.0	A

**Lab ID:** 23101124-20      Client Sample ID: 23-120G.B20  
 Collection Date: 10/26/2023 5:09:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 51 R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.766		0.515	ppb	1	11/1/2023	15.0	A

**Lab ID:** 23101124-21      Client Sample ID: 23-120G.B21  
 Collection Date: 10/26/2023 5:20:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 21 L Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.79		0.515	ppb	1	11/1/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-22      Client Sample ID: 23-120G.B22  
 Collection Date: 10/26/2023 5:20:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 21 L L L Middle Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	3.37		0.515	ppb	1	11/1/2023	15.0	A

**Lab ID:** 23101124-23      Client Sample ID: 23-120G.B23  
 Collection Date: 10/26/2023 5:20:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 21 L L L Middle Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	8.79		0.515	ppb	1	11/1/2023	15.0	A

**Lab ID:** 23101124-24      Client Sample ID: 23-120G.B24  
 Collection Date: 10/26/2023 5:20:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 21 L L Middle Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	6.30		0.515	ppb	1	11/1/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-25      Client Sample ID: 23-120G.B25  
 Collection Date: 10/26/2023 5:20:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 21 L Middle Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	6.66		0.515	ppb	1	11/1/2023	15.0	A

**Lab ID:** 23101124-26      Client Sample ID: 23-120G.B26  
 Collection Date: 10/26/2023 5:20:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 21 Middle Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	5.07		0.515	ppb	1	11/1/2023	15.0	A

**Lab ID:** 23101124-27      Client Sample ID: 23-120G.B27  
 Collection Date: 10/26/2023 5:20:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 21 R Middle Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	4.84		0.515	ppb	1	11/1/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-28      Client Sample ID: 23-120G.B28  
 Collection Date: 10/26/2023 5:20:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 21 R R Middle Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	5.28		0.515	ppb	1	11/1/2023	15.0	A

**Lab ID:** 23101124-29      Client Sample ID: 23-120G.B29  
 Collection Date: 10/26/2023 5:20:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 21 R R R Middle Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	6.65		0.515	ppb	1	11/1/2023	15.0	A

**Lab ID:** 23101124-30      Client Sample ID: 23-120G.B30  
 Collection Date: 10/26/2023 5:20:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 21 R R R R Middle Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	6.49		0.515	ppb	1	11/1/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-31      Client Sample ID: 23-120G.B31  
 Collection Date: 10/26/2023 5:20:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 21 R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	4.26		0.515	ppb	1	11/2/2023	15.0	A	

**Lab ID:** 23101124-32      Client Sample ID: 23-120G.B32  
 Collection Date: 10/26/2023 5:28:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm Between 43 & 44 L Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	8.47		0.515	ppb	1	11/2/2023	15.0	A	

**Lab ID:** 23101124-33      Client Sample ID: 23-120G.B34  
 Collection Date: 10/26/2023 5:28:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm Between 43 & 44 R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CBB		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	3.24		0.515	ppb	1	11/2/2023	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-34      Client Sample ID: 23-120G.B35  
 Collection Date: 10/26/2023 5:28:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 42 Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: CBB		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.14		0.515	ppb	1	11/2/2023	15.0	A

**Lab ID:** 23101124-35      Client Sample ID: 23-120G.B36  
 Collection Date: 10/26/2023 5:28:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Hall DF at Rm 39

Trace Metals by EPA 200.8 ICP-MS						Analyst: CBB		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	11/2/2023	15.0	A

**Lab ID:** 23101124-36      Client Sample ID: 23-120G.B37  
 Collection Date: 10/26/2023 5:28:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Hall DF Btl Filler at Rm 39

Trace Metals by EPA 200.8 ICP-MS						Analyst: CBB		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	11/2/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-37      Client Sample ID: 23-120G.B38  
 Collection Date: 10/26/2023 5:31:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 43 L Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: CBB		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	7.14		0.515	ppb	1	11/2/2023	15.0	A

**Lab ID:** 23101124-38      Client Sample ID: 23-120G.B39  
 Collection Date: 10/26/2023 5:31:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 43 L Middle

Trace Metals by EPA 200.8 ICP-MS						Analyst: CBB		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	8.92		0.515	ppb	1	11/2/2023	15.0	A

**Lab ID:** 23101124-39      Client Sample ID: 23-120G.B40  
 Collection Date: 10/26/2023 5:31:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 43 L L Middle Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: CBB		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.32		0.515	ppb	1	11/2/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits





Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-40      Client Sample ID: 23-120G.B41  
 Collection Date: 10/26/2023 5:51:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 36 DF

Trace Metals by EPA 200.8 ICP-MS						Analyst: CBB		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.568		0.515	ppb	1	11/2/2023	15.0	A

**Lab ID:** 23101124-41      Client Sample ID: 23-120G.B42  
 Collection Date: 10/26/2023 7:08:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Kitchen Sink R

Trace Metals by EPA 200.8 ICP-MS						Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.64		0.515	ppb	1	11/3/2023	15.0	A

**Lab ID:** 23101124-42      Client Sample ID: 23-120G.B44  
 Collection Date: 10/26/2023 5:38:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 43 R Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	11/3/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-43      Client Sample ID: 23-120G.B45  
 Collection Date: 10/26/2023 5:39:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Girl's Hall RR Rm 39 L Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.920		0.515	ppb	1	11/3/2023	15.0	A	

**Lab ID:** 23101124-44      Client Sample ID: 23-120G.B46  
 Collection Date: 10/26/2023 5:39:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Girl's Hall RR Rm 39 M Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	26.5	*	0.515	ppb	1	11/3/2023	15.0	A	

**Lab ID:** 23101124-45      Client Sample ID: 23-120G.B47  
 Collection Date: 10/26/2023 5:39:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Girl's Hall RR Rm 39 R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	27.5	*	0.515	ppb	1	11/3/2023	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-46      Client Sample ID: 23-120G.B48  
 Collection Date: 10/26/2023 5:33:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Boy's Hall RR Rm 39 L Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.14		0.515	ppb	1	11/3/2023	15.0	A

**Lab ID:** 23101124-47      Client Sample ID: 23-120G.B49  
 Collection Date: 10/26/2023 5:33:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Boy's Hall RR Rm 39 M Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.25		0.515	ppb	1	11/3/2023	15.0	A

**Lab ID:** 23101124-48      Client Sample ID: 23-120G.B50  
 Collection Date: 10/26/2023 5:33:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Boy's Hall RR Rm 39 R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.06		0.515	ppb	1	11/3/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-49      Client Sample ID: 23-120G.B51  
 Collection Date: 10/26/2023 5:43:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 54 Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst:	CJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	2.28		0.515	ppb	1	11/3/2023	15.0	A	

**Lab ID:** 23101124-50      Client Sample ID: 23-120G.B52  
 Collection Date: 10/26/2023 5:49:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Greenhouse Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst:	CJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	3.69		0.515	ppb	1	11/3/2023	15.0	A	

**Lab ID:** 23101124-51      Client Sample ID: 23-120G.B53  
 Collection Date: 10/26/2023 5:50:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 36 Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst:	CJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.825		0.515	ppb	1	11/3/2023	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-52      Client Sample ID: 23-120G.B54  
 Collection Date: 10/26/2023 5:54:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Hall DF at Rm 24

Trace Metals by EPA 200.8 ICP-MS								Analyst: CJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	11/3/2023	15.0	A

**Lab ID:** 23101124-53      Client Sample ID: 23-120G.B55  
 Collection Date: 10/26/2023 5:54:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Hall DF Btl Filler at Rm 24

Trace Metals by EPA 200.8 ICP-MS								Analyst: CJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	11/3/2023	15.0	A

**Lab ID:** 23101124-54      Client Sample ID: 23-120G.B56  
 Collection Date: 10/26/2023 5:55:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Boy's Hall RR Rm 23 L Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst: CJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.94		0.515	ppb	1	11/3/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-55      Client Sample ID: 23-120G.B57  
 Collection Date: 10/26/2023 5:55:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Boy's Hall RR Rm 23 M Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.56		0.515	ppb	1	11/3/2023	15.0	A

**Lab ID:** 23101124-56      Client Sample ID: 23-120G.B58  
 Collection Date: 10/26/2023 5:55:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Boy's Hall RR Rm 23 R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.88		0.515	ppb	1	11/3/2023	15.0	A

**Lab ID:** 23101124-57      Client Sample ID: 23-120G.B59  
 Collection Date: 10/26/2023 6:04:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Girl's Locker Rm DF

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.38		0.515	ppb	1	11/3/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-58      Client Sample ID: 23-120G.B60  
 Collection Date: 10/26/2023 6:04:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Girl's Locker Rm L Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.775		0.515	ppb	1	11/3/2023	15.0	A

**Lab ID:** 23101124-59      Client Sample ID: 23-120G.B61  
 Collection Date: 10/26/2023 6:04:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Girl's Locker Rm M Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	11/3/2023	15.0	A

**Lab ID:** 23101124-60      Client Sample ID: 23-120G.B62  
 Collection Date: 10/26/2023 6:04:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Girl's Locker Rm R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	11/3/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-61      Client Sample ID: 23-120G.B63  
 Collection Date: 10/26/2023 6:04:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Concession Stand

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/6/2023	15.0	A	

**Lab ID:** 23101124-62      Client Sample ID: 23-120G.B64  
 Collection Date: 10/26/2023 6:06:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Boy's Locker Rm L Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/6/2023	15.0	A	

**Lab ID:** 23101124-63      Client Sample ID: 23-120G.B65  
 Collection Date: 10/26/2023 6:06:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Boy's Locker Rm M Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/6/2023	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits





Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-64      Client Sample ID: 23-120G.B66  
 Collection Date: 10/26/2023 6:06:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Boy's Locker Rm R Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/6/2023	15.0	A	

**Lab ID:** 23101124-65      Client Sample ID: 23-120G.B67  
 Collection Date: 10/26/2023 6:04:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Gym DF

Trace Metals by EPA 200.8 ICP-MS								Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/6/2023	15.0	A	

**Lab ID:** 23101124-66      Client Sample ID: 23-120G.B68  
 Collection Date: 10/26/2023 6:04:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Gym DF Bottle Filler

Trace Metals by EPA 200.8 ICP-MS								Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/6/2023	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-67      Client Sample ID: 23-120G.B69  
 Collection Date: 10/26/2023 6:06:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Hall DF at Gym

Trace Metals by EPA 200.8 ICP-MS								Analyst: CJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	11/6/2023	15.0	A

**Lab ID:** 23101124-68      Client Sample ID: 23-120G.B70  
 Collection Date: 10/26/2023 6:06:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Hall DF Bottle Filler at Gym

Trace Metals by EPA 200.8 ICP-MS								Analyst: CJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	11/6/2023	15.0	A

**Lab ID:** 23101124-69      Client Sample ID: 23-120G.B71  
 Collection Date: 10/26/2023 6:10:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 21 L Sink


Trace Metals by EPA 200.8 ICP-MS								Analyst: CJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.48		0.515	ppb	1	11/6/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits

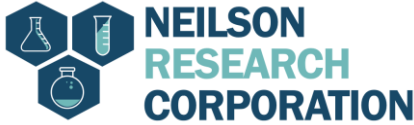

Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-70      Client Sample ID: 23-120G.B72  
 Collection Date: 10/26/2023 6:10:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 21 R Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst:	CJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/6/2023	15.0	A	

**Lab ID:** 23101124-71      Client Sample ID: 23-120G.B73  
 Collection Date: 10/26/2023 6:12:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Boy's Hall RR Rm 5 L Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst:	CJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/6/2023	15.0	A	

**Lab ID:** 23101124-72      Client Sample ID: 23-120G.B74  
 Collection Date: 10/26/2023 6:12:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Boy's Hall RR Rm 5 M Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst:	CJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/6/2023	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-73      Client Sample ID: 23-120G.B75  
 Collection Date: 10/26/2023 6:12:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Boy's Hall RR Rm 5 R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.521		0.515	ppb	1	11/6/2023	15.0	A	

**Lab ID:** 23101124-74      Client Sample ID: 23-120G.B76  
 Collection Date: 10/26/2023 6:12:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Girl's Hall RR Rm 5 L Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.826		0.515	ppb	1	11/6/2023	15.0	A	

**Lab ID:** 23101124-75      Client Sample ID: 23-120G.B77  
 Collection Date: 10/26/2023 6:12:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Girl's Hall RR Rm 5 M Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.565		0.515	ppb	1	11/6/2023	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-76      Client Sample ID: 23-120G.B78  
 Collection Date: 10/26/2023 6:12:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Girl's Hall RR Rm 5 R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.531		0.515	ppb	1	11/6/2023	15.0	A	

**Lab ID:** 23101124-77      Client Sample ID: 23-120G.B79  
 Collection Date: 10/26/2023 6:12:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Room 5 Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	1.83		0.515	ppb	1	11/6/2023	15.0	A	

**Lab ID:** 23101124-78      Client Sample ID: 23-120G.B80  
 Collection Date: 10/26/2023 6:18:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Small Gym L Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	1.40		0.515	ppb	1	11/6/2023	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-79      Client Sample ID: 23-120G.B81  
 Collection Date: 10/26/2023 6:18:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Small Gym R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	4.42		0.515	ppb	1	11/6/2023	15.0	A	

**Lab ID:** 23101124-80      Client Sample ID: 23-120G.B82  
 Collection Date: 10/26/2023 6:24:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: FFA Trailer L Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	11/6/2023	15.0	A	

**Lab ID:** 23101124-81      Client Sample ID: 23-120G.B83  
 Collection Date: 10/26/2023 6:24:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: FFA Trailer M Sink


Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.593		0.515	ppb	1	11/6/2023	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits

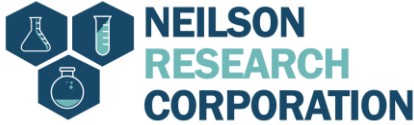

Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-82      Client Sample ID: 23-120G.B84  
 Collection Date: 10/26/2023 6:24:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: FFA Trailer R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.568		0.515	ppb	1	11/6/2023	15.0	A

**Lab ID:** 23101124-83      Client Sample ID: 23-120G.B85  
 Collection Date: 10/26/2023 6:27:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Rm 29 Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	11/6/2023	15.0	A

**Lab ID:** 23101124-84      Client Sample ID: 23-120G.B86  
 Collection Date: 10/26/2023 6:28:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Girl's Hall RR Rm 30 L Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.12		0.515	ppb	1	11/6/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-85      Client Sample ID: 23-120G.B87  
 Collection Date: 10/26/2023 6:28:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Girl's Hall RR Rm 30 M Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.36		0.515	ppb	1	11/6/2023	15.0	A

**Lab ID:** 23101124-86      Client Sample ID: 23-120G.B88  
 Collection Date: 10/26/2023 6:28:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Girl's Hall RR Rm 30 R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.10		0.515	ppb	1	11/6/2023	15.0	A

**Lab ID:** 23101124-87      Client Sample ID: 23-120G.B89  
 Collection Date: 10/26/2023 6:30:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Room 12 Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.23		0.515	ppb	1	11/6/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits





Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-88      Client Sample ID: 23-120G.B90  
 Collection Date: 10/26/2023 6:30:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Hall DF Rm 12

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	11/6/2023	15.0	A

**Lab ID:** 23101124-89      Client Sample ID: 23-120G.B91  
 Collection Date: 10/26/2023 6:30:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Hall DF Bottle Filler Rm 12

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	11/6/2023	15.0	A

**Lab ID:** 23101124-90      Client Sample ID: 23-120G.B92  
 Collection Date: 10/26/2023 6:41:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Football Field Conc Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.810		0.515	ppb	1	11/6/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 23101124  
 Date Reported: 11/9/2023

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 23101124  
**Received Date:** 10/26/2023 3:14:00 PM  
**Reported Date:** 11/9/2023 10:59:13 AM

Sample Information:

**Lab ID:** 23101124-91      Client Sample ID: 23-120G.B93  
 Collection Date: 10/26/2023 6:42:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Football Fld Girl's RR Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.77		0.515	ppb	1	11/6/2023	15.0	A

**Lab ID:** 23101124-92      Client Sample ID: 23-120G.B94  
 Collection Date: 10/26/2023 6:45:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Football Fld Boy's RR Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	3.44		0.515	ppb	1	11/6/2023	15.0	A

**Lab ID:** 23101124-93      Client Sample ID: 23-120G.B95  
 Collection Date: 10/26/2023 6:45:00 AM      Collected By: Bill Schroeder  
 Matrix: Drinking Water      Sample Location: Football Fld Outside DF

Trace Metals by EPA 200.8 ICP-MS							Analyst: CJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	11/6/2023	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	PRE Percent RE exceeds the Limit	R RPD outside accepted recovery limits

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# QC SUMMARY REPORT

WO#: 23101124  
 09-Nov-23

**Client:** Coleman Creek Consulting  
**Project:** 23-120G Bonanza School Leads

**TestCode:** LEAD\_DW

Sample ID: <b>MB-23189</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43817</b>
Client ID: <b>PBW</b>	Batch ID: <b>23189</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/1/2023</b>	SeqNo: <b>730274</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead ND 0.515

Sample ID: <b>LCS-23189</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43817</b>
Client ID: <b>LCSW</b>	Batch ID: <b>23189</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/1/2023</b>	SeqNo: <b>730275</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 95.7 0.520 100 0 95.7 85 115

Sample ID: <b>23101124-01AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43817</b>
Client ID: <b>23-120G.B1</b>	Batch ID: <b>23189</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/1/2023</b>	SeqNo: <b>730277</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 94.1 0.520 100 0.906 93.2 70 130

Sample ID: <b>23101124-01AMSD</b>	SampType: <b>MSD</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43817</b>
Client ID: <b>23-120G.B1</b>	Batch ID: <b>23189</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/1/2023</b>	SeqNo: <b>730278</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 95.5 0.520 100 0.906 94.6 70 130 94.1 1.50 20

**Qualifiers:** \* Value exceeds Maximum Contaminant Level. CI Sample container temperature is out of limit as specified at testcode H Holding times for preparation or analysis exceeded  
 MI Recovery outside control limits due to Matrix Interference ND Not Detected at the Reporting Limit PL Permit Limit  
 RL Reporting Detection Limit

Original



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# QC SUMMARY REPORT

WO#: 23101124  
 09-Nov-23

**Client:** Coleman Creek Consulting  
**Project:** 23-120G Bonanza School Leads

**TestCode:** LEAD\_DW

Sample ID: <b>MB-23190</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43817</b>
Client ID: <b>PBW</b>	Batch ID: <b>23190</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/1/2023</b>	SeqNo: <b>730302</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead ND 0.515

Sample ID: <b>MB-23190</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43817</b>
Client ID: <b>PBW</b>	Batch ID: <b>23190</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/1/2023</b>	SeqNo: <b>730303</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead ND 0.515

Sample ID: <b>LCS-23190</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43817</b>
Client ID: <b>LCSW</b>	Batch ID: <b>23190</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/1/2023</b>	SeqNo: <b>730304</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 94.6 0.520 100 0 94.6 85 115

Sample ID: <b>23101124-21AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43817</b>
Client ID: <b>23-120G.B21</b>	Batch ID: <b>23190</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/1/2023</b>	SeqNo: <b>730306</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 97.4 0.520 100 2.79 94.7 70 130

**Qualifiers:** \* Value exceeds Maximum Contaminant Level. CI Sample container temperature is out of limit as specified at testcode H Holding times for preparation or analysis exceeded  
 MI Recovery outside control limits due to Matrix Interference ND Not Detected at the Reporting Limit PL Permit Limit  
 RL Reporting Detection Limit

Original



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# QC SUMMARY REPORT

WO#: 23101124  
 09-Nov-23

**Client:** Coleman Creek Consulting  
**Project:** 23-120G Bonanza School Leads

**TestCode:** LEAD\_DW

Sample ID: <b>23101124-21AMSD</b>	SampType: <b>MSD</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43817</b>						
Client ID: <b>23-120G.B21</b>	Batch ID: <b>23190</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/1/2023</b>	SeqNo: <b>730307</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	96.5	0.520	100	2.79	93.7	70	130	97.4	0.991	20	

Sample ID: <b>MB-23191</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43889</b>						
Client ID: <b>PBW</b>	Batch ID: <b>23191</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/3/2023</b>	SeqNo: <b>731620</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	ND	0.515									

Sample ID: <b>LCS-23191</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43889</b>						
Client ID: <b>LCSW</b>	Batch ID: <b>23191</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/3/2023</b>	SeqNo: <b>731621</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	97.6	0.520	100	0	97.6	85	115				

Sample ID: <b>23101124-41AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43889</b>						
Client ID: <b>23-120G.B42</b>	Batch ID: <b>23191</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/3/2023</b>	SeqNo: <b>731623</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	96.8	0.520	100	1.64	95.1	70	130				

**Qualifiers:** \* Value exceeds Maximum Contaminant Level. CI Sample container temperature is out of limit as specified at testcode H Holding times for preparation or analysis exceeded  
 MI Recovery outside control limits due to Matrix Interference ND Not Detected at the Reporting Limit PL Permit Limit  
 RL Reporting Detection Limit

Original



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# QC SUMMARY REPORT

WO#: 23101124  
 09-Nov-23

**Client:** Coleman Creek Consulting  
**Project:** 23-120G Bonanza School Leads

**TestCode:** LEAD\_DW

Sample ID: <b>23101124-41AMSD</b>	SampType: <b>MSD</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43889</b>						
Client ID: <b>23-120G.B42</b>	Batch ID: <b>23191</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/3/2023</b>	SeqNo: <b>731624</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	94.1	0.520	100	1.64	92.4	70	130	96.8	2.82	20	

Sample ID: <b>MB-23192</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43919</b>						
Client ID: <b>PBW</b>	Batch ID: <b>23192</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/6/2023</b>	SeqNo: <b>732469</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	ND	0.515									

Sample ID: <b>LCS-23192</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43919</b>						
Client ID: <b>LCSW</b>	Batch ID: <b>23192</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/6/2023</b>	SeqNo: <b>732470</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	100	0.520	100	0	100	85	115				

Sample ID: <b>23101124-61AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43919</b>						
Client ID: <b>23-120G.B63</b>	Batch ID: <b>23192</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/6/2023</b>	SeqNo: <b>732472</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	99.0	0.520	100	0.217	98.8	70	130				

**Qualifiers:** \* Value exceeds Maximum Contaminant Level. CI Sample container temperature is out of limit as specified at testcode H Holding times for preparation or analysis exceeded  
 MI Recovery outside control limits due to Matrix Interference ND Not Detected at the Reporting Limit PL Permit Limit  
 RL Reporting Detection Limit

Original



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# QC SUMMARY REPORT

WO#: 23101124  
 09-Nov-23

**Client:** Coleman Creek Consulting  
**Project:** 23-120G Bonanza School Leads

**TestCode:** LEAD\_DW

Sample ID: <b>23101124-61AMSD</b>	SampType: <b>MSD</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43919</b>						
Client ID: <b>23-120G.B63</b>	Batch ID: <b>23192</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/6/2023</b>	SeqNo: <b>732473</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	99.1	0.520	100	0.217	98.9	70	130	99.0	0.122	20	

Sample ID: <b>MB-23193</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43919</b>						
Client ID: <b>PBW</b>	Batch ID: <b>23193</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/6/2023</b>	SeqNo: <b>732497</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	ND	0.515									

Sample ID: <b>LCS-23193</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43919</b>						
Client ID: <b>LCSW</b>	Batch ID: <b>23193</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/6/2023</b>	SeqNo: <b>732498</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	98.1	0.520	100	0	98.1	85	115				

Sample ID: <b>23101124-81AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43919</b>						
Client ID: <b>23-120G.B83</b>	Batch ID: <b>23193</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/6/2023</b>	SeqNo: <b>732500</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	98.5	0.520	100	0.593	97.9	70	130				

**Qualifiers:** \* Value exceeds Maximum Contaminant Level. CI Sample container temperature is out of limit as specified at testcode H Holding times for preparation or analysis exceeded  
 MI Recovery outside control limits due to Matrix Interference ND Not Detected at the Reporting Limit PL Permit Limit  
 RL Reporting Detection Limit

Original



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# QC SUMMARY REPORT

WO#: 23101124  
 09-Nov-23

**Client:** Coleman Creek Consulting  
**Project:** 23-120G Bonanza School Leads

**TestCode:** LEAD\_DW

Sample ID: <b>23101124-81AMSD</b>	SampType: <b>MSD</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>11/1/2023</b>	RunNo: <b>43919</b>						
Client ID: <b>23-120G.B83</b>	Batch ID: <b>23193</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>11/6/2023</b>	SeqNo: <b>732501</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	97.8	0.520	100	0.593	97.2	70	130	98.5	0.669	20	

**Qualifiers:**

* Value exceeds Maximum Contaminant Level.	CI Sample container temperature is out of limit as specified at testcode	H Holding times for preparation or analysis exceede
MI Recovery outside control limits due to Matrix Interference	ND Not Detected at the Reporting Limit	PL Permit Limit
RL Reporting Detection Limit		

Original



# Sample Log-In Check List

Client Name: **ColemanCreek** Work Order Number: **23101124** RcptNo: **1**

Logged by:	<b>Tamra Schmedemann</b>	<b>10/26/2023 3:14:00 PM</b>	<i>Tamra Schmedemann</i>
Completed By:	<b>Erin Hernandez</b>	<b>10/27/2023 5:05:00 PM</b>	<i>Erin Hernandez</i>
Reviewed By:	<b>Tamra Schmedemann</b>	<b>11/9/2023 10:29:22 AM</b>	<i>Tamra Schmedemann</i>

**Chain of Custody**

1. Is Chain of Custody complete? Yes  No  Not Present   
 2. How was the sample delivered? Client

**Log In**

3. Coolers are present? Yes  No  NA   
 4. Shipping container/cooler in good condition? Yes  No   
 Custody seals intact on shipping container/cooler? Yes  No  Not Present   
 No. Seal Date: Signed By:  
 5. Was an attempt made to cool the samples? Yes  No  NA   
 6. Were all samples received at a temperature of >0° C to 6.0°C Yes  No  NA   
 7. Sample(s) in proper container(s)? Yes  No   
 8. Sufficient sample volume for indicated test(s)? Yes  No   
 9. Are samples (except VOA and ONG) properly preserved? Yes  No   
 10. Was preservative added to bottles? Yes  No  NA   
 HNO3 pH<2  
 11. Is the headspace in the VOA vials less than 1/4 inch or 6 mm? Yes  No  No VOA Vials   
 12. Were any sample containers received broken? Yes  No   
 13. Does paperwork match bottle labels? Yes  No   
 (Note discrepancies on chain of custody)  
 14. Are matrices correctly identified on Chain of Custody? Yes  No   
 15. Is it clear what analyses were requested? Yes  No   
 16. Were all holding times able to be met? Yes  No   
 (If no, notify customer for authorization.)

**Special Handling (if applicable)**

17. Was client notified of all discrepancies with this order? Yes  No  NA

Person Notified:	<input type="text"/>	Date:	<input type="text"/>
By Whom:	<input type="text"/>	Via:	<input type="checkbox"/> eMail <input type="checkbox"/> Phone <input type="checkbox"/> Fax <input type="checkbox"/> In Person
Regarding:	<input type="text"/>		
Client Instructions:	<input type="text"/>		

18. Additional remarks:

**Cooler Information**

Cooler No	Temp °C	Condition	Seal Intact	Seal No	Seal Date	Signed By
-----------	---------	-----------	-------------	---------	-----------	-----------

# Chain of Custody Record

This Chain of Custody is a LEGAL DOCUMENT and must be filled out accurately.

<b>Section A</b> Required Client Information	<b>Section B</b> Required Project Information	<b>Section C</b> Invoice Information	<b>Section D</b> Rush Status (Subject to Scheduling)
Company: Coleman Creek Consulting	Project Name: <u>Bonanza School</u>	Attention:	<input checked="" type="checkbox"/> Standard: 10 Business Days
Address: 810 Leonard St	Project Number: <u>23-1204</u>	Company Name:	<input type="checkbox"/> Priority: 5 Business Days (List x 1.50)
Ashland, OR 97520	Report To: Dave Fawcett	Address:	<input type="checkbox"/> Express: 3 Business Days (List x 1.75)
Email: <a href="mailto:fawbro@ccountry.net">fawbro@ccountry.net</a>	Copy To:	P.O. #	<input type="checkbox"/> Rush: 2 Business Days (List x 2.00)
Phone: Fax:			<input type="checkbox"/> Rush: 1 Business Day (List x 2.50)
Collected By (Print): <u>Bill Schroeder</u>	<b>Analysis Requested</b>		<input type="checkbox"/> Rush: Same Day (List x 3.00)
Collected By (Sign): <u>[Signature]</u>			Authorized <input type="checkbox"/> Yes <input type="checkbox"/> No
Email Report <input type="checkbox"/> Mail Report <input type="checkbox"/> Fax Report <input type="checkbox"/>			

<b>Section E</b> Sample Information					<b>Analysis Requested</b>										NRC Workorder # <u>23101124</u> (Lab Use Only)					
Sample ID	Comp/Grab	Matrix*	Date Collected	Time Collected	No. of Containers															
<u>22-1204, B1-B42</u>	<u>Grab</u>	<u>DW</u>	<u>10-26-23</u>		<u>42</u>	<u>X</u>														
<u>23-1204, B44-B95</u>	<u>Grab</u>	<u>DW</u>	<u>"</u>		<u>52</u>	<u>X</u>														

\*Matrix: DW - Drinking Water WW - Wastewater W - Water S - Soil/Solid SL - Sludge O - Oil WP - Wipe OT - Other

<b>Section F</b> Relinquish/Receive		Sign	Print	Date	Time
Relinquished By: <u>[Signature]</u>		<u>David W Fawcett</u>		<u>10-26-23</u>	<u>15:24</u>
Received By:					
Relinquished By:					
Received By:					
Relinquished By:					
Received By Laboratory: <u>Tamara Schmedeman</u>		<u>Tamara Schmedeman</u>		<u>10-26-23</u>	<u>15:24</u>

<b>Section G</b> Lab Use Only	
Temp: <u>Comb</u>	IR Therm ID:
≤6°C: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	
Received on Ice: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	
Number of Bottles Received: <u>94</u>	
pH Checked: <u>N/A</u>	
COC Seals Intact: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/> NA	
Field Blank Included: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	

Received Via <input type="checkbox"/> UPS <input type="checkbox"/> FedEX <input type="checkbox"/> Other <input checked="" type="checkbox"/> Hand
Payment: <input checked="" type="checkbox"/> Invoice <input type="checkbox"/> Cash <input type="checkbox"/> VISA, M/C <input type="checkbox"/> Check # _____ Amount _____

- 
- A Total Alkalinity and Bicarbonate Alkalinity results are to a pH endpoint of 4.5. Carbonate Alkalinity result is to a pH endpoint of 8.3.
- A-LL The total low level alkalinity results are to a pH endpoint of 4.3-4.7 pH units per SM 2320B-2011.
- B Analyte detected in the associated method blank.
- C Sample(s) does not meet NELAP/ORELAP sample acceptance criteria. See Case Narrative.
- C1 Sample(s) does not meet NELAP/ORELAP sample acceptance criteria for temperature.
- CF Results confirmed by re-analysis.
- CU Cleanup performed as specified by method.
- E Estimated value.
- ER Elevated reporting limit due to matrix. Report limits (MDLs, MRLs & PQLs) are adjusted based on variations in sample preparation amounts, analytical dilutions, and percent solids, where applicable.
- FC Fecal Coliforms: Sample(s) received past 40 CFR Part 136 specified holding time. Results reported as estimated values.
- HP Sample re-analysis performed outside of method specified holding time.
- HR Sample received outside of method specified holding time.
- HS Sample analyzed for volatile organics contained headspace.
- HT At the client's request, the sample was analyzed outside of method specified holding time.
- H Analysis performed outside of method specified holding time.
- J Analyte detected below the Minimum Reporting Limit (MRL) and above the Method Detection Limit (MDL). The J flag result is an estimated value and the user should be aware that this data is of limited reliability.
- L Dissolved metals were not filtered within 15 minutes of collection per 40 CFR Part 136.
- MI Surrogate, Duplicate Sample (DUP) or Matrix Spikes recoveries are out of control limits due to matrix interference. Sample results may be biased.
- N See Case Narrative on page 2 of report.
- Q Initial calibration verification (ICV), continuing calibration verification (CCV) or laboratory control sample (LCS), and/or matrix spikes exceeded high recovery limits, but associated samples are non-detect and the sample results are not affected. Data meets EPA/NELAP requirements.
- R Relative percent difference (RPD) is outside of the accepted recovery limits.
- R3 The relative percent difference (RPD) and/or percent recovery for the duplicate (DUP) or matrix spike (MS)/matrix spike duplicate (MSD) cannot be accurately calculated due to the concentration of analyte already present in the sample.
- R4 The Relative percent difference (RPD) is not within control limits because the concentration of the sample result is too low to represent proper statistical error.
- R5 The difference between the BOD/CBOD results for the highest and lowest dilution used for the calculation is >30% because the results are too low to represent proper statistical error. The BOD/CBOD sample result is an average of all qualified bottles for each dilution series. The sample results are not affected.
- R6 The difference between the BOD/CBOD results for the highest and lowest dilution used for the calculation is >30%. This may indicate a possible matrix interference. The BOD/CBOD sample result is an average of all qualified bottles for each dilution series.
- S Surrogate and/or matrix spike recovery is outside of the accepted recovery limits. Sample results may be biased.
- S1 Surrogate or matrix spike recovery is outside of control limits due to dilution necessary for analysis.
- SC Sub-contracted to another laboratory for analysis.
- SP Sample(s) were not collected per EPA Method 5035A protocols. The results are considered minimum values.
- \* Value exceeds Maximum Contaminant Level or is outside the acceptable range.