

Coleman Creek Consulting, Inc.

**DRINKING WATER LEAD SAMPLING**  
OF  
**MAZAMA HIGH SCHOOL**  
**3009 SUMMERS LANE, KLAMATH FALLS, OREGON**  
FOR  
**KLAMATH COUNTY SCHOOL DISTRICT**

**INTRODUCTION**


Coleman Creek Consulting, Inc. (CCC) was retained by Klamath County School District (KCS D) to perform representative lead drinking water sampling of Mazama High School (Mazama) at the above address. The purpose of the lead drinking water sampling was to determine the concentration of lead in representative drinking water sources and compare with regulatory standards. In 2017, Education Service Districts were required to adopt a Healthy and Safe Schools Plan, including provisions for testing and reducing exposure to elevated levels of lead in water used for drinking and food preparation.

**LEAD DRINKING WATER SAMPLING REQUIREMENTS**

Guidelines for sampling lead in water were established by the Oregon Health Authority. Water sampling is to occur after water sits overnight in the pipes without being used, and must be sampled after a day occupied by students or building occupants. All water sources are to be sampled, with the exception of water used for heating, sanitation, irrigation, and science sinks for grades 6 and up with non-potable water signs. Initial testing is required to be performed by 2020, and every 6 years thereafter, according to a testing schedule determined by the Oregon Department of Education.

**SAMPLE LOCATION DETERMINATION/SAMPLE PREP**

David W. Fawcett of CCC contacted Polo Flores, Head Custodian at Mazama, and discussed the objectives of the lead drinking water program. Mr. Flores reviewed the School buildings for water sources and identified by type on a building floor plan. Mr. Fawcett and Mr. Flores discussed the drinking water sources by phone, and Mr. Fawcett created a Site Sample Record Sheet describing each drinking water source by type and location. Mr. Fawcett identified each source by number (M1-M142), and identified each source number on floor plan diagrams of the school building (the Main Building has two sample location diagrams for individual samplers, and there are no floor plans of the concession buildings). Mr. Fawcett delivered the following sampling materials to Mr. Flores March 10, 2022: Numbered sample containers, Site Sample Record Sheet filled out with Sample Number, Sample Type, and Location. Mr. Flores, Jimmy, and Darin Martins (three samplers selected due to large number of samples to collect) were instructed in proper sampling technique, including sampling prior to water system use by other school occupants, fill sample container immediately from faucet opening, and recording time of water sampling on the Site Sample Record Sheets (pages 3-10).



# Coleman Creek Consulting, Inc.

## **DRINKING WATER SAMPLING**

Mr. Flores, Jimmy, and Darin Martins collected lead drinking water samples from the drinking water sources identified in Mazama High School March 11, 2022. See Site Sample Record Sheets (pages 3-10) for a description of the drinking water sources sampled. See Drinking Water Sample Location Diagram in Appendix A for a visual review of all drinking water sample locations. The drinking water samples were collected in the early morning, ensuring that the sample source had not been in use since the previous day. The samples were placed in a cooler. Mr. Fawcett picked up the samples collected by Mr. Flores, Jimmy, and Mr. Martins March 11, 2022, and transported to Neilson Research Corporation in Medford, Oregon. No sample collected for M79, thought to be a double faucet sink, one faucet present at sampling.

## **DRINKING WATER LEAD RESULTS AND TESTING SUMMARY SHEETS**

The one hundred forty-one (141) drinking water samples collected were analyzed for lead using EPA Method 200.8. See Neilson Research Corporation Analytical Report in Appendix B. Drinking Water Testing Summary Sheets (pages 11-17) indicate the lead in drinking water concentrations for the one hundred forty-one (141) samples collected from the Main School Building, Dwelling Building (White House/Daycare), Daycare Building (Health Clinic), and Concessions Building were reported ranging from <0.515 to 427 parts per billion (ppb).


## **CONCLUSIONS**

One hundred forty-one (141) drinking water samples were collected from drinking water sources at the Mazama High School Building, Dwelling (White House/Daycare) Building, Daycare Building (Health Clinic), and Concessions Building prior to use that day by building occupants, and after a day the facility was occupied. The lead concentrations reported were all below the 15 ppb lead action level in water, with the exception of seven samples collected from the Mazama High School Building, including the Cafeteria Fountain, Room 23 faucet, Room 32 faucets (2), Room 34 faucets (2), and Dark Room faucet.

## **RECOMMENDATIONS**

The Sink and Fountain fixture reported with lead concentrations greater than 15 ppb lead should either be re-tested, replaced, or deleted. Re-testing or fixture replacement should follow additional testing guidelines. Coleman Creek Consulting, Inc. recommends future drinking water sampling at Mazama High School according to the schedule set out by the Oregon Department of Education. Coleman Creek Consulting, Inc. appreciates the opportunity to continue to perform environmental sampling and consulting services to Klamath County School District.

David W. Fawcett  
Director of Consulting Services



# Coleman Creek Consulting, Inc.


## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Mazama High School  
ADDRESS: 3009 Summers Lane  
Klamath Falls, Oregon

DATE: 03-11-22  
INSPECTOR: Polo Flores

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
22-010G.M1	DW	Room 15 L Faucet	0620
22-010G.M2	DW	Room 15 R Faucet	0620
22-010G.M3	DW	Room 16 Faucet	0623
22-010G.M4	DW	Room 17 L Faucet	0630
22-010G.M5	DW	Room 17 LM Faucet	0631
22-010G.M6	DW	Room 17 LMM Faucet	0632
22-010G.M7	DW	Room 17 RMM Faucet	0633
22-010G.M8	DW	Room 17 RM Faucet	0638
22-010G.M9	DW	Room 17 R Faucet	0636
22-010G.M10	DW	Room 18 L Faucet	0652
22-010G.M11	DW	Room 18 M Faucet	0653
22-010G.M12	DW	Room 18 R Faucet	0654
22-010G.M13	DW	Room 19 L Faucet	0657
22-010G.M14	DW	Room 19 M Faucet	0658
22-010G.M15	DW	Room 19 R Faucet	0659
22-010G.M16	DW	Room 24A L Faucet	0702
22-010G.M17	DW	Room 24A M Faucet	0705
22-010G.M18	DW	Room 24A R Faucet	0706
22-010G.M19	DW	Room 24 Fountain	0708
22-010G.M20	DW	Room 24 Sink Faucet	0852

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle LMM = Left Middle Middle RMM = Right Middle Middle M = Middle



# Coleman Creek Consulting, Inc.


## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Mazama High School  
 ADDRESS: 3009 Summers Lane  
 Klamath Falls, Oregon

DATE: 03-11-22  
 INSPECTOR: Polo Flores

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
22-010G.M21	DW	Room 24 LM Faucet	0727
22-010G.M22	DW	Room 24 RM Faucet	0728
22-010G.M23	DW	Room 24 R Faucet	0728
22-010G.M24	DW	Kitchen Middle Faucet	0823
22-010G.M25	DW	Custodian Office at Boiler Room Fountain	0730
22-010G.M26	DW	Hall Fountain Outside Custodian Office	0730
22-010G.M27	DW	Room 29 RR L Faucet	0741
22-010G.M28	DW	Room 29 RR R Faucet	0741
22-010G.M29	DW	Room 29 Kitchen Faucet	0742
22-010G.M30	DW	Boy's Hall RR at Room 29 L Faucet	0743
22-010G.M31	DW	Boy's Hall RR at Room 29 M Faucet	0743
22-010G.M32	DW	Boy's Hall RR at Room 29 R Faucet	0744
22-010G.M33	DW	Kitchen Dishwash Area L Faucet	0812
22-010G.M34	DW	Kitchen Dishwash Area R Faucet	0812
22-010G.M35	DW	Kitchen RR Sink Faucet	0809
22-010G.M36	DW	Kitchen Sink Faucet Outside RR	0808
22-010G.M37	DW	Kitchen Main Area Faucet	0810
22-010G.M38	DW	Cafeteria Fountain	0807
22-010G.M39	DW	Room 25 L Faucet	0824
22-010G.M40	DW	Room 25 R Faucet	0824

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
 LM = Left Middle LMM = Left Middle Middle RMM = Right Middle Middle M = Middle



# Coleman Creek Consulting, Inc.


## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Mazama High School  
ADDRESS: 3009 Summers Lane  
Klamath Falls, Oregon

DATE: 03-11-22  
INSPECTOR: Polo Flores

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
22-010G.M41	DW	Room 23 L Faucet	0717
22-010G.M42	DW	Room 23 LM Faucet	0718
22-010G.M43	DW	Room 23 M Faucet	0718
22-010G.M44	DW	Room 23 RM Faucet	0719
22-010G.M45	DW	Room 23 R Faucet	0719
22-010G.M46	DW	Room 23 Office Sink Faucet	0523
22-010G.M47	DW	Office Nurse Room L Faucet	0510
22-010G.M48	DW	Office Nurse Room M Faucet	0511
22-010G.M49	DW	Office Nurse Room R Faucet	0512
22-010G.M50	DW	Office Men's RR Faucet	0514
22-010G.M51	DW	Office Women's RR Faucet	0515
22-010G.M52	DW	Office Coffee Sink Faucet	0618
22-010G.M53	DW	Room 32 L Faucet	0750
22-010G.M54	DW	Room 32 LM Faucet	0750
22-010G.M55	DW	Room 32 M Faucet	0751
22-010G.M56	DW	Room 32 RM Faucet	0751
22-010G.M57	DW	Room 32 R Faucet	0751
22-010G.M58	DW	Room 34 L Faucet	0801
22-010G.M59	DW	Room 34 LM Faucet	0801
22-010G.M60	DW	Room 34 RM Faucet	0802
22-010G.M61	DW	Room 34 R Faucet	0803

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle LMM = Left Middle Middle RMM = Right Middle Middle M = Middle



# Coleman Creek Consulting, Inc.


## DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District  
 DISTRICT ID#: 467  
 SCHOOL NAME: Mazama High School  
 BUILDING NAME: Mazama High School  
 BUILDING ID#: 20572000

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
22-010G.M001	Room 15 L Faucet	20572000-001CF	03-11-22	<0.515		
22-010G.M002	Room 15 R Faucet	20572000-002CF	03-11-22	0.590		
22-010G.M003	Room 16 Faucet	20572000-003CF	03-11-22	1.99		
22-010G.M004	Room 17 L Faucet	20572000-004CF	03-11-22	1.31		
22-010G.M005	Room 17 LM Faucet	20572000-005CF	03-11-22	0.982		
22-010G.M006	Room 17 LMM Faucet	20572000-006CF	03-11-22	2.10		
22-010G.M007	Room 17 RMM Faucet	20572000-007CF	03-11-22	<0.515		
22-010G.M008	Room 17 RM Faucet	20572000-008CF	03-11-22	<0.515		
22-010G.M009	Room 17 R Faucet	20572000-009CF	03-11-22	0.638		
22-010G.M010	Room 18 L Faucet	20572000-010CF	03-11-22	0.736		
22-010G.M011	Room 18 M Faucet	20572000-011CF	03-11-22	<0.515		
22-010G.M012	Room 18 R Faucet	20572000-012CF	03-11-22	<0.515		
22-010G.M013	Room 19 L Faucet	20572000-013CF	03-11-22	<0.515		
22-010G.M014	Room 19 M Faucet	20572000-014CF	03-11-22	<0.515		
22-010G.M015	Room 19 R Faucet	20572000-015CF	03-11-22	<0.515		
22-010G.M016	Room 24A L Faucet	20572000-016CF	03-11-22	<0.515		
22-010G.M017	Room 24A M Faucet	20572000-017CF	03-11-22	1.10		
22-010G.M018	Room 24A R Faucet	20572000-018CF	03-11-22	0.553		
22-010G.M019	Room 24 Fountain	20572000-019DW	03-11-22	1.79		
22-010G.M020	Room 24 Sink Faucet	20572000-020CF	03-11-22	2.36		
22-010G.M021	Room 24 LM Faucet	20572000-021CF	03-11-22	1.19		
22-010G.M022	Room 24 RM Faucet	20572000-022CF	03-11-22	<0.515		
22-010G.M023	Room 24 R Faucet	20572000-023CF	03-11-22	2.01		
22-010G.M024	Kitchen Middle Faucet	20572000-024KF	03-11-22	<0.515		
22-010G.M025	Custodian Office Fountain at Boiler	20572000-025DW	03-11-22	0.585		
22-010G.M026	Hall Fountain at Custodian Office	20572000-026DW	03-11-22	3.57		
22-010G.M027	Room 29 RR L Faucet	20572000-027CF	03-11-22	<0.515		
22-010G.M028	Room 29 RR R Faucet	20572000-028CF	03-11-22	<0.515		
22-010G.M029	Room 29 Kitchen Faucet	20572000-029CF	03-11-22	<0.515		
22-010G.M030	Boy's Hall RR at Room 29 L Faucet	20572000-030BF	03-11-22	<0.515		
22-010G.M031	Boy's Hall RR at Room 29 M Faucet	20572000-031BF	03-11-22	0.722		
22-010G.M032	Boy's Hall RR at Room 29 R Faucet	20572000-032BF	03-11-22	<0.515		

Fixture ID Coding:

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler  
 CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet  
 KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)



# Coleman Creek Consulting, Inc.

## DRINKING WATER TESTING SUMMARY SHEET


DISTRICT NAME: Klamath County School District  
 DISTRICT ID#: 467  
 SCHOOL NAME: Mazama High School  
 BUILDING NAME: Mazama High School  
 BUILDING ID#: 20572000

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
22-010G.M033	Kitchen Dishwash Area L Faucet	20572000-033KF	03-11-22	1.29		
22-010G.M034	Kitchen Dishwash Area R Faucet	20572000-034KF	03-11-22	2.95		
22-010G.M035	Kitchen RR Sink Faucet	20572000-035KF	03-11-22	<0.515		
22-010G.M036	Kitchen Sink Faucet Outside RR	20572000-036KF	03-11-22	2.22		
22-010G.M037	Kitchen Main Area Faucet	20572000-037KF	03-11-22	1.09		
22-010G.M038	Cafeteria Fountain	20572000-038DW	03-11-22	<b>22.1</b>		
22-010G.M039	Room 25 L Faucet	20572000-039CF	03-11-22	5.91		
22-010G.M040	Room 25 R Faucet	20572000-040CF	03-11-22	7.57		
22-010G.M041	Room 23 L Faucet	20572000-041CF	03-11-22	<b>19.7</b>		
22-010G.M042	Room 23 LM Faucet	20572000-042CF	03-11-22	1.39		
22-010G.M043	Room 23 M Faucet	20572000-043CF	03-11-22	2.00		
22-010G.M044	Room 23 RM Faucet	20572000-044CF	03-11-22	6.93		
22-010G.M045	Room 23 R Faucet	20572000-045CF	03-11-22	1.93		
22-010G.M046	Room 23 Office Sink Faucet	20572000-046CF	03-11-22	<0.515		
22-010G.M047	Office Nurse Room L Faucet	20572000-047NS	03-11-22	0.561		
22-010G.M048	Office Nurse Room M Faucet	20572000-048NS	03-11-22	0.651		
22-010G.M049	Office Nurse Room R Faucet	20572000-049NS	03-11-22	<0.515		
22-010G.M050	Office Men's RR Faucet	20572000-050BF	03-11-22	<0.515		
22-010G.M051	Office Women's RR Faucet	20572000-051BF	03-11-22	<0.515		
22-010G.M052	Office Coffee Sink Faucet	20572000-052SF	03-11-22	2.01		
22-010G.M053	Room 32 L Faucet	20572000-053CF	03-11-22	2.86		
22-010G.M054	Room 32 LM Faucet	20572000-054CF	03-11-22	<b>105</b>		
22-010G.M055	Room 32 M Faucet	20572000-055CF	03-11-22	3.49		
22-010G.M056	Room 32 RM Faucet	20572000-056CF	03-11-22	3.66		
22-010G.M057	Room 32 R Faucet	20572000-057CF	03-11-22	<b>108</b>		
22-010G.M058	Room 34 L Faucet	20572000-058CF	03-11-22	8.56		
22-010G.M059	Room 34 LM Faucet	20572000-059CF	03-11-22	2.32		
22-010G.M060	Room 34 RM Faucet	20572000-060CF	03-11-22	<b>427</b>		
22-010G.M061	Room 34 R Faucet	20572000-061CF	03-11-22	<b>90.0</b>		
22-010G.M062	Room 38 Faucet	20572000-062CF	03-11-22	8.63		
22-010G.M063	Girl's RR at Room 31 L Faucet	20572000-063BF	03-11-22	<0.515		
22-010G.M064	Girl's RR at Room 31 M Faucet	20572000-064BF	03-11-22	<0.515		

Fixture ID Coding:

**Bold Indicates Test Result >15 ppb**

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler  
 CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet  
 KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)



# Coleman Creek Consulting, Inc.

## DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District  
 DISTRICT ID#: 467  
 SCHOOL NAME: Mazama High School  
 BUILDING NAME: Mazama High School  
 BUILDING ID#: 20572000


Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
22-010G.M065	Girl's RR at Room 31 R Faucet	20572000-065BF	03-11-22	<0.515		
22-010G.M066	Boy's RR at Room 31 L Faucet	20572000-066BF	03-11-22	0.834		
22-010G.M067	Boy's RR at Room 31 M Faucet	20572000-067BF	03-11-22	<0.515		
22-010G.M068	Boy's RR at Room 31 R Faucet	20572000-068BF	03-11-22	<0.515		
22-010G.M069	Hall Fountain at Library	20572000-069DW	03-11-22	<0.515		
22-010G.M070	Library Office Faucet	20572000-070SF	03-11-22	<0.515		
22-010G.M071	Break Room Faucet at Room 33	20572000-071SF	03-11-22	2.94		
22-010G.M072	Dark Room Faucet at Room 33	20572000-072SF	03-11-22	<b>26.0</b>		
22-010G.M073	Boy's RR at Rm 44 (Gym) L Faucet	20572000-073BF	03-11-22	<0.515		
22-010G.M074	Boy's RR at Rm 44 (Gym) R Faucet	20572000-074BF	03-11-22	<0.515		
22-010G.M075	Girl's RR at Rm 44 (Gym) L Faucet	20572000-075BF	03-11-22	<0.515		
22-010G.M076	Girl's RR at Rm 44 (Gym) R Faucet	20572000-076BF	03-11-22	<0.515		
22-010G.M077	Hall Fountain at 60's Hall	20572000-077DW	03-11-22	<0.515		
22-010G.M078	Concession L Faucet	20572000-078SF	03-11-22	0.750		
22-010G.M080	Math Office Faucet at Room 47	20572000-080SF	03-11-22	0.602		
22-010G.M081	Boy's Hall RR at Room 52 L Faucet	20572000-081BF	03-11-22	1.11		
22-010G.M082	Boy's Hall RR at Room 52 M Faucet	20572000-082BF	03-11-22	1.06		
22-010G.M083	Boy's Hall RR at Room 52 R Faucet	20572000-083BF	03-11-22	1.24		
22-010G.M084	Girl's Hall RR at Room 52 L Faucet	20572000-084BF	03-11-22	1.35		
22-010G.M085	Girl's Hall RR at Room 52 M Faucet	20572000-085BF	03-11-22	0.785		
22-010G.M086	Girl's Hall RR at Room 52 R Faucet	20572000-086BF	03-11-22	1.02		
22-010G.M087	Hall Fountain at Room 9	20572000-087DW	03-11-22	<0.515		
22-010G.M088	Room 55 Break Room Faucet	20572000-088SF	03-11-22	1.54		
22-010G.M089	Room 57 RR L Faucet	20572000-089CF	03-11-22	<0.515		
22-010G.M090	Room 57 RR R Faucet	20572000-090CF	03-11-22	<0.515		
22-010G.M091	Girl's Locker L Faucet	20572000-091BF	03-11-22	<0.515		
22-010G.M092	Girl's Locker LM Faucet	20572000-092BF	03-11-22	<0.515		
22-010G.M093	Girl's Locker RM Faucet	20572000-093BF	03-11-22	<0.515		
22-010G.M094	Girl's Locker R Faucet	20572000-094BF	03-11-22	0.647		
22-010G.M095	Girl's Locker Fountain	20572000-095DW	03-11-22	<0.515		
22-010G.M096	Girl's Locker Office Faucet	20572000-096SF	03-11-22	<0.515		
22-010G.M097	Main Gym L Fountain	20572000-097DW	03-11-22	<0.515		

Fixture ID Coding:

**Bold Indicates Test Result >15 ppb**

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler  
 CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet  
 KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)





# Coleman Creek Consulting, Inc.


## DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District  
 DISTRICT ID#: 467  
 SCHOOL NAME: Mazama High School  
 BUILDING NAME: Mazama High School  
 BUILDING ID#: 20572000

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
22-010G.M098	Main Gym LM Fountain	20572000-098DW	03-11-22	<0.515		
22-010G.M099	Main Gym RM Fountain	20572000-099DW	03-11-22	0.615		
22-010G.M100	Main Gym R Fountain	20572000-100DW	03-11-22	<0.515		
22-010G.M101	Upper Gym L Fountain	20572000-101DW	03-11-22	1.45		
22-010G.M102	Upper Gym R Fountain	20572000-102DW	03-11-22	<0.515		
22-010G.M103	Boy's Locker Big Wall L Faucet	20572000-103BF	03-11-22	<0.515		
22-010G.M104	Boy's Locker Big Wall LM Faucet	20572000-104BF	03-11-22	<0.515		
22-010G.M105	Boy's Locker Big Wall LMM Faucet	20572000-105BF	03-11-22	<0.515		
22-010G.M106	Boy's Locker Big Wall RMM Faucet	20572000-106BF	03-11-22	0.556		
22-010G.M107	Boy's Locker Big Wall RM Faucet	20572000-107BF	03-11-22	<0.515		
22-010G.M108	Boy's Locker Big Wall R Faucet	20572000-108BF	03-11-22	<0.515		
22-010G.M109	Boy's Locker Little Wall L Faucet	20572000-109BF	03-11-22	<0.515		
22-010G.M110	Boy's Locker Little Wall M Faucet	20572000-110BF	03-11-22	<0.515		
22-010G.M111	Boy's Locker Little Wall R Faucet	20572000-111BF	03-11-22	<0.515		
22-010G.M112	Boy's Locker Coach Office L Faucet	20572000-112SF	03-11-22	<0.515		
22-010G.M113	Boy's Locker Coach Office R Faucet	20572000-113SF	03-11-22	<0.515		
22-010G.M114	Boy's Locker Main Office Faucet	20572000-114SF	03-11-22	<0.515		

### Fixture ID Coding:

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler  
 CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet  
 KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)



# Coleman Creek Consulting, Inc.


## DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District  
 DISTRICT ID#: 467  
 SCHOOL NAME: Mazama High School  
 BUILDING NAME: Daycare (now Health Clinic)  
 BUILDING ID#: 20572004

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
22-010G.M115	Clinic Waiting Room RR Faucet	20572004-115SF	03-11-22	1.68		
22-010G.M116	Clinic Kitchen Double Sink L Faucet	20572004-116KF	03-11-22	0.877		
22-010G.M117	Clinic Kitchen Double Sink R Faucet	20572004-117KF	03-11-22	0.577		
22-010G.M118	Clinic Kitchen Handwash Faucet	20572004-118KF	03-11-22	1.92		
22-010G.M119	Clinic Staff RR Faucet	20572004-119SF	03-11-22	<0.515		
22-010G.M120	Exam Room A Faucet	20572004-120SF	03-11-22	3.49		
22-010G.M121	Exam Room B Faucet	20572004-121SF	03-11-22	2.32		
22-010G.M122	Exam Room C Faucet	20572004-122SF	03-11-22	1.47		

### Fixture ID Coding:

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler  
 CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet  
 KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)



# Coleman Creek Consulting, Inc.


## DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District  
 DISTRICT ID#: 467  
 SCHOOL NAME: Mazama High School  
 BUILDING NAME: Dwelling (White House/Daycare)  
 BUILDING ID#: 20572002

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
22-010G.M123	1 <sup>st</sup> Floor Stair RR Faucet	20572002-123BF	03-11-22	1.03		
22-010G.M124	Handwash Sink Faucet	20572002-124SF	03-11-22	0.539		
22-010G.M125	Kitchen L Faucet	20572002-125KF	03-11-22	<0.515		
22-010G.M126	Kitchen Handwash Faucet	20572002-126KF	03-11-22	2.91		
22-010G.M127	1 <sup>st</sup> Floor Kitchen RR Faucet	20572002-127BF	03-11-22	<0.515		
22-010G.M128	2 <sup>nd</sup> Floor RR Faucet	20572002-128BF	03-11-22	1.10		
22-010G.M129	2 <sup>nd</sup> Floor Breakroom Faucet	20572002-129SF	03-11-22	0.633		

Fixture ID Coding:

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler  
 CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet  
 KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)



# Coleman Creek Consulting, Inc.

## DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District  
 DISTRICT ID#: 467  
 SCHOOL NAME: Mazama High School  
 BUILDING NAME: Concessions  
 BUILDING ID#: 20572005

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
22-010G.M130	Soccer Girl's RR L Faucet	20572005-130BF	03-11-22	14.4		
22-010G.M131	Soccer Girl's RR R Faucet	20572005-131BF	03-11-22	3.80		
22-010G.M132	Soccer Boy's RR L Faucet	20572005-132BF	03-11-22	6.71		
22-010G.M133	Soccer Boy's RR R Faucet	20572005-133BF	03-11-22	7.74		
22-010G.M134	Main Concession Faucet	20572005-134SF	03-11-22	0.798		
22-010G.M135	Football Boy's RR L Faucet	20572005-135BF	03-11-22	1.28		
22-010G.M136	Football Boy's RR M Faucet	20572005-136BF	03-11-22	1.04		
22-010G.M137	Football Boy's RR R Faucet	20572005-137BF	03-11-22	<0.515		
22-010G.M138	Football Girl's RR L Faucet	20572005-138BF	03-11-22	1.54		
22-010G.M139	Football Girl's RR M Faucet	20572005-139BF	03-11-22	<0.515		
22-010G.M140	Football Girl's RR R Faucet	20572005-140BF	03-11-22	2.22		
22-010G.M141	Football Concession L Faucet	20572005-141SF	03-11-22	<0.515		
22-010G.M142	Football Concession R Faucet	20572005-142SF	03-11-22	<0.515		

### Fixture ID Coding:


DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler  
 CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet  
 KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)

**APPENDIX A**

**DRINKING WATER SAMPLE LOCATION  
DIAGRAMS**

# MAZAMA HIGH SCHOOL

## Drinking Water Sample Locations

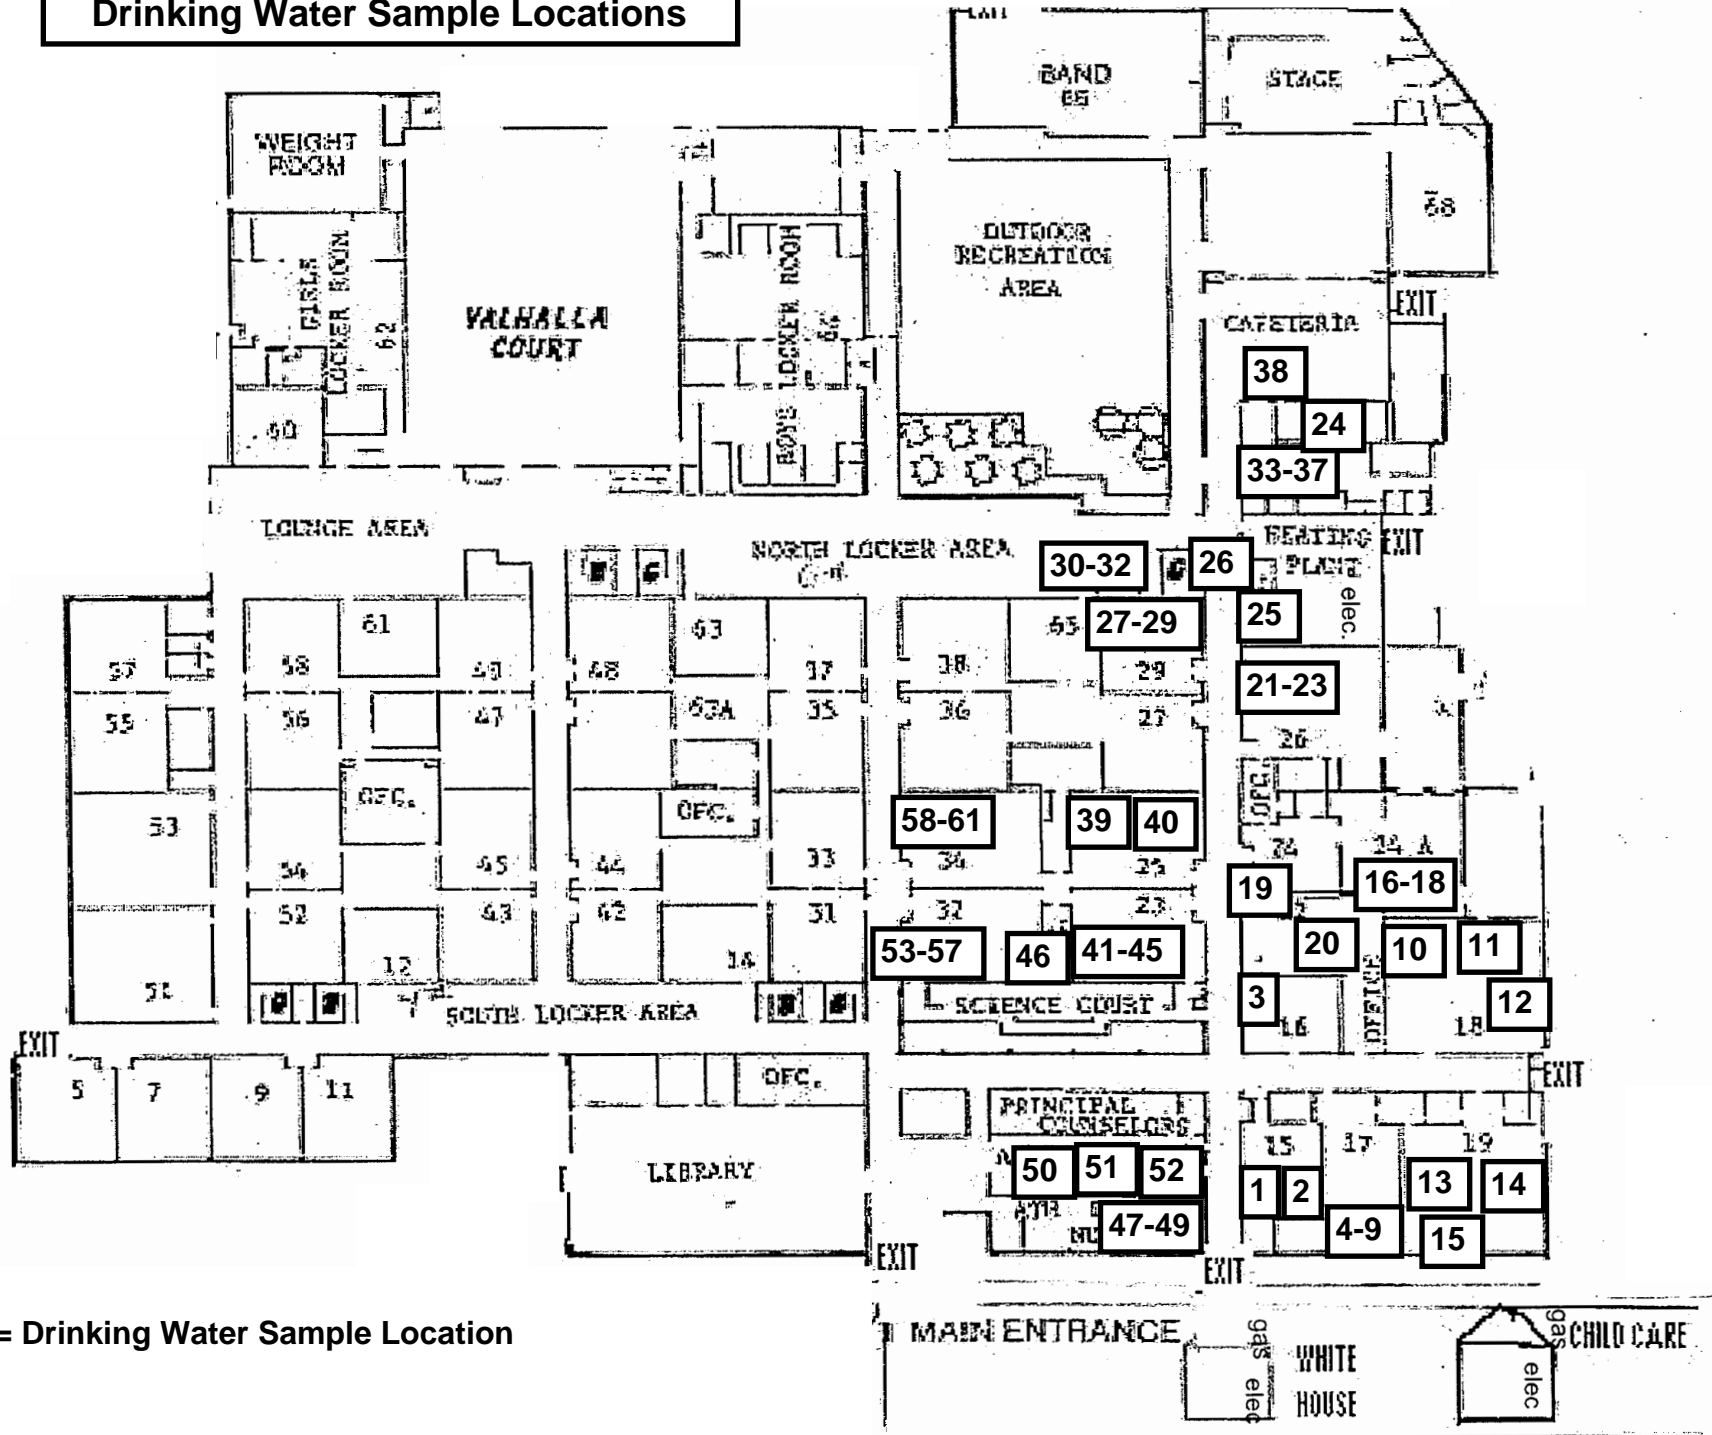

**12** = Drinking Water Sample Location


# MAZAMA HIGH SCHOOL

## Drinking Water Sample Locations

Upper Gym:  
Wrestling

101


102

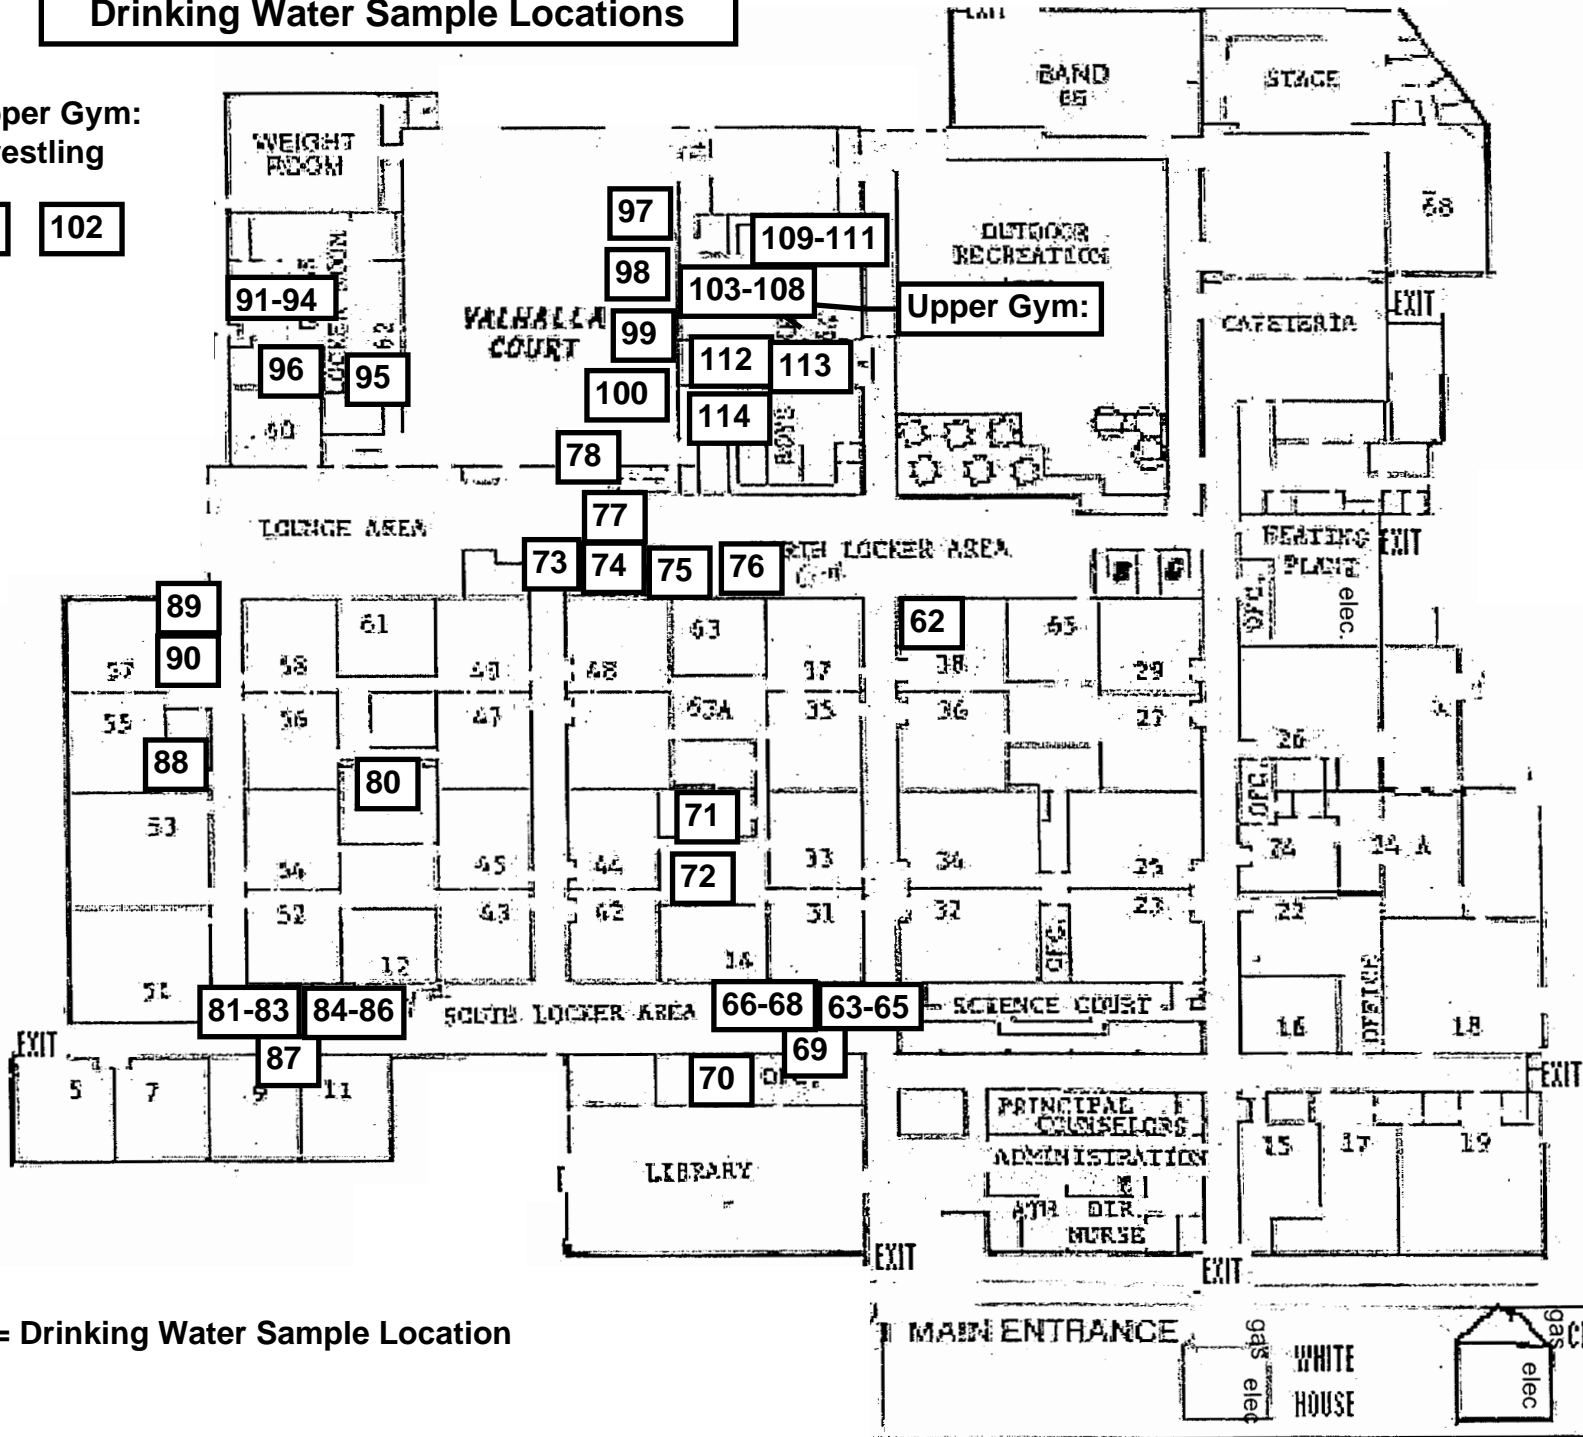

**62** = Drinking Water Sample Location

# Mazama Clinic

8 Faucets Total

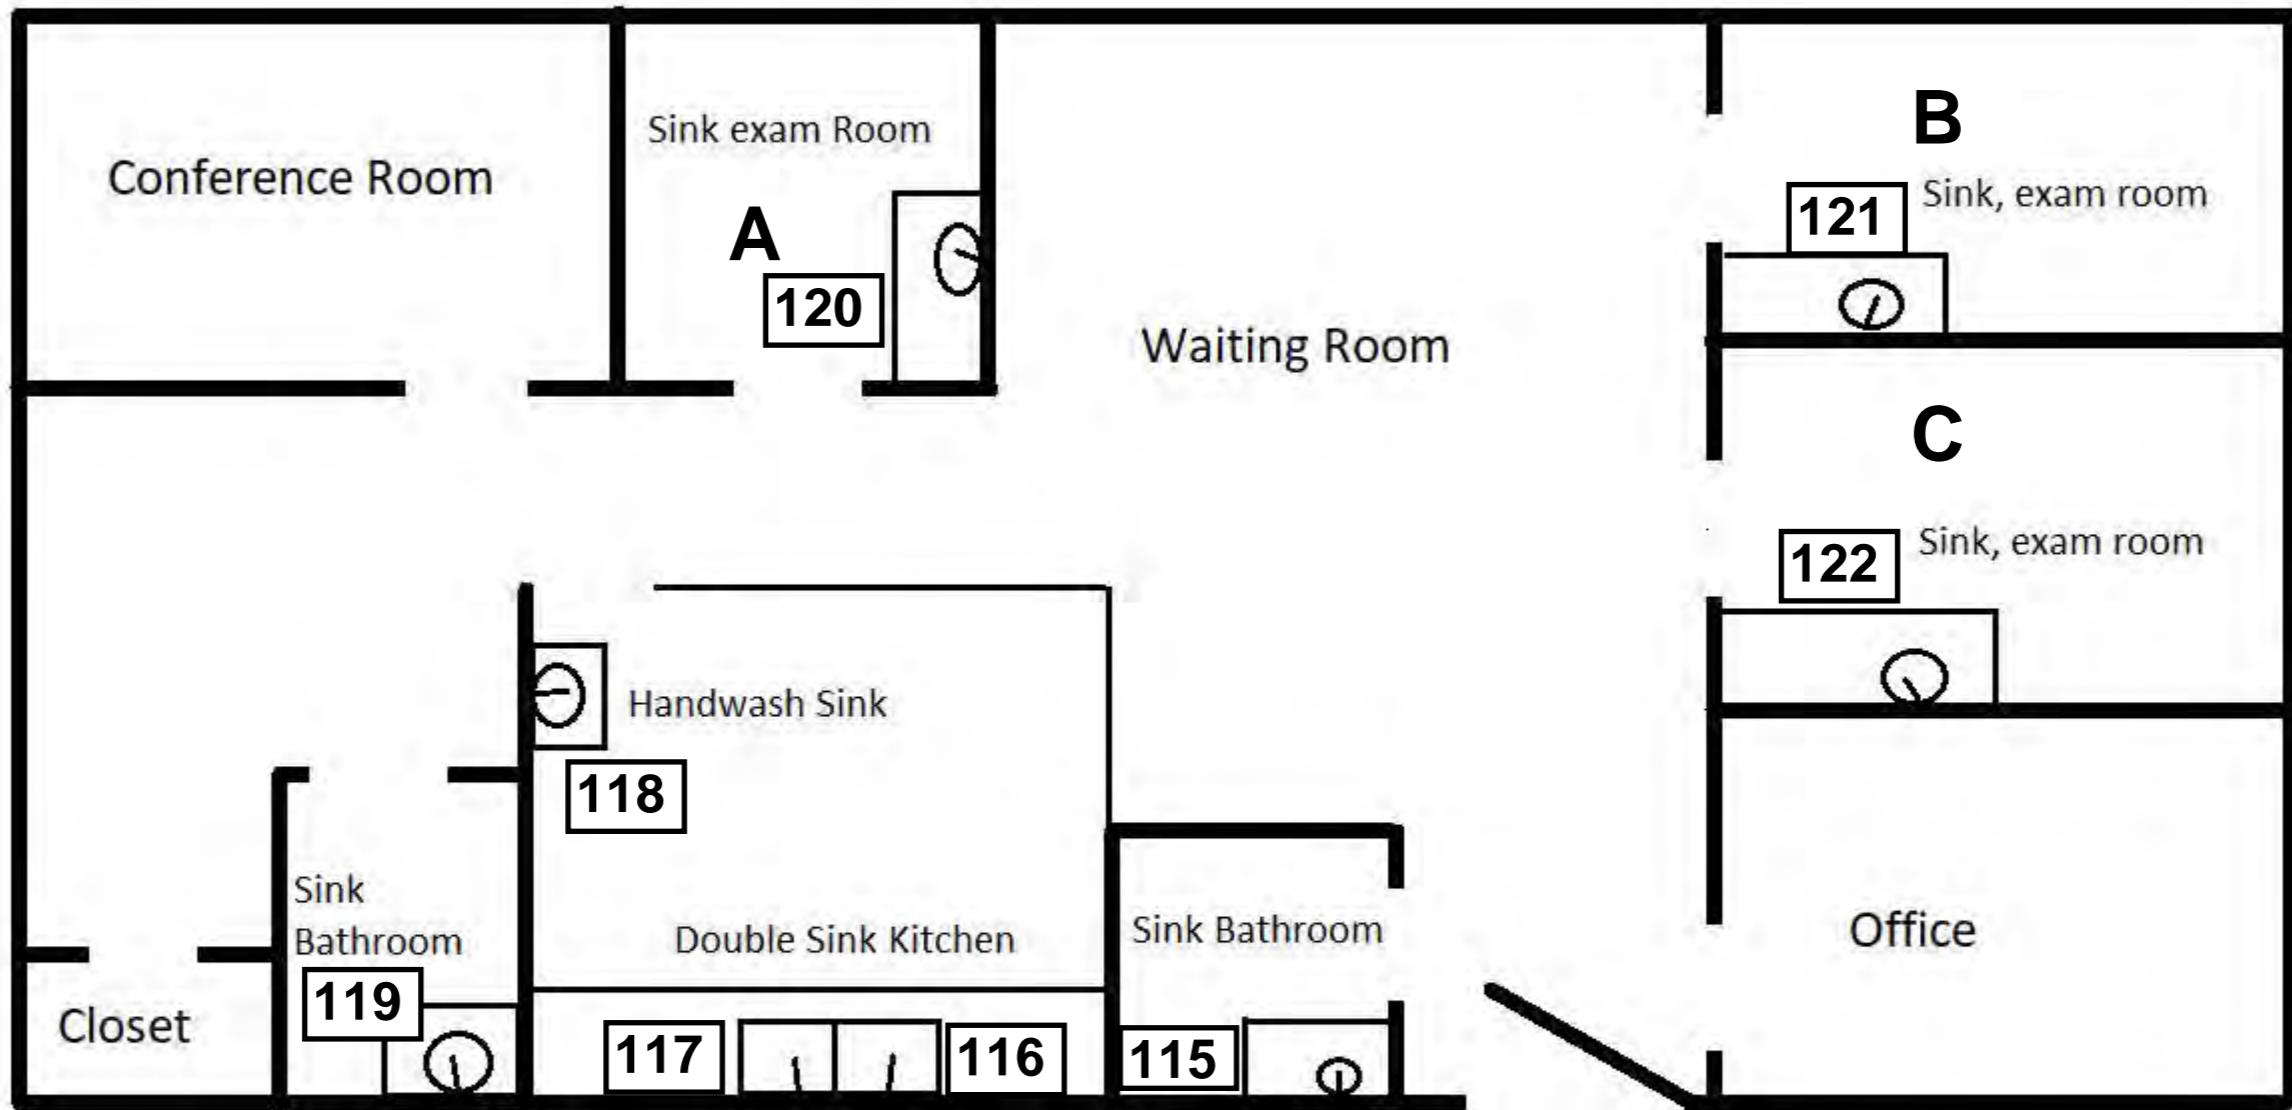


**115** = Drinking Water Sample Location




# Mazama White House

1st floor 5 faucets

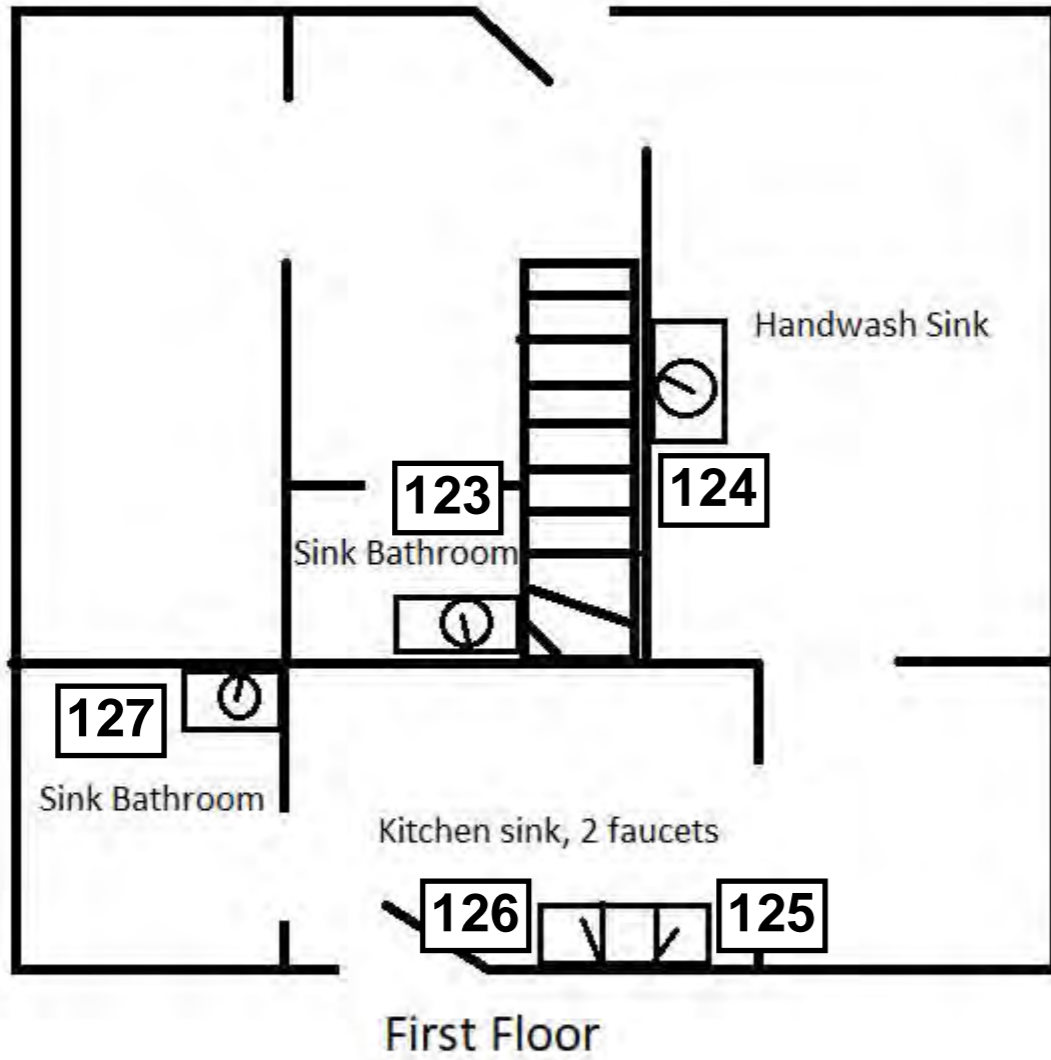

Second floor 2 faucets  
(no kids second floor)

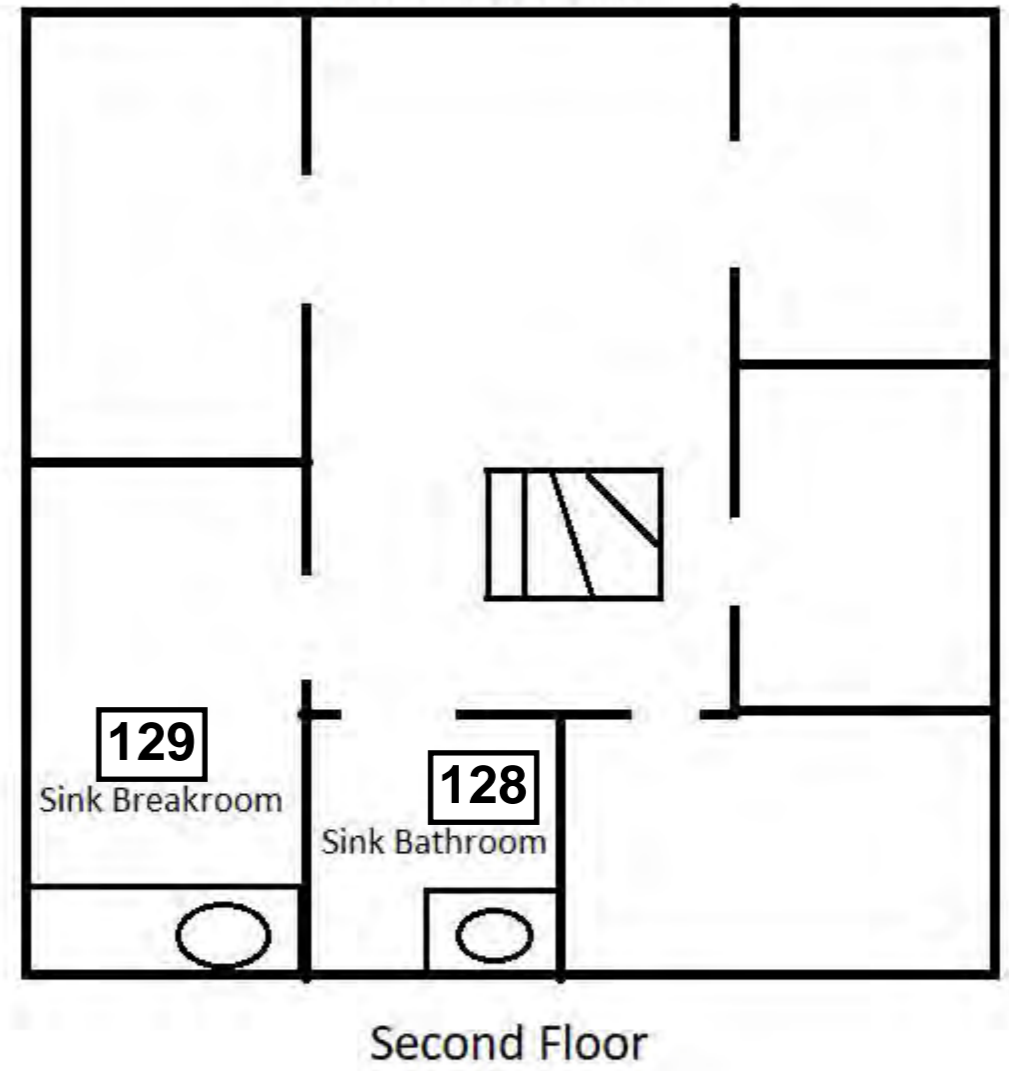

**123** = Drinking Water Sample Location

**APPENDIX B**

**NEILSON RESEARCH CORPORATION  
ANALYTICAL REPORT**



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

March 31, 2022

Dave Fawcett  
Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520  
TEL: (541) 535-7108  
FAX (541) 535-8795

RE: 22-010G Mazama HS

Order No.: 22030644

Dear Dave Fawcett:

Neilson Research Corporation received 141 sample(s) on 3/11/2022 for the analyses presented in the following report.

The results relate only to the parameters tested or to the sample as received by the laboratory. This report shall not be reproduced except in full, without the written approval of Neilson Research Corporation. If you have any questions regarding these test results, please feel free to call.

Sincerely,  
Neilson Research Corporation

Tamra Schmedemann  
Senior Project Manager  
245 S Grape St  
Medford, OR 97501



Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Case Narrative

WO#: 22030644  
Date: 3/31/2022

---

**CLIENT:** Coleman Creek Consulting

**Project:** 22-010G Mazama HS

---

The analyses were performed according to the guidelines in the Neilson Research Corporation Quality Assurance Program. This report contains analytical results for the sample(s) as received by the laboratory.

Neilson Research Corporation certifies that this report is in compliance with the requirements of NELAP. No unusual difficulties were experienced during analysis of this batch except as noted below or qualified with data flags on the reports.

---

Original



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-001      Client Sample ID: 22-010G.M1  
 Collection Date: 3/11/2022 6:20:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS			
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-002      Client Sample ID: 22-010G.M2  
 Collection Date: 3/11/2022 6:20:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS			
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.590		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-003      Client Sample ID: 22-010G.M3  
 Collection Date: 3/11/2022 6:23:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS			
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	1.99		0.515	ppb	1	3/15/2022	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-004      Client Sample ID: 22-010G.M4  
 Collection Date: 3/11/2022 6:30:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.31		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-005      Client Sample ID: 22-010G.M5  
 Collection Date: 3/11/2022 6:31:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.982		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-006      Client Sample ID: 22-010G.M6  
 Collection Date: 3/11/2022 6:32:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.10		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-007      Client Sample ID: 22-010G.M7  
 Collection Date: 3/11/2022 6:33:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS			
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-008      Client Sample ID: 22-010G.M8  
 Collection Date: 3/11/2022 6:35:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS			
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-009      Client Sample ID: 22-010G.M9  
 Collection Date: 3/11/2022 6:36:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS			
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.638		0.515	ppb	1	3/15/2022	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-010      Client Sample ID: 22-010G.M10  
 Collection Date: 3/11/2022 6:52:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.736		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-011      Client Sample ID: 22-010G.M11  
 Collection Date: 3/11/2022 6:53:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-012      Client Sample ID: 22-010G.M12  
 Collection Date: 3/11/2022 6:54:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits





Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-013      Client Sample ID: 22-010G.M13  
 Collection Date: 3/11/2022 6:57:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-014      Client Sample ID: 22-010G.M14  
 Collection Date: 3/11/2022 6:58:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-015      Client Sample ID: 22-010G.M15  
 Collection Date: 3/11/2022 6:59:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-016      Client Sample ID: 22-010G.M16  
 Collection Date: 3/11/2022 7:02:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-017      Client Sample ID: 22-010G.M17  
 Collection Date: 3/11/2022 7:05:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.10		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-018      Client Sample ID: 22-010G.M18  
 Collection Date: 3/11/2022 7:06:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.553		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-019      Client Sample ID: 22-010G.M19  
 Collection Date: 3/11/2022 7:08:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.78		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-020      Client Sample ID: 22-010G.M20  
 Collection Date: 3/11/2022 8:52:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.36		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-021      Client Sample ID: 22-010G.M21  
 Collection Date: 3/11/2022 7:27:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.19		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-022      Client Sample ID: 22-010G.M22  
 Collection Date: 3/11/2022 7:28:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS			
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-023      Client Sample ID: 22-010G.M23  
 Collection Date: 3/11/2022 7:28:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS			
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	2.01		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-024      Client Sample ID: 22-010G.M24  
 Collection Date: 3/11/2022 8:23:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS			
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-025      Client Sample ID: 22-010G.M25  
 Collection Date: 3/11/2022 7:30:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.585		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-026      Client Sample ID: 22-010G.M26  
 Collection Date: 3/11/2022 7:30:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	3.57		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-027      Client Sample ID: 22-010G.M27  
 Collection Date: 3/11/2022 7:41:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

- |                   |  |  |
|-------------------|--|--|
| <b>QUALIFIERS</b> | * Value exceeds Maximum Contaminant Level.   | C1 Sample container temperature is out of limit as specified at testcode |
|                   | E Value above quantitation range             | H Holding times for preparation or analysis exceeded                     |
|                   | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference            |
|                   | ND Not Detected at the Reporting Limit       | PL Permit Limit  |
|                   | R RPD outside accepted recovery limits       |  |

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-028 Client Sample ID: 22-010G.M28  
 Collection Date: 3/11/2022 7:41:00 AM Collected By: Polo Flores  
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-029 Client Sample ID: 22-010G.M29  
 Collection Date: 3/11/2022 7:42:00 AM Collected By: Polo Flores  
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-030 Client Sample ID: 22-010G.M30  
 Collection Date: 3/11/2022 7:43:00 AM Collected By: Polo Flores  
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-031      Client Sample ID: 22-010G.M31  
 Collection Date: 3/11/2022 7:43:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.722		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-032      Client Sample ID: 22-010G.M32  
 Collection Date: 3/11/2022 7:44:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-033      Client Sample ID: 22-010G.M33  
 Collection Date: 3/11/2022 8:12:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.29		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-034      Client Sample ID: 22-010G.M34  
 Collection Date: 3/11/2022 8:12:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.95		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-035      Client Sample ID: 22-010G.M35  
 Collection Date: 3/11/2022 8:09:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-036      Client Sample ID: 22-010G.M36  
 Collection Date: 3/11/2022 8:08:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.22		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits





Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-037      Client Sample ID: 22-010G.M37  
 Collection Date: 3/11/2022 8:10:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS			
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	1.09		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-038      Client Sample ID: 22-010G.M38  
 Collection Date: 3/11/2022 8:07:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS			
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	22.1	*	0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-039      Client Sample ID: 22-010G.M39  
 Collection Date: 3/11/2022 8:24:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS			
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	5.91		0.515	ppb	1	3/15/2022	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-040      Client Sample ID: 22-010G.M40  
 Collection Date: 3/11/2022 8:24:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	7.57		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-041      Client Sample ID: 22-010G.M41  
 Collection Date: 3/11/2022 7:17:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	19.7	*	0.515	ppb	1	3/16/2022	15.0	A

**Lab ID:** 22030644-042      Client Sample ID: 22-010G.M42  
 Collection Date: 3/11/2022 7:18:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.39		0.515	ppb	1	3/16/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-043      Client Sample ID: 22-010G.M43  
 Collection Date: 3/11/2022 7:18:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.00		0.515	ppb	1	3/16/2022	15.0	A

**Lab ID:** 22030644-044      Client Sample ID: 22-010G.M44  
 Collection Date: 3/11/2022 7:19:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	6.93		0.515	ppb	1	3/16/2022	15.0	A

**Lab ID:** 22030644-045      Client Sample ID: 22-010G.M45  
 Collection Date: 3/11/2022 7:19:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.93		0.515	ppb	1	3/16/2022	15.0	A

- |                   |  |  |
|-------------------|--|--|
| <b>QUALIFIERS</b> | * Value exceeds Maximum Contaminant Level.   | C1 Sample container temperature is out of limit as specified at testcode |
|                   | E Value above quantitation range             | H Holding times for preparation or analysis exceeded                     |
|                   | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference            |
|                   | ND Not Detected at the Reporting Limit       | PL Permit Limit  |
|                   | R RPD outside accepted recovery limits       |  |

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-046      Client Sample ID: 22-010G.M46  
 Collection Date: 3/11/2022 5:08:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/16/2022	15.0	A

**Lab ID:** 22030644-047      Client Sample ID: 22-010G.M47  
 Collection Date: 3/11/2022 5:10:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.561		0.515	ppb	1	3/16/2022	15.0	A

**Lab ID:** 22030644-048      Client Sample ID: 22-010G.M48  
 Collection Date: 3/11/2022 5:11:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.651		0.515	ppb	1	3/16/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-049      Client Sample ID: 22-010G.M50  
 Collection Date: 3/11/2022 5:14:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst:	SJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/16/2022	15.0	A	

**Lab ID:** 22030644-050      Client Sample ID: 22-010G.M51  
 Collection Date: 3/11/2022 5:15:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst:	SJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/16/2022	15.0	A	

**Lab ID:** 22030644-051      Client Sample ID: 22-010G.M52  
 Collection Date: 3/11/2022 5:18:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst:	SJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	2.01		0.515	ppb	1	3/16/2022	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-052      Client Sample ID: 22-010G.M53  
 Collection Date: 3/11/2022 7:50:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	2.86		0.515	ppb	1	3/16/2022	15.0	A	

**Lab ID:** 22030644-053      Client Sample ID: 22-010G.M54  
 Collection Date: 3/11/2022 7:50:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	105	*	0.515	ppb	1	3/16/2022	15.0	A	

**Lab ID:** 22030644-054      Client Sample ID: 22-010G.M55  
 Collection Date: 3/11/2022 7:51:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	3.49		0.515	ppb	1	3/16/2022	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-055      Client Sample ID: 22-010G.M56  
 Collection Date: 3/11/2022 7:51:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	3.66		0.515	ppb	1	3/16/2022	15.0	A

**Lab ID:** 22030644-056      Client Sample ID: 22-010G.M57  
 Collection Date: 3/11/2022 7:51:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	108	*	0.515	ppb	1	3/16/2022	15.0	A

**Lab ID:** 22030644-057      Client Sample ID: 22-010G.M58  
 Collection Date: 3/11/2022 8:01:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	8.56		0.515	ppb	1	3/16/2022	15.0	A

- |                   |  |  |
|-------------------|--|--|
| <b>QUALIFIERS</b> | * Value exceeds Maximum Contaminant Level.   | C1 Sample container temperature is out of limit as specified at testcode |
|                   | E Value above quantitation range             | H Holding times for preparation or analysis exceeded                     |
|                   | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference            |
|                   | ND Not Detected at the Reporting Limit       | PL Permit Limit  |
|                   | R RPD outside accepted recovery limits       |  |

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-058      Client Sample ID: 22-010G.M59  
 Collection Date: 3/11/2022 8:01:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.32		0.515	ppb	1	3/16/2022	15.0	A

**Lab ID:** 22030644-059      Client Sample ID: 22-010G.M60  
 Collection Date: 3/11/2022 8:02:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	427	*	5.15	ppb	10	3/29/2022	15.0	A

**Lab ID:** 22030644-060      Client Sample ID: 22-010G.M61  
 Collection Date: 3/11/2022 8:03:00 AM      Collected By: Polo Flores  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	90.0	*	0.515	ppb	1	3/16/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits





Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-061      Client Sample ID: 22-010G.M62  
 Collection Date: 3/11/2022 7:30:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	8.63		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-062      Client Sample ID: 22-010G.M63  
 Collection Date: 3/11/2022 6:07:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-063      Client Sample ID: 22-010G.M64  
 Collection Date: 3/11/2022 6:08:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:


Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

- |                   |  |  |
|-------------------|--|--|
| <b>QUALIFIERS</b> | * Value exceeds Maximum Contaminant Level.   | C1 Sample container temperature is out of limit as specified at testcode |
|                   | E Value above quantitation range             | H Holding times for preparation or analysis exceeded                     |
|                   | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference            |
|                   | ND Not Detected at the Reporting Limit       | PL Permit Limit  |
|                   | R RPD outside accepted recovery limits       |  |

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits

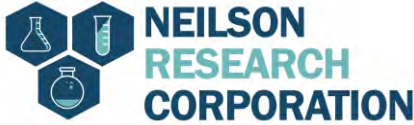

Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-064      Client Sample ID: 22-010G.M65  
 Collection Date: 3/11/2022 6:09:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-065      Client Sample ID: 22-010G.M66  
 Collection Date: 3/11/2022 6:10:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.834		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-066      Client Sample ID: 22-010G.M67  
 Collection Date: 3/11/2022 6:11:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-067      Client Sample ID: 22-010G.M68  
 Collection Date: 3/11/2022 6:12:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-068      Client Sample ID: 22-010G.M69  
 Collection Date: 3/11/2022 6:12:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-069      Client Sample ID: 22-010G.M70  
 Collection Date: 3/11/2022 6:13:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-070      Client Sample ID: 22-010G.M71  
 Collection Date: 3/11/2022 6:15:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.94		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-071      Client Sample ID: 22-010G.M72  
 Collection Date: 3/11/2022 6:16:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	26.0	*	0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-072      Client Sample ID: 22-010G.M73  
 Collection Date: 3/11/2022 6:32:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-073      Client Sample ID: 22-010G.M74  
 Collection Date: 3/11/2022 6:32:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-074      Client Sample ID: 22-010G.M75  
 Collection Date: 3/11/2022 6:33:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-075      Client Sample ID: 22-010G.M76  
 Collection Date: 3/11/2022 6:33:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-076      Client Sample ID: 22-010G.M77  
 Collection Date: 3/11/2022 6:34:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-077      Client Sample ID: 22-010G.M78  
 Collection Date: 3/11/2022 6:35:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.750		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-078      Client Sample ID: 22-010G.M80  
 Collection Date: 3/11/2022 6:38:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.602		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-079 Client Sample ID: 22-010G.M81  
 Collection Date: 3/11/2022 6:41:00 AM Collected By: Jimmy  
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.11		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-080 Client Sample ID: 22-010G.M82  
 Collection Date: 3/11/2022 6:41:00 AM Collected By: Jimmy  
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.06		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-081 Client Sample ID: 22-010G.M83  
 Collection Date: 3/11/2022 6:42:00 AM Collected By: Jimmy  
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.24		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-082      Client Sample ID: 22-010G.M84  
 Collection Date: 3/11/2022 6:43:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.35		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-083      Client Sample ID: 22-010G.M85  
 Collection Date: 3/11/2022 6:44:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.785		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-084      Client Sample ID: 22-010G.M86  
 Collection Date: 3/11/2022 6:44:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.02		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits





Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-085      Client Sample ID: 22-010G.M87  
 Collection Date: 3/11/2022 6:45:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-086      Client Sample ID: 22-010G.M88  
 Collection Date: 3/11/2022 6:46:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.54		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-087      Client Sample ID: 22-010G.M89  
 Collection Date: 3/11/2022 6:47:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-088      Client Sample ID: 22-010G.M90  
 Collection Date: 3/11/2022 6:47:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-089      Client Sample ID: 22-010G.M91  
 Collection Date: 3/11/2022 6:50:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-090      Client Sample ID: 22-010G.M92  
 Collection Date: 3/11/2022 6:50:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-091      Client Sample ID: 22-010G.M93  
 Collection Date: 3/11/2022 6:51:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-092      Client Sample ID: 22-010G.M94  
 Collection Date: 3/11/2022 6:52:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.647		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-093      Client Sample ID: 22-010G.M95  
 Collection Date: 3/11/2022 6:52:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-094      Client Sample ID: 22-010G.M96  
 Collection Date: 3/11/2022 6:53:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-095      Client Sample ID: 22-010G.M97  
 Collection Date: 3/11/2022 6:57:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-096      Client Sample ID: 22-010G.M98  
 Collection Date: 3/11/2022 6:56:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

- |                   |  |  |
|-------------------|--|--|
| <b>QUALIFIERS</b> | * Value exceeds Maximum Contaminant Level.   | C1 Sample container temperature is out of limit as specified at testcode |
|                   | E Value above quantitation range             | H Holding times for preparation or analysis exceeded                     |
|                   | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference            |
|                   | ND Not Detected at the Reporting Limit       | PL Permit Limit  |
|                   | R RPD outside accepted recovery limits       |  |

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-097      Client Sample ID: 22-010G.M99  
 Collection Date: 3/11/2022 6:58:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.615		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-098      Client Sample ID: 22-010G.M100  
 Collection Date: 3/11/2022 6:58:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-099      Client Sample ID: 22-010G.M101  
 Collection Date: 3/11/2022 7:08:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:


Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	1.45		0.515	ppb	1	3/15/2022	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits

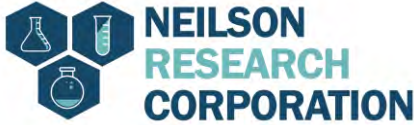

Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-100      Client Sample ID: 22-010G.M102  
 Collection Date: 3/11/2022 7:08:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-101      Client Sample ID: 22-010G.M103  
 Collection Date: 3/11/2022 7:10:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-102      Client Sample ID: 22-010G.M104  
 Collection Date: 3/11/2022 7:10:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-103      Client Sample ID: 22-010G.M105  
 Collection Date: 3/11/2022 7:11:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-104      Client Sample ID: 22-010G.M106  
 Collection Date: 3/11/2022 7:11:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.556		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-105      Client Sample ID: 22-010G.M107  
 Collection Date: 3/11/2022 7:12:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-106      Client Sample ID: 22-010G.M108  
 Collection Date: 3/11/2022 7:12:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-107      Client Sample ID: 22-010G.M109  
 Collection Date: 3/11/2022 7:13:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-108      Client Sample ID: 22-010G.M110  
 Collection Date: 3/11/2022 7:13:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits





Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-109      Client Sample ID: 22-010G.M111  
 Collection Date: 3/11/2022 7:14:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-110      Client Sample ID: 22-010G.M112  
 Collection Date: 3/11/2022 7:15:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

**Lab ID:** 22030644-111      Client Sample ID: 22-010G.M113  
 Collection Date: 3/11/2022 7:16:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-112      Client Sample ID: 22-010G.M114  
 Collection Date: 3/11/2022 7:16:00 AM      Collected By: Jimmy  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-113      Client Sample ID: 22-010G.M115  
 Collection Date: 3/11/2022 6:05:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.68		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-114      Client Sample ID: 22-010G.M116  
 Collection Date: 3/11/2022 6:06:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.877		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-115      Client Sample ID: 22-010G.M117  
 Collection Date: 3/11/2022 6:06:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.577		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-116      Client Sample ID: 22-010G.M118  
 Collection Date: 3/11/2022 6:07:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.92		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-117      Client Sample ID: 22-010G.M119  
 Collection Date: 3/11/2022 6:08:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-118 Client Sample ID: 22-010G.M120  
 Collection Date: 3/11/2022 6:09:00 AM Collected By: Darin Martins  
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	3.49		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-119 Client Sample ID: 22-010G.M121  
 Collection Date: 3/11/2022 6:09:00 AM Collected By: Darin Martins  
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.32		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-120 Client Sample ID: 22-010G.M122  
 Collection Date: 3/11/2022 6:10:00 AM Collected By: Darin Martins  
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.47		0.515	ppb	1	3/15/2022	15.0	A

- |                   |  |  |
|-------------------|--|--|
| <b>QUALIFIERS</b> | * Value exceeds Maximum Contaminant Level.   | C1 Sample container temperature is out of limit as specified at testcode |
|                   | E Value above quantitation range             | H Holding times for preparation or analysis exceeded                     |
|                   | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference            |
|                   | ND Not Detected at the Reporting Limit       | PL Permit Limit  |
|                   | R RPD outside accepted recovery limits       |  |

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-121      Client Sample ID: 22-010G.M123  
 Collection Date: 3/11/2022 6:23:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.03		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-122      Client Sample ID: 22-010G.M124  
 Collection Date: 3/11/2022 6:23:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.539		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-123      Client Sample ID: 22-010G.M125  
 Collection Date: 3/11/2022 6:24:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

- |                   |  |  |
|-------------------|--|--|
| <b>QUALIFIERS</b> | * Value exceeds Maximum Contaminant Level.   | C1 Sample container temperature is out of limit as specified at testcode |
|                   | E Value above quantitation range             | H Holding times for preparation or analysis exceeded                     |
|                   | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference            |
|                   | ND Not Detected at the Reporting Limit       | PL Permit Limit  |
|                   | R RPD outside accepted recovery limits       |  |

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-124      Client Sample ID: 22-010G.M126  
 Collection Date: 3/11/2022 6:24:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.91		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-125      Client Sample ID: 22-010G.M127  
 Collection Date: 3/11/2022 6:24:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-126      Client Sample ID: 22-010G.M128  
 Collection Date: 3/11/2022 6:26:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.10		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-127      Client Sample ID: 22-010G.M129  
 Collection Date: 3/11/2022 6:27:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.633		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-128      Client Sample ID: 22-010G.M130  
 Collection Date: 3/11/2022 6:28:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	14.4		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-129      Client Sample ID: 22-010G.M131  
 Collection Date: 3/11/2022 6:35:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	3.80		0.515	ppb	1	3/15/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-130      Client Sample ID: 22-010G.M132  
 Collection Date: 3/11/2022 6:38:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	6.71		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-131      Client Sample ID: 22-010G.M133  
 Collection Date: 3/11/2022 6:38:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	7.74		0.515	ppb	1	3/15/2022	15.0	A

**Lab ID:** 22030644-132      Client Sample ID: 22-010G.M134  
 Collection Date: 3/11/2022 6:42:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.798		0.515	ppb	1	3/15/2022	15.0	A

- |                   |  |  |
|-------------------|--|--|
| <b>QUALIFIERS</b> | * Value exceeds Maximum Contaminant Level.   | C1 Sample container temperature is out of limit as specified at testcode |
|                   | E Value above quantitation range             | H Holding times for preparation or analysis exceeded                     |
|                   | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference            |
|                   | ND Not Detected at the Reporting Limit       | PL Permit Limit  |
|                   | R RPD outside accepted recovery limits       |  |

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits





Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-133      Client Sample ID: 22-010G.M135  
 Collection Date: 3/11/2022 6:57:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.28		0.515	ppb	1	3/16/2022	15.0	A

**Lab ID:** 22030644-134      Client Sample ID: 22-010G.M136  
 Collection Date: 3/11/2022 6:57:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.04		0.515	ppb	1	3/16/2022	15.0	A

**Lab ID:** 22030644-135      Client Sample ID: 22-010G.M137  
 Collection Date: 3/11/2022 6:57:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/16/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-136      Client Sample ID: 22-010G.M138  
 Collection Date: 3/11/2022 6:59:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.54		0.515	ppb	1	3/16/2022	15.0	A

**Lab ID:** 22030644-137      Client Sample ID: 22-010G.M139  
 Collection Date: 3/11/2022 6:59:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/16/2022	15.0	A

**Lab ID:** 22030644-138      Client Sample ID: 22-010G.M140  
 Collection Date: 3/11/2022 7:00:00 AM      Collected By: Darin Martins  
 Matrix: Drinking Water      Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.22		0.515	ppb	1	3/16/2022	15.0	A

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 22030644  
 Date Reported: 3/31/2022

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 22030644  
**Received Date:** 3/11/2022 4:21:00 PM  
**Reported Date:** 3/31/2022 3:49:54 PM

Sample Information:

**Lab ID:** 22030644-139 Client Sample ID: 22-010G.M141  
 Collection Date: 3/11/2022 7:01:00 AM Collected By: Darin Martins  
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/16/2022	15.0	A	

**Lab ID:** 22030644-140 Client Sample ID: 22-010G.M142  
 Collection Date: 3/11/2022 7:01:00 AM Collected By: Darin Martins  
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/16/2022	15.0	A	

**Lab ID:** 22030644-141 Client Sample ID: 22-010G.M49  
 Collection Date: 3/11/2022 5:12:00 AM Collected By: Polo Flores  
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/30/2022	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

Results are out of the EPA limits



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# QC SUMMARY REPORT

WO#: 22030644  
 31-Mar-22

**Client:** Coleman Creek Consulting  
**Project:** 22-010G Mazama HS

**TestCode:** LEAD\_DW

Sample ID: <b>MB-16028</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/14/2022</b>	RunNo: <b>28466</b>
Client ID: <b>PBW</b>	Batch ID: <b>16028</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>460926</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead	ND	0.515									
------	----	-------	--	--	--	--	--	--	--	--	--

Sample ID: <b>LCS-16028</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/14/2022</b>	RunNo: <b>28466</b>
Client ID: <b>LCSW</b>	Batch ID: <b>16028</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>460927</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead	103	0.520	100	0	103	85	115				
------	-----	-------	-----	---	-----	----	-----	--	--	--	--

Sample ID: <b>22030644-020AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/14/2022</b>	RunNo: <b>28466</b>
Client ID: <b>22-010G.M20</b>	Batch ID: <b>16028</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>460950</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead	102	0.520	100	2.36	99.9	70	130				
------	-----	-------	-----	------	------	----	-----	--	--	--	--

Sample ID: <b>22030644-020AMSD</b>	SampType: <b>MSD</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/14/2022</b>	RunNo: <b>28466</b>
Client ID: <b>22-010G.M20</b>	Batch ID: <b>16028</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>460951</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead	96.8	0.520	100	2.36	94.5	70	130	102	5.43	20	
------	------	-------	-----	------	------	----	-----	-----	------	----	--

**Qualifiers:** \* Value exceeds Maximum Contaminant Level. CI Sample container temperature is out of limit as specified at testcode H Holding times for preparation or analysis exceeded  
 MI Recovery outside control limits due to Matrix Interference ND Not Detected at the Reporting Limit PL Permit Limit  
 RL Reporting Detection Limit

Original



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# QC SUMMARY REPORT

WO#: 22030644  
 31-Mar-22

**Client:** Coleman Creek Consulting  
**Project:** 22-010G Mazama HS

**TestCode:** LEAD\_DW

Sample ID: <b>MB-16029</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/14/2022</b>	RunNo: <b>28466</b>
Client ID: <b>PBW</b>	Batch ID: <b>16029</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>460954</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead ND 0.515

Sample ID: <b>LCS-16029</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/14/2022</b>	RunNo: <b>28466</b>
Client ID: <b>LCSW</b>	Batch ID: <b>16029</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>460955</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 102 0.520 100 0 102 85 115

Sample ID: <b>22030644-040AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/14/2022</b>	RunNo: <b>28466</b>
Client ID: <b>22-010G.M40</b>	Batch ID: <b>16029</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>460978</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual


Lead 105 0.520 100 7.57 97.4 70 130

Sample ID: <b>22030644-040AMSD</b>	SampType: <b>MSD</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/14/2022</b>	RunNo: <b>28466</b>
Client ID: <b>22-010G.M40</b>	Batch ID: <b>16029</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>460979</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 108 0.520 100 7.57 100 70 130 105 2.69 20

**Qualifiers:** \* Value exceeds Maximum Contaminant Level. CI Sample container temperature is out of limit as specified at testcode H Holding times for preparation or analysis exceeded  
 MI Recovery outside control limits due to Matrix Interference ND Not Detected at the Reporting Limit PL Permit Limit  
 RL Reporting Detection Limit

Original

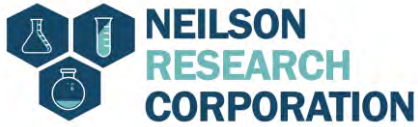

Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# QC SUMMARY REPORT

WO#: 22030644  
 31-Mar-22

**Client:** Coleman Creek Consulting  
**Project:** 22-010G Mazama HS

**TestCode:** LEAD\_DW

Sample ID: <b>MB-16033</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/15/2022</b>	RunNo: <b>28466</b>
Client ID: <b>PBW</b>	Batch ID: <b>16033</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>460982</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead ND 0.515

Sample ID: <b>LCS-16033</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/15/2022</b>	RunNo: <b>28466</b>
Client ID: <b>LCSW</b>	Batch ID: <b>16033</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>460983</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 99.5 0.520 100 0 99.5 85 115

Sample ID: <b>22030644-080AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/15/2022</b>	RunNo: <b>28466</b>
Client ID: <b>22-010G.M82</b>	Batch ID: <b>16033</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>461006</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 101 0.520 100 1.06 99.9 70 130

Sample ID: <b>22030644-080AMSD</b>	SampType: <b>MSD</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/15/2022</b>	RunNo: <b>28466</b>
Client ID: <b>22-010G.M82</b>	Batch ID: <b>16033</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>461007</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 99.1 0.520 100 1.06 98.1 70 130 101 1.78 20

**Qualifiers:** \* Value exceeds Maximum Contaminant Level. CI Sample container temperature is out of limit as specified at testcode H Holding times for preparation or analysis exceeded  
 MI Recovery outside control limits due to Matrix Interference ND Not Detected at the Reporting Limit PL Permit Limit  
 RL Reporting Detection Limit

Original



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# QC SUMMARY REPORT

WO#: 22030644  
 31-Mar-22

**Client:** Coleman Creek Consulting  
**Project:** 22-010G Mazama HS

**TestCode:** LEAD\_DW

Sample ID: <b>MB-16034</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/15/2022</b>	RunNo: <b>28466</b>
Client ID: <b>PBW</b>	Batch ID: <b>16034</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>461010</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual
Lead	ND	0.515			

Sample ID: <b>LCS-16034</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/15/2022</b>	RunNo: <b>28466</b>
Client ID: <b>LCSW</b>	Batch ID: <b>16034</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>461011</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual
Lead	102	0.520	100	0	102 85 115

Sample ID: <b>22030644-100AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/15/2022</b>	RunNo: <b>28466</b>
Client ID: <b>22-010G.M102</b>	Batch ID: <b>16034</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>461034</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual
Lead	99.1	0.520	100	0.188	98.9 70 130

Sample ID: <b>22030644-100AMSD</b>	SampType: <b>MSD</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/15/2022</b>	RunNo: <b>28466</b>
Client ID: <b>22-010G.M102</b>	Batch ID: <b>16034</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>461035</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual
Lead	100	0.520	100	0.188	99.8 70 130 99.1 0.899 20

**Qualifiers:** \* Value exceeds Maximum Contaminant Level. CI Sample container temperature is out of limit as specified at testcode H Holding times for preparation or analysis exceeded  
 MI Recovery outside control limits due to Matrix Interference ND Not Detected at the Reporting Limit PL Permit Limit  
 RL Reporting Detection Limit

Original



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# QC SUMMARY REPORT

WO#: 22030644  
 31-Mar-22

**Client:** Coleman Creek Consulting  
**Project:** 22-010G Mazama HS

**TestCode:** LEAD\_DW

Sample ID: <b>MB-16035</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/15/2022</b>	RunNo: <b>28466</b>
Client ID: <b>PBW</b>	Batch ID: <b>16035</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>461038</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead ND 0.515

Sample ID: <b>LCS-16035</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/15/2022</b>	RunNo: <b>28466</b>
Client ID: <b>LCSW</b>	Batch ID: <b>16035</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>461039</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 102 0.520 100 0 102 85 115

Sample ID: <b>22030644-120AMSD</b>	SampType: <b>MSD</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/15/2022</b>	RunNo: <b>28466</b>
Client ID: <b>22-010G.M122</b>	Batch ID: <b>16035</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>461051</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 103 0.520 100 1.47 101 70 130 102 1.21 20


Sample ID: <b>MB-16036</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/15/2022</b>	RunNo: <b>28466</b>
Client ID: <b>PBW</b>	Batch ID: <b>16036</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>461054</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead ND 0.515

**Qualifiers:** \* Value exceeds Maximum Contaminant Level. CI Sample container temperature is out of limit as specified at testcode H Holding times for preparation or analysis exceeded  
 MI Recovery outside control limits due to Matrix Interference ND Not Detected at the Reporting Limit PL Permit Limit  
 RL Reporting Detection Limit

Original



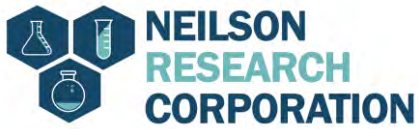

Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# QC SUMMARY REPORT

WO#: 22030644  
 31-Mar-22

**Client:** Coleman Creek Consulting  
**Project:** 22-010G Mazama HS

**TestCode:** LEAD\_DW

Sample ID: <b>LCS-16036</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/15/2022</b>	RunNo: <b>28466</b>						
Client ID: <b>LCSW</b>	Batch ID: <b>16036</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>461055</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead 102 0.520 100 0 102 85 115

Sample ID: <b>22030644-140AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/15/2022</b>	RunNo: <b>28466</b>						
Client ID: <b>22-010G.M142</b>	Batch ID: <b>16036</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/16/2022</b>	SeqNo: <b>461078</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead 100 0.520 100 0.505 99.9 70 130

Sample ID: <b>22030644-140AMSD</b>	SampType: <b>MSD</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/15/2022</b>	RunNo: <b>28466</b>						
Client ID: <b>22-010G.M142</b>	Batch ID: <b>16036</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/16/2022</b>	SeqNo: <b>461079</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual


Lead 101 0.520 100 0.505 101 70 130 100 0.783 20

Sample ID: <b>MB-16030</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/14/2022</b>	RunNo: <b>28466</b>						
Client ID: <b>PBW</b>	Batch ID: <b>16030</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/16/2022</b>	SeqNo: <b>461082</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead ND 0.515

**Qualifiers:** \* Value exceeds Maximum Contaminant Level. CI Sample container temperature is out of limit as specified at testcode H Holding times for preparation or analysis exceeded  
 MI Recovery outside control limits due to Matrix Interference ND Not Detected at the Reporting Limit PL Permit Limit  
 RL Reporting Detection Limit

Original

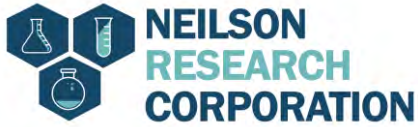

Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# QC SUMMARY REPORT

WO#: 22030644  
 31-Mar-22

**Client:** Coleman Creek Consulting  
**Project:** 22-010G Mazama HS

**TestCode:** LEAD\_DW

Sample ID: <b>LCS-16030</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/14/2022</b>	RunNo: <b>28466</b>
Client ID: <b>LCSW</b>	Batch ID: <b>16030</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/16/2022</b>	SeqNo: <b>461083</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead	104	0.520	100	0	104 85 115
------	-----	-------	-----	---	------------

Sample ID: <b>22030644-060AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/14/2022</b>	RunNo: <b>28466</b>
Client ID: <b>22-010G.M61</b>	Batch ID: <b>16030</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/16/2022</b>	SeqNo: <b>461106</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead	191	0.520	100	90.0	101 70 130
------	-----	-------	-----	------	------------

Sample ID: <b>22030644-060AMSD</b>	SampType: <b>MSD</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/14/2022</b>	RunNo: <b>28466</b>
Client ID: <b>22-010G.M61</b>	Batch ID: <b>16030</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/16/2022</b>	SeqNo: <b>461107</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead	192	0.520	100	90.0	102 70 130 191 0.718 20
------	-----	-------	-----	------	-------------------------


Sample ID: <b>22030644-120AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/15/2022</b>	RunNo: <b>28466</b>
Client ID: <b>22-010G.M122</b>	Batch ID: <b>16035</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/15/2022</b>	SeqNo: <b>461121</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead	102	0.520	100	1.47	100 70 130
------	-----	-------	-----	------	------------

**Qualifiers:**

* Value exceeds Maximum Contaminant Level.	CI Sample container temperature is out of limit as specified at testcode	H Holding times for preparation or analysis exceeded
MI Recovery outside control limits due to Matrix Interference	ND Not Detected at the Reporting Limit	PL Permit Limit
RL Reporting Detection Limit		

Original

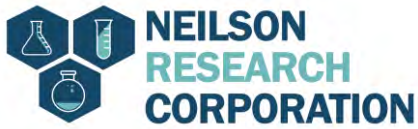

Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# QC SUMMARY REPORT

WO#: 22030644  
 31-Mar-22

**Client:** Coleman Creek Consulting  
**Project:** 22-010G Mazama HS

**TestCode:** LEAD\_DW

Sample ID: <b>MB-16072</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/18/2022</b>	RunNo: <b>28808</b>
Client ID: <b>PBW</b>	Batch ID: <b>16072</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/30/2022</b>	SeqNo: <b>469079</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead ND 0.515

Sample ID: <b>LCS-16072</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/18/2022</b>	RunNo: <b>28808</b>
Client ID: <b>LCSW</b>	Batch ID: <b>16072</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/30/2022</b>	SeqNo: <b>469080</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 97.6 0.520 100 0 97.6 85 115

Sample ID: <b>22030644-141AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/18/2022</b>	RunNo: <b>28808</b>
Client ID: <b>22-010G.M49</b>	Batch ID: <b>16072</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/30/2022</b>	SeqNo: <b>469096</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual


Lead 94.9 0.520 100 0.148 94.7 70 130

Sample ID: <b>22030644-141AMSD</b>	SampType: <b>MSD</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>3/18/2022</b>	RunNo: <b>28808</b>
Client ID: <b>22-010G.M49</b>	Batch ID: <b>16072</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>3/30/2022</b>	SeqNo: <b>469097</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 94.7 0.520 100 0.148 94.6 70 130 94.9 0.173 20

**Qualifiers:** \* Value exceeds Maximum Contaminant Level. CI Sample container temperature is out of limit as specified at testcode H Holding times for preparation or analysis exceeded  
 MI Recovery outside control limits due to Matrix Interference ND Not Detected at the Reporting Limit PL Permit Limit  
 RL Reporting Detection Limit

Original

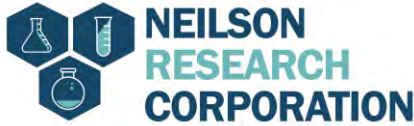

Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Sample Log-In Check List

Client Name: **ColemanCreek** Work Order Number: **22030644** RcptNo: **1**

Logged by:	<b>Tammy Kreutzer</b>	<b>3/11/2022 4:21:00 PM</b>	<i>Tammy Kreutzer</i>
Completed By:	<b>Katherine Root</b>	<b>3/17/2022 11:09:08 AM</b>	<i>Katherine Root</i>
Reviewed By:	<b>Tamra Schmedemann</b>	<b>3/31/2022 3:29:52 PM</b>	<i>Tamra Schmedemann</i>

### Chain of Custody

1. Is Chain of Custody complete? Yes  No  Not Present   
 2. How was the sample delivered? Client

### Log In

3. Coolers are present? Yes  No  NA   
 4. Shipping container/cooler in good condition? Yes  No   
 Custody seals intact on shipping container/cooler? Yes  No  Not Present   
 No. Seal Date: Signed By:  
 5. Was an attempt made to cool the samples? Yes  No  NA   
 6. Were all samples received at a temperature of >0° C to 6.0°C Yes  No  NA   
 7. Sample(s) in proper container(s)? Yes  No   
 8. Sufficient sample volume for indicated test(s)? Yes  No   
 9. Are samples (except VOA and ONG) properly preserved? Yes  No   
 10. Was preservative added to bottles? Yes  No  NA   
 HNO3 pH<2  
 11. Is the headspace in the VOA vials less than 1/4 inch or 6 mm? Yes  No  No VOA Vials   
 12. Were any sample containers received broken? Yes  No   
 13. Does paperwork match bottle labels? Yes  No   
 (Note discrepancies on chain of custody)  
 14. Are matrices correctly identified on Chain of Custody? Yes  No   
 15. Is it clear what analyses were requested? Yes  No   
 16. Were all holding times able to be met? Yes  No   
 (If no, notify customer for authorization.)

### Special Handling (if applicable)

17. Was client notified of all discrepancies with this order? Yes  No  NA

Person Notified:	<input type="text"/>	Date:	<input type="text"/>
By Whom:	<input type="text"/>	Via:	<input type="checkbox"/> eMail <input type="checkbox"/> Phone <input type="checkbox"/> Fax <input type="checkbox"/> In Person
Regarding:	<input type="text"/>		
Client Instructions:	<input type="text"/>		

18. Additional remarks:  
 The samples submitted for Sample ID 22030644-11A, 34A, 39A, 53A, 55A, 56A, 57A, 71A, 113A, 129A, 133A, 138A contained visible sediments and 53A, 56A, 71A were tan in color.

### Cooler Information

Cooler No	Temp °C	Condition	Seal Intact	Seal No	Seal Date	Signed By
-----------	---------	-----------	-------------	---------	-----------	-----------


This Chain of Custody is a LEGAL DOCUMENT and must be filled out accurately.

<b>Section A</b> Required Client Information	<b>Section B</b> Required Project Information	<b>Section C</b> Invoice Information	<b>Section D</b> Rush Status (Subject to Scheduling)
Company: Coleman Creek Consulting, Inc.	Project Name: Mazama HS	Attention:	X
Address: 810 Leonard Street	Project Number: 22-010G	Company Name:	___ Priority: 5 Business Days (List x 1.50)
Ashland, OR 97520	Report To:	Address:	___ Express: 3 Business Days (List x 1.75)
Email: fawbro@ccountry.net	Copy To:		___ Rush: 2 Business Days (List x 2.00)
Phone: 541-944-5318 Fax:			___ Rush: Same Day (List x 3.00)
Collected By (Print): David W. Fawcett			Authorized ___ Yes ___ No
Collected By (Sign):	<b>Analysis Requested</b>		
Email Report ___ Mail Report ___ Fax Report ___			

Section E Sample Information					No. of Containers	Analysis Requested										NRC Workorder # (Lab Use Only) <u>22030644</u>	
Sample ID	Comp/Grab	Matrix*	Date Collected	Time Collected												Remarks / Field Data	NRC Sample # (Lab Use Only)
<u>22-010G.MC-M78</u>	<u>Grab</u>	<u>DW</u>	<u>3-11-22</u>		<u>78</u>												
<u>M80-M142</u>	<u>Grab</u>	<u>DW</u>	<u>3-11-22</u>		<u>63</u>												

\*Matrix: DW - Drinking Water WW - Wastewater W - Water S - Soil/Solid SL - Sludge O - Oil WP - Wipe OT - Other

<b>Section F</b> Relinquish/Receive				<b>Section G</b> Lab Use Only			
Relinquished By: <u>[Signature]</u>	Sign	Print: <u>David W Fawcett</u>	Date: <u>3-11-22</u>	Time: <u>16:21</u>	Temp: <u>amb</u>	4°C +/- 2°C: ___ Yes <u>X</u> No	Received on Ice: ___ Yes <u>X</u> No
Received By:					Number of Bottles Received: <u>141</u>	pH Checked: <u>NA</u>	COC Seals Intact: ___ Yes ___ No <u>X</u> NA
Relinquished By:					Field Blank Included: ___ Yes <u>X</u> No	Received Via ___ UPS ___ FedEX ___ Other <u>X</u> Hand	
Received By:					Payment: <u>X</u> Invoice ___ Cash ___ VISA, M/C ___ Check # ___ Amount ___		
Relinquished By:							
Received By Laboratory: <u>Tamra Schneider</u>		Print: <u>Tamra Schneider</u>	Date: <u>3-11-22</u>	Time: <u>16:21</u>			



# Coleman Creek Consulting, Inc.

## DRINKING WATER SITE SAMPLE RECORD SHEET


BUILDING: Mazama High School  
 ADDRESS: 3009 Summers Lane  
 Klamath Falls, Oregon

DATE: 03-11-22  
 INSPECTOR: Polo Flores

22030644

	SAMPLE #	SAMPLE TYPE	LOCATION	TIME
01	22-010G.M1	DW	Room 15 L Faucet	6:20
02	22-010G.M2	DW	Room 15 R Faucet	6:20
03	22-010G.M3	DW	Room 16 Faucet	6:23
04	22-010G.M4	DW	Room 17 L Faucet	6:30
05	22-010G.M5	DW	Room 17 LM Faucet	6:31
06	22-010G.M6	DW	Room 17 LMM Faucet	6:32
07	22-010G.M7	DW	Room 17 RMM Faucet	6:33
08	22-010G.M8	DW	Room 17 RM Faucet	6:35
09	22-010G.M9	DW	Room 17 R Faucet	6:36
10	22-010G.M10	DW	Room 18 L Faucet	6:52
11	22-010G.M11	DW	Room 18 M Faucet	6:53
12	22-010G.M12	DW	Room 18 R Faucet	6:54
13	22-010G.M13	DW	Room 19 L Faucet	6:57
14	22-010G.M14	DW	Room 19 M Faucet	6:58
15	22-010G.M15	DW	Room 19 R Faucet	6:59
16	22-010G.M16	DW	Room 24A L Faucet	7:02
17	22-010G.M17	DW	Room 24A M Faucet	7:05
18	22-010G.M18	DW	Room 24A R Faucet	7:06
19	22-010G.M19	DW	Room 24 Fountain	7:08
20	22-010G.M20	DW	Room 24 Sink Faucet <del>24</del> Rm 22	7:52

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
 LM = Left Middle LMM = Left Middle Middle RMM = Right Middle Middle M = Middle



# Coleman Creek Consulting, Inc.

## DRINKING WATER SITE SAMPLE RECORD SHEET


BUILDING: Mazama High School  
 ADDRESS: 3009 Summers Lane  
 Klamath Falls, Oregon

DATE: 03-11-22  
 INSPECTOR: Polo Flores

220306AA

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
21	22-010G.M21	DW Room 24 L Faucet <del>26</del>	7:27
22	22-010G.M22	DW Room <del>24</del> LM Faucet <del>26</del> Rm 26	7:28
23	22-010G.M23	DW Room <del>24</del> RM Faucet <del>26</del> Rm 26	7:28
24	22-010G.M24	DW Room <del>24</del> R Faucet <del>26</del> Rm 26	7:28
25	22-010G.M25	DW Custodian Office at Boiler Room Fountain	7:30
26	22-010G.M26	DW Hall Fountain Outside Custodian Office	7:30
27	22-010G.M27	DW Room 29 RR L Faucet	7:41
28	22-010G.M28	DW Room 29 RR R Faucet	7:41
29	22-010G.M29	DW Room 29 Kitchen Sink Faucet	7:42
30	22-010G.M30	DW Boy's Hall RR at Room 29 L Faucet	7:43
31	22-010G.M31	DW Boy's Hall RR at Room 29 M Faucet	7:43
32	22-010G.M32	DW Boy's Hall RR at Room 29 R Faucet	7:44
33	22-010G.M33	DW Kitchen Main Area L Faucet Dishwash	8:11
34	22-010G.M34	DW Kitchen Main Area R Faucet	8:12
35	22-010G.M35	DW Kitchen RR Sink Faucet	8:09
36	22-010G.M36	DW Kitchen Sink Faucet Outside RR	8:08
37	22-010G.M37	DW Kitchen Dishwash Sink Faucet Main area	8:10
38	22-010G.M38	DW Cafeteria Fountain	8:07
39	22-010G.M39	DW Room 25 L Faucet	8:24
40	22-010G.M40	DW Room 25 R Faucet	8:24
		M24 15 Kitchen Sink Middle	8:23

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
 LM = Left Middle LMM = Left Middle Middle RMM = Right Middle Middle M = Middle



# Coleman Creek Consulting, Inc.

## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Mazama High School  
ADDRESS: 3009 Summers Lane  
Klamath Falls, Oregon

DATE: 03-11-22  
INSPECTOR: Polo Flores


22030644

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
41 22-010G.M41	DW	Room 23 L Faucet	7:17
42 22-010G.M42	DW	Room 23 LM Faucet	7:18
43 22-010G.M43	DW	Room 23 M Faucet	7:18
44 22-010G.M44	DW	Room 23 RM Faucet	7:19
45 22-010G.M45	DW	Room 23 R Faucet	7:19
46 22-010G.M46	DW	Room 23 Office Sink Faucet	7:08
47 22-010G.M47	DW	Office Nurse Room L Faucet	5:10
48 22-010G.M48	DW	Office Nurse Room M Faucet	5:11
49 22-010G.M49	DW	Office Nurse Room R Faucet	5:12
50 22-010G.M50	DW	Office Men's RR Faucet	5:14
51 22-010G.M51	DW	Office Women's RR Faucet	5:15
52 22-010G.M52	DW	Office Coffee Sink Faucet	6:18
53 22-010G.M53	DW	Room 32 L Faucet	7:50
54 22-010G.M54	DW	Room 32 LM Faucet	7:50
55 22-010G.M55	DW	Room 32 M Faucet	7:51
56 22-010G.M56	DW	Room 32 RM Faucet	7:51
57 22-010G.M57	DW	Room 32 R Faucet	7:51
58 22-010G.M58	DW	Room 34 L Faucet	8:01
59 22-010G.M59	DW	Room 34 LM Faucet	8:01
60 22-010G.M60	DW	Room 34 RM Faucet	8:02
61 22-010G.M61	DW	Room 34 R Faucet	8:03

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle LMM = Left Middle Middle RMM = Right Middle Middle M = Middle

41 \* sample 49 time? there is a sample collected





# Coleman Creek Consulting, Inc.

Dave 541-944-5318


## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Mazama High School  
ADDRESS: 3009 Summers Lane  
Klamath Falls, Oregon

DATE: 03-11-22  
INSPECTOR: Jimmy

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
61 22-010G.M62	DW	Room <del>32</del> Faucet <i>Rm 38</i>	730
62 22-010G.M63	DW	Girl's RR at Room 31 L Faucet	607
63 22-010G.M64	DW	Girl's RR at Room 31 M Faucet	608
64 22-010G.M65	DW	Girl's RR at Room 31 R Faucet	609
65 22-010G.M66	DW	Boy's RR at Room 31 L Faucet	610
66 22-010G.M67	DW	Boy's RR at Room 31 M Faucet	611
67 22-010G.M68	DW	Boy's RR at Room 31 R Faucet	612
68 22-010G.M69	DW	Hall Fountain at Library	612
69 22-010G.M70	DW	Library Office Faucet	613
70 22-010G.M71	DW	Break Room Faucet at Room 33	615
71 22-010G.M72	DW	Dark Room Faucet at Room 33	616
72 22-010G.M73	DW	Boy's RR at Room 44 L Faucet <i>GYM</i>	632
73 22-010G.M74	DW	Boy's RR at Room 44 R Faucet <i>GYM</i>	632
74 22-010G.M75	DW	Girl's RR at Room 44 L Faucet <i>GYM</i>	633
75 22-010G.M76	DW	Girl's RR at Room 44 R Faucet <i>GYM</i>	633
76 22-010G.M77	DW	Hall Fountain at 60's Hall	634
77 22-010G.M78	DW	Concession <del>L</del> Faucet <i>One Faucet</i>	635
78 22-010G.M79	DW	<del>Concession R</del> Faucet <i>double sink</i>	
79 22-010G.M80	DW	Math Office Faucet at Room 47	638
20 22-010G.M81	DW	Boy's Hall RR at Room 52 L Faucet	641

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle LMM = Left Middle Middle RMM = Right Middle Middle M = Middle



# Coleman Creek Consulting, Inc.

## DRINKING WATER SITE SAMPLE RECORD SHEET


BUILDING: Mazama High School  
 ADDRESS: 3009 Summers Lane  
 Klamath Falls, Oregon

DATE: 03-11-22  
 INSPECTOR: Jimmy

80  
81  
82  
83  
84  
85  
86  
87  
88  
89  
90  
91  
92  
93  
94  
95  
96  
97  
98  
99

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
22-010G.M82	DW	Boy's Hall RR at Room 52 M Faucet	641
22-010G.M83	DW	Boy's Hall RR at Room 52 R Faucet	642
22-010G.M84	DW	Girl's Hall RR at Room 52 L Faucet	643
22-010G.M85	DW	Girl's Hall RR at Room 52 M Faucet	644
22-010G.M86	DW	Girl's Hall RR at Room 52 R Faucet	644
22-010G.M87	DW	Hall Fountain at Room 9	645
22-010G.M88	DW	Room 55 Break Room Faucet	646
22-010G.M89	DW	Room 57 RR L Faucet	647
22-010G.M90	DW	Room 57 RR R Faucet	647
22-010G.M91	DW	Girl's Locker L Faucet	650
22-010G.M92	DW	Girl's Locker LM Faucet	650
22-010G.M93	DW	Girl's Locker RM Faucet	651
22-010G.M94	DW	Girl's Locker R Faucet	652
22-010G.M95	DW	Girl's Locker Fountain	652
22-010G.M96	DW	Girl's Locker Office Faucet	653
22-010G.M97	DW	Main Gym L Fountain	657
22-010G.M98	DW	Main Gym LM Fountain	656
22-010G.M99	DW	Main Gym RM Fountain	658
22-010G.M100	DW	Main Gym R Fountain	658
22-010G.M101	DW	Upper Gym L Fountain	708

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
 LM = Left Middle LMM = Left Middle Middle RMM = Right Middle Middle M = Middle



# Coleman Creek Consulting, Inc.

## DRINKING WATER SITE SAMPLE RECORD SHEET


BUILDING: Mazama High School  
ADDRESS: 3009 Summers Lane  
Klamath Falls, Oregon

DATE: 03-11-22  
INSPECTOR: Jimmy

100  
101  
102  
103  
104  
105  
106  
107  
108  
109  
110  
111  
112

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
22-010G.M102	DW	Upper Gym R Fountain	708
22-010G.M103	DW	Boy's Locker Big Wall L Faucet	710
22-010G.M104	DW	Boy's Locker Big Wall LM Faucet	710
22-010G.M105	DW	Boy's Locker Big Wall LMM Faucet	711
22-010G.M106	DW	Boy's Locker Big Wall RMM Faucet	711
22-010G.M107	DW	Boy's Locker Big Wall RM Faucet	712
22-010G.M108	DW	Boy's Locker Big Wall R Faucet	712
22-010G.M109	DW	Boy's Locker Little Wall L Faucet	713
22-010G.M110	DW	Boy's Locker Little Wall M Faucet	713
22-010G.M111	DW	Boy's Locker Little Wall R Faucet	714
22-010G.M112	DW	Boy's Locker Coach's Office L Faucet	715
22-010G.M113	DW	Boy's Locker Coach's Office R Faucet	716
22-010G.M114	DW	Boy's Locker Main Office Faucet	716

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle LMM = Left Middle Middle RMM = Right Middle Middle M = Middle



# Coleman Creek Consulting, Inc.

## DRINKING WATER SITE SAMPLE RECORD SHEET


BUILDING: Mazama High School  
 ADDRESS: 3009 Summers Lane  
 Klamath Falls, Oregon

DATE: 03-11-22  
 INSPECTOR: Darin Martins

113  
114  
115  
116  
117  
118  
119  
120  
121  
122  
123  
124  
125  
126  
127  
128  
129  
130  
131  
132

SAMPLE #	SAMPLE TYPE	LOCATION	TIME <sup>AM</sup>
22-010G.M115	DW	Clinic Waiting Room RR Faucet	6:05
22-010G.M116	DW	Clinic Kitchen Double Sink L Faucet	6:06
22-010G.M117	DW	Clinic Kitchen Double Sink R Faucet	6:06
22-010G.M118	DW	Clinic Kitchen Handwash Faucet	6:07
22-010G.M119	DW	Clinic Staff RR Faucet	6:08
22-010G.M120	DW	Exam Room A Faucet	6:09
22-010G.M121	DW	Exam Room B Faucet	6:09
22-010G.M122	DW	Exam Room C Faucet	6:10
22-010G.M123	DW	White House 1 <sup>st</sup> Floor Stair RR Faucet	6:23
22-010G.M124	DW	White House Handwash Sink Faucet	6:23
22-010G.M125	DW	White House Kitchen L Faucet	6:24
22-010G.M126	DW	White House Kitchen <del>R Faucet</del> Handwash Faucet	6:24
22-010G.M127	DW	White House 1 <sup>st</sup> Floor Kitchen RR Faucet	6:26
22-010G.M128	DW	White House 2 <sup>nd</sup> Floor RR Faucet	6:27
22-010G.M129	DW	White House 2 <sup>nd</sup> Floor Breakroom Faucet	6:28
22-010G.M130	DW	Soccer Concession Girl's RR L Sink	6:35
22-010G.M131	DW	Soccer Concession Girl's RR R Sink	6:35
22-010G.M132	DW	Soccer Concession Boy's RR L Sink	6:38
22-010G.M133	DW	Soccer Concession Boy's RR R Sink	6:38
22-010G.M134	DW	Main Concession Sink	6:42

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
 LM = Left Middle M = Middle



# Coleman Creek Consulting, Inc.

## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Mazama High School  
ADDRESS: 3009 Summers Lane  
Klamath Falls, Oregon

DATE: 03-11-22  
INSPECTOR: Darin Martins

SAMPLE #	SAMPLE TYPE	LOCATION	TIME AM
133 22-010G.M135	DW	Football Boy's RR L Faucet	6:57
134 22-010G.M136	DW	Football Boy's RR M Faucet	6:57
135 22-010G.M137	DW	Football Boy's RR R Faucet	6:57
136 22-010G.M138	DW	Football Girl's RR L Faucet	6:59
137 22-010G.M139	DW	Football Girl's RR M Faucet	6:59
138 22-010G.M140	DW	Football Girl's RR R Faucet	7:00
139 22-010G.M141	DW	Football Concession L Faucet	7:01
140 22-010G.M142	DW	Football Concession R Faucet	7:01

Comments: DW = Drinking Water RR = Restroom R = Right L = Left M = Middle

- B Analyte detected in the associated method blank.
- BA BOD Alternative Calculation: The initial results performed by Standard Methods did not fall within parameters of the Standard Methods calculation. An alternate approved calculation was performed using the HACH method and the value reported is an estimated concentration.
- C Sample(s) does not meet NELAP/ORELAP sample acceptance criteria. See Case Narrative.
- C1 Sample(s) does not meet NELAP/ORELAP sample acceptance criteria for temperature.
- CF Results confirmed by re-analysis.
- CU Cleanup performed as specified by method.
- D1 The diesel elution pattern for the sample is not typical.
- D2 The sample appears to be a heavier hydrocarbon range than diesel.
- D3 The sample appears to be a lighter hydrocarbon range than diesel.
- D4 Detected hydrocarbons do not have pattern and range consistent with typical petroleum products and may be due to biogenic interference.
- D5 Detected hydrocarbons in the diesel range appear to be weathered diesel.
- E Estimated value.
- ER Elevated reporting limit due to matrix. Report limits (MDLs, MRLs & PQLs) are adjusted based on variations in sample preparation amounts, analytical dilutions, and percent solids, where applicable.
- FC Fecal Coliforms: Sample(s) received past 40 CFR Part 136 specified holding time. Results reported as estimated values.
- G1 The gasoline elution pattern for the sample is not typical.
- G2 The sample appears to be a heavier hydrocarbon range than gasoline.
- G3 The sample appears to be a lighter hydrocarbon range than gasoline.
- G4 Detected hydrocarbons in the gasoline range appear to be weathered gasoline.
- HP Sample re-analysis performed outside of method specified holding time.
- HR Sample received outside of method specified holding time.
- HS Sample analyzed for volatile organics contained headspace.
- HT At the client's request, the sample was analyzed outside of method specified holding time.
- H Analysis performed outside of method specified holding time.
- J Analyte detected below the Minimum Reporting Limit (MRL) and above the Method Detection Limit (MDL). The J flag result is an estimated value and the user should be aware that this data is of limited reliability.
- L Dissolved metals were not filtered within 15 minutes of collection per 40 CFR Part 136.
- MI Surrogate, Duplicate Sample (DUP) or Matrix Spikes recoveries are out of control limits due to matrix interference. Sample results may be biased.
- N See Case Narrative on page 2 of report.
- NLR No Legionella Recovered.
- PLR Presence of Legionella Recovered.
- Q Initial calibration verification (ICV), continuing calibration verification (CCV) or laboratory control sample (LCS) exceeded high recovery limits, but associated samples are non-detect and the sample results are not affected. Data meets EPA/NELAP requirements.
- R Relative percent difference (RPD) is outside of the accepted recovery limits.
- R1 Relative percent difference (RPD) is outside of the accepted recovery limits. However, analyses are not controlled on RPD values for sample concentrations that are less than the reporting limit.
- R3 The relative percent difference (RPD) and/or percent recovery for the duplicate (DUP) or matrix spike (MS)/matrix spike duplicate (MSD) cannot be accurately calculated due to the concentration of analyte already present in the sample.
- R4 Duplicate analysis failed due to result being at or near the method reporting limit.
- S Surrogate and/or matrix spike recovery is outside of the accepted recovery limits. Sample results may be biased.
- S1 Surrogate or matrix spike recovery is outside of control limits due to dilution necessary for analysis.
- SC Sub-contracted to another laboratory for analysis.
- SP Sample(s) were not collected per EPA Method 5035A protocols. The results are considered minimum values.
- # Value exceeds regulatory level for TCLP contaminant.
- X1 The motor oil elution pattern for the sample is not typical.
- X2 The sample appears to be a heavier hydrocarbon range than motor oil.
- X3 The sample appears to be a lighter hydrocarbon range than motor oil.
- \* Value exceeds Maximum Contaminant Level or is outside the acceptable range.