

Coleman Creek Consulting, Inc.

DRINKING WATER LEAD SAMPLING

OF

STEARNS ELEMENTARY SCHOOL

3641 CREST STREET, KLAMATH FALLS, OREGON

FOR

KLAMATH COUNTY SCHOOL DISTRICT

INTRODUCTION


Coleman Creek Consulting, Inc. (CCC) was retained by Klamath County School District (KCS D) to perform representative lead drinking water sampling of Stearns Elementary School (Stearns) at the above address. The purpose of the lead drinking water sampling was to determine the concentration of lead in representative drinking water sources and compare with regulatory standards. In 2017, Education Service Districts were required to adopt a Healthy and Safe Schools Plan, including provisions for testing and reducing exposure to elevated levels of lead in water used for drinking and food preparation.

LEAD DRINKING WATER SAMPLING REQUIREMENTS

Guidelines for sampling lead in water were established by the Oregon Health Authority. Water sampling is to occur after water sits overnight in the pipes without being used, and must be sampled after a day occupied by students or building occupants. All water sources are to be sampled, with the exception of water used for heating, sanitation, irrigation, and science sinks for grades 6 and up with non-potable water signs. Initial testing is required to be performed by 2020, and every 6 years thereafter, according to a testing schedule determined by the Oregon Department of Education.

SAMPLE LOCATION DETERMINATION/SAMPLE PREP

David W. Fawcett of CCC contacted Bill Schroeder, Head Custodian at Stearns, and discussed the objectives of the lead drinking water program. Mr. Schroeder reviewed the School building for water sources and identified by type on a building floor plan. Mr. Fawcett and Mr. Schroeder discussed the drinking water sources by phone, and Mr. Fawcett created a Site Sample Record Sheet describing each drinking water source by type and location. Mr. Fawcett identified each source by number (ST1-ST52), and identified each source number on a floor plan diagram of the school building. Mr. Fawcett delivered the following sampling materials to Mr. Schroeder March 10, 2022: Numbered sample containers, Site Sample Record Sheet filled out with Sample Number, Sample Type, and Location. Mr. Schroeder was instructed in proper sampling technique, including sampling prior to water system use by other school occupants, fill sample container immediately from faucet opening, and recording time of water sampling on the Site Sample Record Sheets (pages 3-5).



Coleman Creek Consulting, Inc.

DRINKING WATER SAMPLING

Mr. Schroeder collected lead drinking water samples from the drinking water sources identified in Stearns Elementary School March 11, 2022. See Site Sample Record Sheets (pages 3-5) for a description of the drinking water sources sampled. The following sample location faucets were hot water only at the time of sampling, and a drinking water sample was not collected: ST4, and ST19. See Drinking Water Sample Location Diagram in Appendix A for a visual review of all drinking water sample locations. The drinking water samples were collected in the early morning, ensuring that the sample source had not been in use since the previous day. The samples were placed in a cooler. Mr. Fawcett picked up the samples collected by Mr. Schroeder March 11, 2022, and transported to Neilson Research Corporation in Medford, Oregon.

DRINKING WATER LEAD RESULTS AND TESTING SUMMARY SHEETS

The fifty (50) drinking water samples collected were analyzed for lead using EPA Method 200.8. See Neilson Research Corporation Analytical Report in Appendix B. Drinking Water Testing Summary Sheets (pages 6-7) indicate the lead in drinking water concentrations for the fifty (50) samples collected from Ferguson Elementary School Building were reported ranging from <0.515 to 10.8 parts per billion (ppb).


CONCLUSIONS

Fifty (50) drinking water samples were collected from drinking water sources at the Stearns Elementary School Building prior to use that day by building occupants, and after a day the facility was occupied. The lead concentrations reported were all below the 15 ppb lead action level in water.

RECOMMENDATIONS

Coleman Creek Consulting, Inc. recommends future drinking water sampling at Stearns Elementary School according to the schedule set out by the Oregon Department of Education. Coleman Creek Consulting, Inc. appreciates the opportunity to continue to perform environmental sampling and consulting services to Klamath County School District.

David W. Fawcett
Director of Consulting Services



Coleman Creek Consulting, Inc.

DRINKING WATER SITE SAMPLE RECORD SHEET


BUILDING: Stearns Elementary School
ADDRESS: 3641 Crest Street
Klamath Falls, Oregon

DATE: 03-11-22
SAMPLER: Bill Schroeder

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
22-010G.ST1	DW	Kitchen, Handwash Sink Faucet	0600
22-010G.ST2	DW	Kitchen, Prep Sink Faucet	0600
22-010G.ST3	DW	Kitchen, Rinse Sink Faucet at Dishwash	0600
22-010G.ST5	DW	Cafeteria Drinking Fountain	0601
22-010G.ST6	DW	Gym Drinking Fountain 1	0604
22-010G.ST7	DW	Gym Drinking Fountain 2	0604
22-010G.ST8	DW	Library Corner Back Room Sink Faucet	0606
22-010G.ST9	DW	Boy's RR at Boiler Room L Sink Faucet	0608
22-010G.ST10	DW	Boy's RR at Boiler Room LM Sink Faucet	0608
22-010G.ST11	DW	Boy's RR at Boiler Room RM Sink Faucet	0608
22-010G.ST12	DW	Boy's RR at Boiler Room R Sink Faucet	0608
22-010G.ST13	DW	Girl's RR at Boiler Room L Sink Faucet	0613
22-010G.ST14	DW	Girl's RR at Boiler Room LM Sink Faucet	0613
22-010G.ST15	DW	Girl's RR at Boiler Room RM Sink Faucet	0615
22-010G.ST16	DW	Girl's RR at Boiler Room R Sink Faucet	0615
22-010G.ST17	DW	Room 10 L Sink Faucet	0618
22-010G.ST18	DW	Room 10 R Sink Faucet	0619
22-010G.ST20	DW	Boy's RR at Room 12 L Sink Faucet	0623

Comments: DW = Drinking Water RR = Restroom L = Left LM = Left Middle RM = Right Middle
R = Right

Sample locations ST4 and ST19 hot water only, no samples collected



Coleman Creek Consulting, Inc.


DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Stearns Elementary School
ADDRESS: 3641 Crest Street
Klamath Falls, Oregon

DATE: 03-11-22
SAMPLER: Bill Schroeder

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
22-010G.ST21	DW	Boy's RR at Room 12 R Sink Faucet	0625
22-010G.ST22	DW	Room 14 Sink/Fountain	0627
22-010G.ST23	DW	Room 16 Sink/Fountain	0628
22-010G.ST24	DW	Room 15 Sink/Fountain	0629
22-010G.ST25	DW	Room 13 Sink/Fountain	0631
22-010G.ST26	DW	Girl's RR at Room 11 L Sink	0632
22-010G.ST27	DW	Girl's RR at Room 11 R Sink	0632
22-010G.ST28	DW	Room 11 Sink/Fountain	0633
22-010G.ST29	DW	Room 9 Sink/Fountain	0635
22-010G.ST30	DW	Staff RR Sink Faucet	0637
22-010G.ST31	DW	Hall Drinking Fountain at Staff Room	0637
22-010G.ST32	DW	Staff Break Room Sink Faucet	0638
22-010G.ST33	DW	Nurse Station Sink/Faucet	0640
22-010G.ST34	DW	Boy's RR at Room 4 L Sink Faucet	0641
22-010G.ST35	DW	Boy's RR at Room 4 R Sink Faucet	0642
22-010G.ST36	DW	Room 4 Sink/Fountain	0643
22-010G.ST37	DW	Room 6 Sink/Fountain	0645
22-010G.ST38	DW	Boy's RR at Room 6 L Sink Faucet	0646
22-010G.ST39	DW	Boy's RR at Room 6 LM Sink Faucet	0647
22-010G.ST40	DW	Boy's RR at Room 6 RM Sink Faucet	0648

Comments: DW = Drinking Water RR = Restroom L = Left LM = Left Middle RM = Right Middle
R = Right



Coleman Creek Consulting, Inc.


DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Stearns Elementary School
ADDRESS: 3641 Crest Street
Klamath Falls, Oregon

DATE: 03-11-22
SAMPLER: Bill Schroeder

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
22-010G.ST41	DW	Boy's RR at Room 6 R Sink Faucet	0649
22-010G.ST42	DW	Room 8 Sink/Fountain	0651
22-010G.ST43	DW	Room 7 Sink/Fountain	0652
22-010G.ST44	DW	Girl's RR at Room 5 L Sink Faucet	0657
22-010G.ST45	DW	Girl's RR at Room 5 LM Sink Faucet	0657
22-010G.ST46	DW	Girl's RR at Room 5 RM Sink Faucet	0657
22-010G.ST47	DW	Girl's RR at Room 5 R Sink Faucet	0658
22-010G.ST48	DW	Room 5 Sink/Fountain	0658
22-010G.ST49	DW	Room 3 Sink/Fountain	0700
22-010G.ST50	DW	Girl's RR at Room 1 L Sink Faucet	0701
22-010G.ST51	DW	Girl's RR at Room 1 R Sink Faucet	0702
22-010G.ST52	DW	Room 1 Sink/Fountain	0703

Comments: DW = Drinking Water RR = Restroom L = Left LM = Left Middle RM = Right Middle
R = Right



Coleman Creek Consulting, Inc.


DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District
 DISTRICT ID#: 467
 SCHOOL NAME: Stearns Elementary School
 BUILDING NAME: Stearns Elementary School
 BUILDING ID#: 20570200

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
22-010G.ST1	Kitchen, Handwash Sink Faucet	20570200-001KF	03-11-22	7.39		
22-010G.ST2	Kitchen, Prep Sink Faucet	20570200-002KF	03-11-22	1.35		
22-010G.ST3	Kitchen, Rinse Sink Faucet at Dishes	20570200-003KF	03-11-22	0.573		
22-010G.ST5	Cafeteria Drinking Fountain	20570200-005DW	03-11-22	<0.515		
22-010G.ST6	Gym Drinking Fountain 1	20570200-006DW	03-11-22	<0.515		
22-010G.ST7	Gym Drinking Fountain 2	20570200-007DW	03-11-22	<0.515		
22-010G.ST8	Library Back Room Sink Faucet	20570200-008SF	03-11-22	3.19		
22-010G.ST9	Boy's RR at Boiler L Sink Faucet	20570200-009BF	03-11-22	<0.515		
22-010G.ST10	Boy's RR at Boiler LM Sink Faucet	20570200-010BF	03-11-22	<0.515		
22-010G.ST11	Boy's RR at Boiler RM Sink Faucet	20570200-011BF	03-11-22	<0.515		
22-010G.ST12	Boy's RR at Boiler R Sink Faucet	20570200-012BF	03-11-22	<0.515		
22-010G.ST13	Girl's RR at Boiler L Sink Faucet	20570200-013BF	03-11-22	<0.515		
22-010G.ST14	Girl's RR at Boiler LM Sink Faucet	20570200-014BF	03-11-22	0.537		
22-010G.ST15	Girl's RR at Boiler RM Sink Faucet	20570200-015BF	03-11-22	<0.515		
22-010G.ST16	Girl's RR at Boiler R Sink Faucet	20570200-016BF	03-11-22	<0.515		
22-010G.ST17	Room 10 Left Sink Faucet	20570200-017CF	03-11-22	<0.515		
22-010G.ST18	Room 10 Right Sink Faucet	20570200-018CF	03-11-22	<0.515		
22-010G.ST20	Boy's RR at Room 12 L Sink Faucet	20570200-020BF	03-11-22	<0.515		
22-010G.ST21	Boy's RR at Room 12 R Sink Faucet	20570200-021BF	03-11-22	2.84		
22-010G.ST22	Room 14 Sink/Fountain	20570200-022DW	03-11-22	0.557		
22-010G.ST23	Room 16 Sink/Fountain	20570200-023DW	03-11-22	<0.515		
22-010G.ST24	Room 15 Sink/Fountain	20570200-024DW	03-11-22	0.777		
22-010G.ST25	Room 13 Sink/Fountain	20570200-025DW	03-11-22	<0.515		
22-010G.ST26	Girl's RR at Room 11 L Sink	20570200-026BF	03-11-22	1.16		
22-010G.ST27	Girl's RR at Room 11 R Sink	20570200-027BF	03-11-22	<0.515		
22-010G.ST28	Room 11 Sink/Fountain	20570200-028DW	03-11-22	6.84		
22-010G.ST29	Room 9 Sink/Fountain	20570200-029DW	03-11-22	4.16		
22-010G.ST30	Staff RR Sink Faucet	20570200-030SF	03-11-22	<0.515		
22-010G.ST31	Hall Drinking Fountain at Staff Room	20570200-031DW	03-11-22	<0.515		
22-010G.ST32	Staff Break Room Sink Faucet	20570200-032SF	03-11-22	<0.515		
22-010G.ST33	Nurse Station Sink/Faucet	20570200-033NS	03-11-22	10.8		
22-010G.ST34	Boy's RR at Room 4 L Sink Faucet	20570200-034BF	03-11-22	3.08		

Fixture ID Coding:

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler
 CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet
 KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)



Coleman Creek Consulting, Inc.

DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District
 DISTRICT ID#: 467
 SCHOOL NAME: Stearns Elementary School
 BUILDING NAME: Stearns Elementary School
 BUILDING ID#: 20570200

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
22-010G.ST35	Boy's RR at Room 4 R Sink Faucet	20570200-035BF	03-11-22	0.709		
22-010G.ST36	Room 4 Sink/Fountain	20570200-036DW	03-11-22	0.692		
22-010G.ST37	Room 6 Sink/Fountain	20570200-037DW	03-11-22	0.547		
22-010G.ST38	Boy's RR at Room 6 L Sink Faucet	20570200-038BF	03-11-22	<0.515		
22-010G.ST39	Boy's RR at Room 6 LM Sink Faucet	20570200-039BR	03-11-22	<0.515		
22-010G.ST40	Boy's RR at Room 6 RM Sink Faucet	20570200-040BF	03-11-22	<0.515		
22-010G.ST41	Boy's RR at Room 6 R Sink Faucet	20570200-041BF	03-11-22	<0.515		
22-010G.ST42	Room 8 Sink/Fountain	20570200-042DW	03-11-22	0.843		
22-010G.ST43	Room 7 Sink/Fountain	20570200-043DW	03-11-22	6.02		
22-010G.ST44	Girl's RR at Room 5 L Sink Faucet	20570200-044BF	03-11-22	<0.515		
22-010G.ST45	Girl's RR at Room 5 LM Sink Faucet	20570200-045BF	03-11-22	<0.515		
22-010G.ST46	Girl's RR at Room 5 RM Sink Faucet	20570200-046BF	03-11-22	<0.515		
22-010G.ST47	Girl's RR at Room 5 R Sink Faucet	20570200-047BF	03-11-22	<0.515		
22-010G.ST48	Room 5 Sink/Fountain	20570200-048DW	03-11-22	2.57		
22-010G.ST49	Room 3 Sink/Fountain	20570200-049DW	03-11-22	<0.515		
22-010G.ST50	Girl's RR at Room 1 L Sink Faucet	20570200-050BF	03-11-22	<0.515		
22-010G.ST51	Girl's RR at Room 1 R Sink Faucet	20570200-051BF	03-11-22	0.650		
22-010G.ST52	Room 1 Sink/Fountain	20570200-052DW	03-11-22	1.34		


Fixture ID Coding:

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler
 CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet
 KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)

APPENDIX A

**DRINKING WATER SAMPLE LOCATION
DIAGRAM**

STEARNS ELEMENTARY SCHOOL Drinking Water Sample Locations

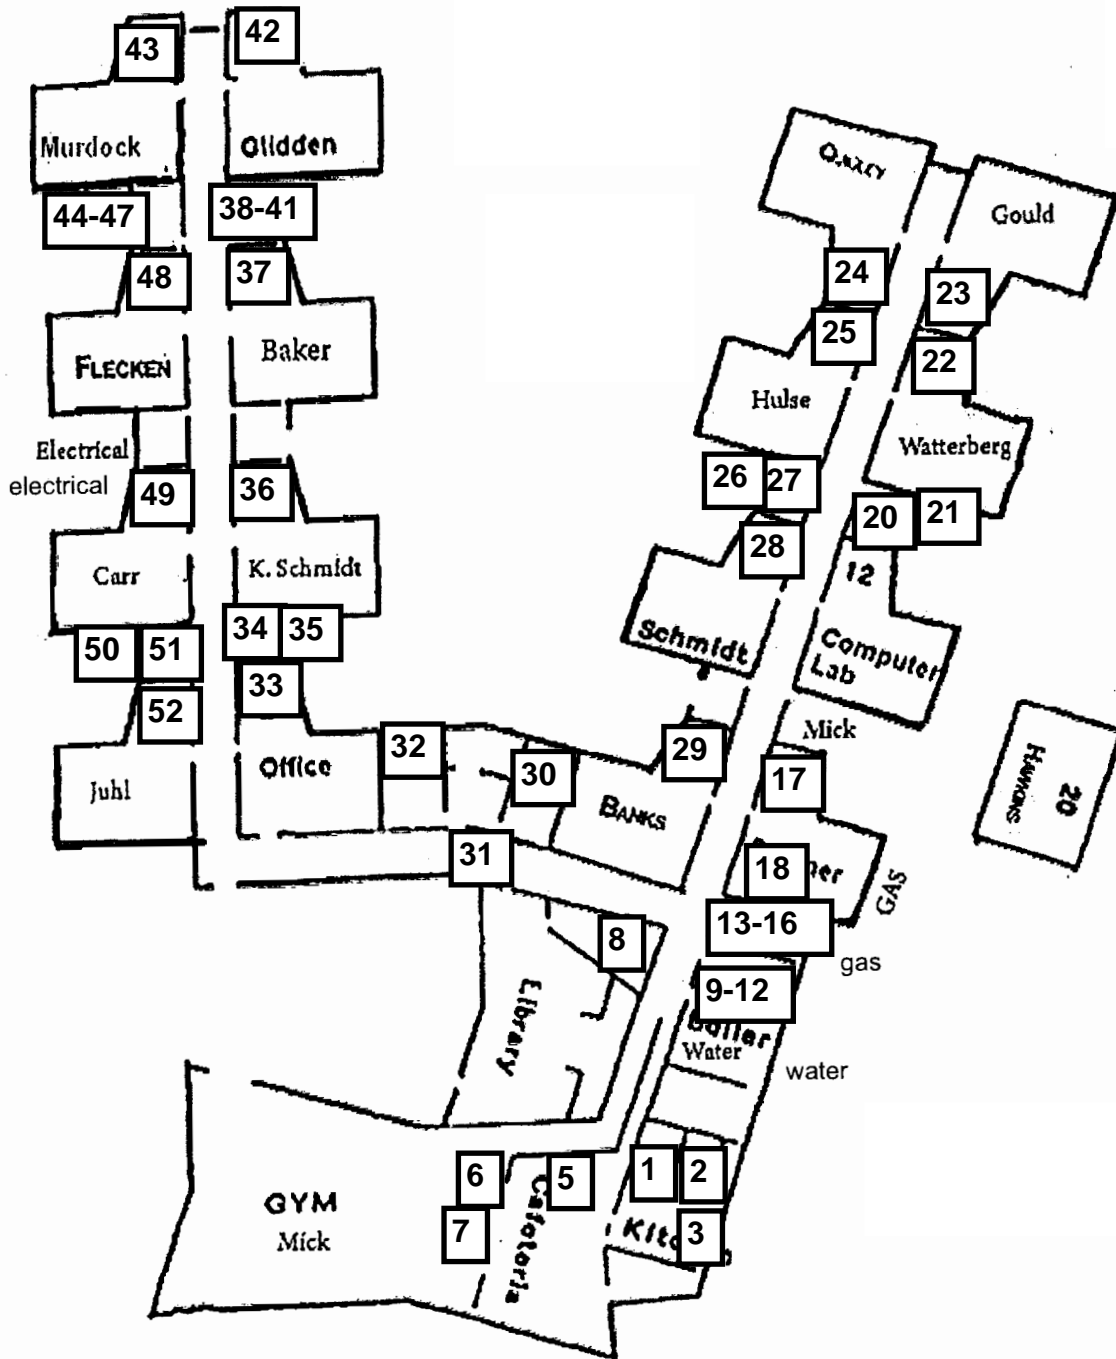

12 = Drinking Water Sample Location

APPENDIX B

**NEILSON RESEARCH CORPORATION
ANALYTICAL REPORT**



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

March 31, 2022

Dave Fawcett
Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520
TEL: (541) 535-7108
FAX (541) 535-8795

RE: 22-010G Stearns ES

Order No.: 22030640

Dear Dave Fawcett:

Neilson Research Corporation received 50 sample(s) on 3/11/2022 for the analyses presented in the following report.

The results relate only to the parameters tested or to the sample as received by the laboratory. This report shall not be reproduced except in full, without the written approval of Neilson Research Corporation. If you have any questions regarding these test results, please feel free to call.

Sincerely,
Neilson Research Corporation

Tamra Schmedemann
Senior Project Manager
245 S Grape St
Medford, OR 97501



Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Case Narrative

WO#: 22030640
Date: 3/31/2022

CLIENT: Coleman Creek Consulting

Project: 22-010G Stearns ES

The analyses were performed according to the guidelines in the Neilson Research Corporation Quality Assurance Program. This report contains analytical results for the sample(s) as received by the laboratory.

Neilson Research Corporation certifies that this report is in compliance with the requirements of NELAP. No unusual difficulties were experienced during analysis of this batch except as noted below or qualified with data flags on the reports.

Original



Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-01 Client Sample ID: 22-010G.ST1
 Collection Date: 3/11/2022 6:00:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	7.39		0.515	ppb	1	3/31/2022	15.0	A

Lab ID: 22030640-02 Client Sample ID: 22-010G.ST2
 Collection Date: 3/11/2022 6:00:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.35		0.515	ppb	1	3/31/2022	15.0	A

Lab ID: 22030640-03 Client Sample ID: 22-010G.ST3
 Collection Date: 3/11/2022 6:00:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.573		0.515	ppb	1	3/31/2022	15.0	A

QUALIFIERS	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-04 Client Sample ID: 22-010G.ST5
 Collection Date: 3/11/2022 6:01:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/31/2022	15.0	A	

Lab ID: 22030640-05 Client Sample ID: 22-010G.ST6
 Collection Date: 3/11/2022 6:04:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/31/2022	15.0	A	

Lab ID: 22030640-06 Client Sample ID: 22-010G.ST7
 Collection Date: 3/11/2022 6:04:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/31/2022	15.0	A	

- | | | |
|-------------------|--|--|
| QUALIFIERS | * Value exceeds Maximum Contaminant Level. | C1 Sample container temperature is out of limit as specified at testcode |
| | E Value above quantitation range | H Holding times for preparation or analysis exceeded |
| | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference |
| | ND Not Detected at the Reporting Limit | PL Permit Limit |
| | R RPD outside accepted recovery limits | |

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-07 Client Sample ID: 22-010G.ST8
 Collection Date: 3/11/2022 6:06:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	3.19		0.515	ppb	1	3/31/2022	15.0	A

Lab ID: 22030640-08 Client Sample ID: 22-010G.ST9
 Collection Date: 3/11/2022 6:08:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/31/2022	15.0	A

Lab ID: 22030640-09 Client Sample ID: 22-010G.ST10
 Collection Date: 3/11/2022 6:08:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/31/2022	15.0	A

QUALIFIERS	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-10 Client Sample ID: 22-010G.ST11
 Collection Date: 3/11/2022 6:09:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/31/2022	15.0	A	

Lab ID: 22030640-11 Client Sample ID: 22-010G.ST12
 Collection Date: 3/11/2022 6:09:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/31/2022	15.0	A	


Lab ID: 22030640-12 Client Sample ID: 22-010G.ST13
 Collection Date: 3/11/2022 6:13:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/31/2022	15.0	A	

- | | | |
|-------------------|--|--|
| QUALIFIERS | * Value exceeds Maximum Contaminant Level. | C1 Sample container temperature is out of limit as specified at testcode |
| | E Value above quantitation range | H Holding times for preparation or analysis exceeded |
| | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference |
| | ND Not Detected at the Reporting Limit | PL Permit Limit |
| | R RPD outside accepted recovery limits | |

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

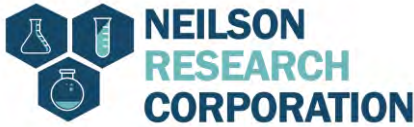

Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-13 Client Sample ID: 22-010G.ST14
 Collection Date: 3/11/2022 6:13:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.537		0.515	ppb	1	3/31/2022	15.0	A	

Lab ID: 22030640-14 Client Sample ID: 22-010G.ST15
 Collection Date: 3/11/2022 6:15:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/31/2022	15.0	A	


Lab ID: 22030640-15 Client Sample ID: 22-010G.ST16
 Collection Date: 3/11/2022 6:15:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/31/2022	15.0	A	

- | | | |
|-------------------|--|--|
| QUALIFIERS | * Value exceeds Maximum Contaminant Level. | C1 Sample container temperature is out of limit as specified at testcode |
| | E Value above quantitation range | H Holding times for preparation or analysis exceeded |
| | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference |
| | ND Not Detected at the Reporting Limit | PL Permit Limit |
| | R RPD outside accepted recovery limits | |

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

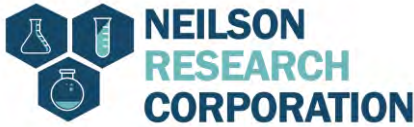

Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-16 Client Sample ID: 22-010G.ST17
 Collection Date: 3/11/2022 6:18:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/31/2022	15.0	A	

Lab ID: 22030640-17 Client Sample ID: 22-010G.ST18
 Collection Date: 3/11/2022 6:19:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/31/2022	15.0	A	

Lab ID: 22030640-18 Client Sample ID: 22-010G.ST20
 Collection Date: 3/11/2022 6:23:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/31/2022	15.0	A	

QUALIFIERS	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-19 Client Sample ID: 22-010G.ST21
 Collection Date: 3/11/2022 6:25:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	2.84		0.515	ppb	1	3/31/2022	15.0	A	

Lab ID: 22030640-20 Client Sample ID: 22-010G.ST22
 Collection Date: 3/11/2022 6:27:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.557		0.515	ppb	1	3/31/2022	15.0	A	


Lab ID: 22030640-21 Client Sample ID: 22-010G.ST23
 Collection Date: 3/11/2022 6:28:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A	

QUALIFIERS	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

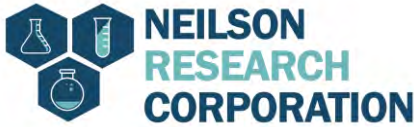

Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-22 Client Sample ID: 22-010G.ST24
 Collection Date: 3/11/2022 6:29:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.777		0.515	ppb	1	3/27/2022	15.0	A

Lab ID: 22030640-23 Client Sample ID: 22-010G.ST25
 Collection Date: 3/11/2022 6:31:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A

Lab ID: 22030640-24 Client Sample ID: 22-010G.ST26
 Collection Date: 3/11/2022 6:32:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.16		0.515	ppb	1	3/27/2022	15.0	A

QUALIFIERS	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-25 Client Sample ID: 22-010G.ST27
 Collection Date: 3/11/2022 6:33:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A	

Lab ID: 22030640-26 Client Sample ID: 22-010G.ST28
 Collection Date: 3/11/2022 6:33:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	6.84		0.515	ppb	1	3/27/2022	15.0	A	


Lab ID: 22030640-27 Client Sample ID: 22-010G.ST29
 Collection Date: 3/11/2022 6:35:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	4.16		0.515	ppb	1	3/27/2022	15.0	A	

- | | | |
|-------------------|--|--|
| QUALIFIERS | * Value exceeds Maximum Contaminant Level. | C1 Sample container temperature is out of limit as specified at testcode |
| | E Value above quantitation range | H Holding times for preparation or analysis exceeded |
| | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference |
| | ND Not Detected at the Reporting Limit | PL Permit Limit |
| | R RPD outside accepted recovery limits | |

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

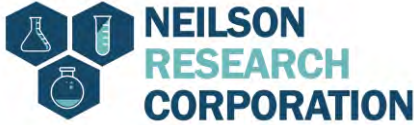

Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-28 Client Sample ID: 22-010G.ST30
 Collection Date: 3/11/2022 6:37:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A	

Lab ID: 22030640-29 Client Sample ID: 22-010G.ST31
 Collection Date: 3/11/2022 6:37:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A	

Lab ID: 22030640-30 Client Sample ID: 22-010G.ST32
 Collection Date: 3/11/2022 6:38:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A	

- | | | |
|-------------------|--|--|
| QUALIFIERS | * Value exceeds Maximum Contaminant Level. | C1 Sample container temperature is out of limit as specified at testcode |
| | E Value above quantitation range | H Holding times for preparation or analysis exceeded |
| | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference |
| | ND Not Detected at the Reporting Limit | PL Permit Limit |
| | R RPD outside accepted recovery limits | |

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-31 Client Sample ID: 22-010G.ST33
 Collection Date: 3/11/2022 6:40:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst:	SJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	10.8		0.515	ppb	1	3/27/2022	15.0	A	

Lab ID: 22030640-32 Client Sample ID: 22-010G.ST34
 Collection Date: 3/11/2022 6:41:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst:	SJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	3.08		0.515	ppb	1	3/27/2022	15.0	A	

Lab ID: 22030640-33 Client Sample ID: 22-010G.ST35
 Collection Date: 3/11/2022 6:42:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst:	SJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.709		0.515	ppb	1	3/27/2022	15.0	A	

QUALIFIERS	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-34 Client Sample ID: 22-010G.ST36
 Collection Date: 3/11/2022 6:43:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst:	SJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.692		0.515	ppb	1	3/27/2022	15.0	A	

Lab ID: 22030640-35 Client Sample ID: 22-010G.ST37
 Collection Date: 3/11/2022 6:45:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst:	SJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.547		0.515	ppb	1	3/27/2022	15.0	A	

Lab ID: 22030640-36 Client Sample ID: 22-010G.ST38
 Collection Date: 3/11/2022 6:46:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst:	SJS
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A	

- | | | |
|-------------------|--|--|
| QUALIFIERS | * Value exceeds Maximum Contaminant Level. | C1 Sample container temperature is out of limit as specified at testcode |
| | E Value above quantitation range | H Holding times for preparation or analysis exceeded |
| | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference |
| | ND Not Detected at the Reporting Limit | PL Permit Limit |
| | R RPD outside accepted recovery limits | |

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-37 Client Sample ID: 22-010G.ST39
 Collection Date: 3/11/2022 6:47:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A	

Lab ID: 22030640-38 Client Sample ID: 22-010G.ST40
 Collection Date: 3/11/2022 6:48:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A	


Lab ID: 22030640-39 Client Sample ID: 22-010G.ST41
 Collection Date: 3/11/2022 6:49:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A	

- | | | |
|-------------------|--|--|
| QUALIFIERS | * Value exceeds Maximum Contaminant Level. | C1 Sample container temperature is out of limit as specified at testcode |
| | E Value above quantitation range | H Holding times for preparation or analysis exceeded |
| | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference |
| | ND Not Detected at the Reporting Limit | PL Permit Limit |
| | R RPD outside accepted recovery limits | |

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

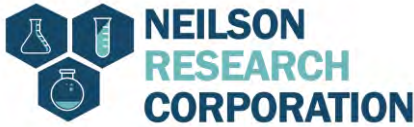

Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-40 Client Sample ID: 22-010G.ST42
 Collection Date: 3/11/2022 6:51:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.843		0.515	ppb	1	3/27/2022	15.0	A	

Lab ID: 22030640-41 Client Sample ID: 22-010G.ST43
 Collection Date: 3/11/2022 6:52:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	6.02		0.515	ppb	1	3/27/2022	15.0	A	

Lab ID: 22030640-42 Client Sample ID: 22-010G.ST44
 Collection Date: 3/11/2022 6:57:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A	

- | | | |
|-------------------|--|--|
| QUALIFIERS | * Value exceeds Maximum Contaminant Level. | C1 Sample container temperature is out of limit as specified at testcode |
| | E Value above quantitation range | H Holding times for preparation or analysis exceeded |
| | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference |
| | ND Not Detected at the Reporting Limit | PL Permit Limit |
| | R RPD outside accepted recovery limits | |

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-43 Client Sample ID: 22-010G.ST45
 Collection Date: 3/11/2022 6:57:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A	

Lab ID: 22030640-44 Client Sample ID: 22-010G.ST46
 Collection Date: 3/11/2022 6:57:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A	


Lab ID: 22030640-45 Client Sample ID: 22-010G.ST47
 Collection Date: 3/11/2022 6:58:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A	

- | | | |
|-------------------|--|--|
| QUALIFIERS | * Value exceeds Maximum Contaminant Level. | C1 Sample container temperature is out of limit as specified at testcode |
| | E Value above quantitation range | H Holding times for preparation or analysis exceeded |
| | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference |
| | ND Not Detected at the Reporting Limit | PL Permit Limit |
| | R RPD outside accepted recovery limits | |

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

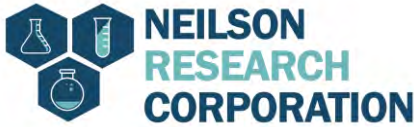

Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-46 Client Sample ID: 22-010G.ST48
 Collection Date: 3/11/2022 6:58:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	2.57		0.515	ppb	1	3/27/2022	15.0	A	

Lab ID: 22030640-47 Client Sample ID: 22-010G.ST49
 Collection Date: 3/11/2022 7:00:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A	


Lab ID: 22030640-48 Client Sample ID: 22-010G.ST50
 Collection Date: 3/11/2022 7:01:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS								Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A	

- | | | |
|-------------------|--|--|
| QUALIFIERS | * Value exceeds Maximum Contaminant Level. | C1 Sample container temperature is out of limit as specified at testcode |
| | E Value above quantitation range | H Holding times for preparation or analysis exceeded |
| | J Analyte detected below quantitation limits | MI Recovery outside control limits due to Matrix Interference |
| | ND Not Detected at the Reporting Limit | PL Permit Limit |
| | R RPD outside accepted recovery limits | |

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

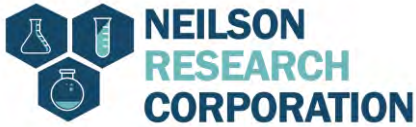

Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

Analytical Report

WO#: 22030640
 Date Reported: 3/31/2022

Coleman Creek Consulting
 810 Leonard St
 Ashland, OR 97520

Lab Order: 22030640
Received Date: 3/11/2022 4:08:00 PM
Reported Date: 3/31/2022 2:32:06 PM

Sample Information:

Lab ID: 22030640-49 Client Sample ID: 22-010G.ST51
 Collection Date: 3/11/2022 7:02:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.650		0.515	ppb	1	3/27/2022	15.0	A


Lab ID: 22030640-50 Client Sample ID: 22-010G.ST52
 Collection Date: 3/11/2022 7:03:00 AM Collected By: Bill Schroeder
 Matrix: Drinking Water Sample Location:

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.34		0.515	ppb	1	3/27/2022	15.0	A

QUALIFIERS	* Value exceeds Maximum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	MI Recovery outside control limits due to Matrix Interference
	ND Not Detected at the Reporting Limit	PL Permit Limit
	R RPD outside accepted recovery limits	

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

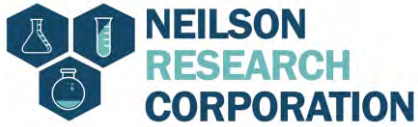

Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

QC SUMMARY REPORT

WO#: 22030640
 31-Mar-22

Client: Coleman Creek Consulting
Project: 22-010G Stearns ES

TestCode: LEAD_DW

Sample ID: MB-16065	SampType: MBLK	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28717
Client ID: PBW	Batch ID: 16065	TestNo: E200.8	E200.8	Analysis Date: 3/27/2022	SeqNo: 467250
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual
Lead	ND	0.515			

Sample ID: LCS-16065	SampType: LCS	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28717
Client ID: LCSW	Batch ID: 16065	TestNo: E200.8	E200.8	Analysis Date: 3/27/2022	SeqNo: 467251
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual
Lead	106	0.520	100	0	106 85 115

Sample ID: 22030640-40AMS	SampType: MS	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28717
Client ID: 22-010G.ST42	Batch ID: 16065	TestNo: E200.8	E200.8	Analysis Date: 3/27/2022	SeqNo: 467274
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual
Lead	100	0.520	100	0.843	99.3 70 130

Sample ID: 22030640-40AMSD	SampType: MSD	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28717
Client ID: 22-010G.ST42	Batch ID: 16065	TestNo: E200.8	E200.8	Analysis Date: 3/27/2022	SeqNo: 467275
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual
Lead	97.4	0.520	100	0.843	96.6 70 130 100 2.81 20

Qualifiers: CI Sample container temperature is out of limit as specified at testcode H Holding times for preparation or analysis exceeded MI Recovery outside control limits due to Matrix Int
 ND Not Detected at the Reporting Limit PL Permit Limit RL Reporting Detection Limit

Original



Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

QC SUMMARY REPORT

WO#: 22030640
 31-Mar-22

Client: Coleman Creek Consulting
Project: 22-010G Stearns ES

TestCode: LEAD_DW

Sample ID: MB-16066	SampType: MBLK	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28717
Client ID: PBW	Batch ID: 16066	TestNo: E200.8	E200.8	Analysis Date: 3/27/2022	SeqNo: 467278
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead ND 0.515

Sample ID: LCS-16066	SampType: LCS	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28717
Client ID: LCSW	Batch ID: 16066	TestNo: E200.8	E200.8	Analysis Date: 3/27/2022	SeqNo: 467279
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 97.7 0.520 100 0 97.7 85 115

Sample ID: 22030640-50AMS	SampType: MS	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28717
Client ID: 22-010G.ST52	Batch ID: 16066	TestNo: E200.8	E200.8	Analysis Date: 3/27/2022	SeqNo: 467290
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 99.0 0.520 100 1.34 97.7 70 130

Sample ID: 22030640-50AMSD	SampType: MSD	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28717
Client ID: 22-010G.ST52	Batch ID: 16066	TestNo: E200.8	E200.8	Analysis Date: 3/27/2022	SeqNo: 467291
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 101 0.520 100 1.34 100 70 130 99.0 2.31 20

Qualifiers: CI Sample container temperature is out of limit as specified at testcode H Holding times for preparation or analysis exceeded MI Recovery outside control limits due to Matrix Int
 ND Not Detected at the Reporting Limit PL Permit Limit RL Reporting Detection Limit

Original



Neilson Research Corporation
 245 S Grape St
 Medford, OR 97501
 TEL: (541) 770-5678 FAX: (541) 770-2901
 Website: www.nrclabs.com

QC SUMMARY REPORT

WO#: 22030640

31-Mar-22

Client: Coleman Creek Consulting

Project: 22-010G Stearns ES

TestCode: LEAD_DW

Sample ID: MB-16064	SampType: MBLK	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28808
Client ID: PBW	Batch ID: 16064	TestNo: E200.8	E200.8	Analysis Date: 3/31/2022	SeqNo: 469164
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual
Lead	ND	0.515			

Sample ID: LCS-16064	SampType: LCS	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28808
Client ID: LCSW	Batch ID: 16064	TestNo: E200.8	E200.8	Analysis Date: 3/31/2022	SeqNo: 469165
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual
Lead	94.9	0.520	100	0	94.9 85 115

Sample ID: 22030640-20AMS	SampType: MS	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28808
Client ID: 22-010G.ST22	Batch ID: 16064	TestNo: E200.8	E200.8	Analysis Date: 3/31/2022	SeqNo: 469188
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual
Lead	93.6	0.520	100	0.557	93.1 70 130

Sample ID: 22030640-20AMSD	SampType: MSD	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28808
Client ID: 22-010G.ST22	Batch ID: 16064	TestNo: E200.8	E200.8	Analysis Date: 3/31/2022	SeqNo: 469189
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual
Lead	93.0	0.520	100	0.557	92.5 70 130 93.6 0.655 20

Qualifiers: CI Sample container temperature is out of limit as specified at testcode H Holding times for preparation or analysis exceeded MI Recovery outside control limits due to Matrix Int
 ND Not Detected at the Reporting Limit PL Permit Limit RL Reporting Detection Limit

Original

Sample Log-In Check List

Client Name: **ColemanCreek** Work Order Number: **22030640** RcptNo: **1**

Logged by:	Tamra Schmedemann	3/11/2022 4:08:00 PM	<i>Tamra Schmedemann</i>
Completed By:	Katherine Root	3/17/2022 11:04:23 AM	<i>Katherine Root</i>
Reviewed By:	Dorie Maier	3/31/2022 2:11:24 PM	<i>Dorie Maier</i>

Chain of Custody

1. Is Chain of Custody complete? Yes No Not Present
 2. How was the sample delivered? Client

Log In

3. Coolers are present? Yes No NA
 4. Shipping container/cooler in good condition? Yes No
 Custody seals intact on shipping container/cooler? Yes No Not Present
 No. Seal Date: Signed By:
 5. Was an attempt made to cool the samples? Yes No NA
 6. Were all samples received at a temperature of >0° C to 6.0°C Yes No NA
 7. Sample(s) in proper container(s)? Yes No
 8. Sufficient sample volume for indicated test(s)? Yes No
 9. Are samples (except VOA and ONG) properly preserved? Yes No
 10. Was preservative added to bottles? Yes No NA
 HNO3 pH<2
 11. Is the headspace in the VOA vials less than 1/4 inch or 6 mm? Yes No No VOA Vials
 12. Were any sample containers received broken? Yes No
 13. Does paperwork match bottle labels? Yes No
 (Note discrepancies on chain of custody)
 14. Are matrices correctly identified on Chain of Custody? Yes No
 15. Is it clear what analyses were requested? Yes No
 16. Were all holding times able to be met? Yes No
 (If no, notify customer for authorization.)

Special Handling (if applicable)

17. Was client notified of all discrepancies with this order? Yes No NA

Person Notified:	<input type="text"/>	Date	<input type="text"/>
By Whom:	<input type="text"/>	Via:	<input type="checkbox"/> eMail <input type="checkbox"/> Phone <input type="checkbox"/> Fax <input type="checkbox"/> In Person
Regarding:	<input type="text"/>		
Client Instructions:	<input type="text"/>		

18. Additional remarks:

Cooler Information

Cooler No	Temp °C	Condition	Seal Intact	Seal No	Seal Date	Signed By
-----------	---------	-----------	-------------	---------	-----------	-----------


This Chain of Custody is a LEGAL DOCUMENT and must be filled out accurately.

Section A Required Client Information	Section B Required Project Information	Section C Invoice Information	Section D Rush Status (Subject to Scheduling)																																								
Company: Coleman Creek Consulting, Inc.	Project Name: Stearns ES	Attention:	X ___ Priority: 5 Business Days (List × 1.50) ___ Express: 3 Business Days (List × 1.75) ___ Rush: 2 Business Days (List × 2.00) ___ Rush: Same Day (List × 3.00)																																								
Address: 810 Leonard Street Ashland, OR 97520	Project Number: 22-010G	Company Name:																																									
Email: <u>fawbro@ccountry.net</u>	Report To:	Address:	Authorized ___ Yes ___ No																																								
Phone: 541-944-5318 Fax:	Copy To:																																										
Collected By (Print): David W. Fawcett	<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th colspan="10" style="text-align: center;">Analysis Requested</th> </tr> <tr> <th rowspan="2" style="writing-mode: vertical-rl; transform: rotate(180deg);">No. of Containers</th> <th colspan="9"></th> </tr> </thead> <tbody> <tr> <td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td> </tr> </tbody> </table>		Analysis Requested										No. of Containers																														
Analysis Requested																																											
No. of Containers																																											
Collected By (Sign):																																											
Email Report ___ Mail Report ___ Fax Report ___																																											

Section E Sample Information						No. of Containers					NRC Workorder # (Lab Use Only) <u>22030640</u>	
Sample ID	Comp/Grab	Matrix*	Date Collected	Time Collected			Remarks / Field Data	NRC Sample # (Lab Use Only)				
<u>22-010G-ST1-ST3</u>	<u>Grab</u>	<u>DW</u>	<u>3-11-22</u>		<u>3</u>							
<u>ST5-ST17</u>	↓	↓	↓		<u>13</u>							
<u>ST19-ST52</u>	↓	↓	↓		<u>34</u>							

*Matrix: DW - Drinking Water WW - Wastewater W - Water S - Soil/Solid SL - Sludge O - Oil WP - Wipe OT - Other

Section F Relinquish/Receive				Section G Lab Use Only	
Relinquished By:	Sign	Print	Date	Time	Temp:
<u>David W. Fawcett</u>	<u>David W. Fawcett</u>	<u>David W. Fawcett</u>	<u>3-11-22</u>	<u>1600</u>	<u>amb</u>
Received By:					4°C +/- 2°C: ___ Yes ___ No
Relinquished By:					Received on Ice: ___ Yes ___ No
Received By:					Number of Bottles Received: <u>50</u>
Relinquished By:					pH Checked: <u>NA</u>
Received By Laboratory: <u>Jamie Schmedeman</u>	<u>Jamie Schmedeman</u>	<u>Jamie Schmedeman</u>	<u>3-11-22</u>	<u>16:08</u>	COC Seals Intact: ___ Yes ___ No ___ NA
					Field Blank Included: ___ Yes ___ No
					Received Via ___ UPS ___ FedEX ___ Other ___ <input checked="" type="checkbox"/> Hand
					Payment: <input checked="" type="checkbox"/> Invoice ___ Cash ___ VISA, M/C ___ Check # ___ Amount ___



Coleman Creek Consulting, Inc.

DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Stearns Elementary School
ADDRESS: 3641 Crest Street
Klamath Falls, Oregon


DATE: 03-11-22
SAMPLER: Bill Schroeder

SAMPLE #	SAMPLE TYPE	LOCATION	TIME	
01 22-010G.ST1	DW	Kitchen, Handwash Sink Faucet	6am	
02 22-010G.ST2	DW	Kitchen, Prep Sink Faucet	6am	
03 22-010G.ST3	DW	Kitchen, Rinse Sink Faucet at Dishwash	6am	
04 22-010G.ST4	DW	Kitchen, Fill Faucet on Wall	6am	hot water only
05 22-010G.ST5	DW	Cafeteria Drinking Fountain	6:01a	
06 22-010G.ST6	DW	Gym Drinking Fountain 1	6:04a	L
07 22-010G.ST7	DW	Gym Drinking Fountain 2	6:04a	R
08 22-010G.ST8	DW	Library Corner Back Room Sink Faucet	6:06a	
09 22-010G.ST9	DW	Boy's RR at Boiler Room L Sink Faucet	6:08a	L
10 22-010G.ST10	DW	Boy's RR at Boiler Room LM Sink Faucet	6:08a	R
11 22-010G.ST11	DW	Boy's RR at Boiler Room RM Sink Faucet	6:09a	L
12 22-010G.ST12	DW	Boy's RR at Boiler Room R Sink Faucet	6:09a	R
13 22-010G.ST13	DW	Girl's RR at Boiler Room L Sink Faucet	6:13a	L
14 22-010G.ST14	DW	Girl's RR at Boiler Room LM Sink Faucet	6:13a	R
15 22-010G.ST15	DW	Girl's RR at Boiler Room RM Sink Faucet	6:15a	L
16 22-010G.ST16	DW	Girl's RR at Boiler Room R Sink Faucet	6:15a	R
17 22-010G.ST17	DW	Room 10 Right Sink Faucet	6:18a	L
18 22-010G.ST18	DW	Room 10 Left Sink Faucet	6:19a	R
19 22-010G.ST19	DW	Room 12 Sink/Fountain	no sample per client	water us off
18 22-010G.ST20	DW	Boy's RR at Room 12 L Sink Faucet	6:27a	L

3/14/22
D

Comments: DW = Drinking Water RR = Restroom L = Left LM = Left Middle RM = Right Middle R = Right

Call about sample 18 or 19?



Coleman Creek Consulting, Inc.

DRINKING WATER SITE SAMPLE RECORD SHEET


BUILDING: Stearns Elementary School
 ADDRESS: 3641 Crest Street
 Klamath Falls, Oregon

DATE: 03-11-22
 SAMPLER: Bill Schroeder

SAMPLE #	SAMPLE TYPE	LOCATION	TIME	
19	22-010G.ST21	DW	Boy's RR at Room 12 Right Sink Faucet	6:25
20	22-010G.ST22	DW	Room 14 Sink/Fountain	6:27
21	22-010G.ST23	DW	Room 16 Sink/Fountain	6:28
22	22-010G.ST24	DW	Room 15 Sink/Fountain	6:29
23	22-010G.ST25	DW	Room 13 Sink/Fountain	6:31
24	22-010G.ST26	DW	Girl's RR at Room 11 L Sink	6:32
25	22-010G.ST27	DW	Girl's RR at Room 11 R Sink	6:33
26	22-010G.ST28	DW	Room 11 Sink/Fountain	6:33
27	22-010G.ST29	DW	Room 9 Sink/Fountain	6:35
28	22-010G.ST30	DW	Staff RR Sink Faucet	6:37
29	22-010G.ST31	DW	Hall Drinking Fountain at Staff Room	6:37
30	22-010G.ST32	DW	Staff Break Room Sink Faucet	6:38
31	22-010G.ST33	DW	Nurse Station Sink/Faucet	6:40
32	22-010G.ST34	DW	Boy's RR at Room 4 Left Sink Faucet	6:41
33	22-010G.ST35	DW	Boy's RR at Room 4 Right Sink Faucet	6:42
34	22-010G.ST36	DW	Room 4 Sink/Fountain	6:43
35	22-010G.ST37	DW	Room 6 Sink/Fountain	6:45
36	22-010G.ST38	DW	Boy's RR at Room 6 L Sink Faucet	6:46
37	22-010G.ST39	DW	Boy's RR at Room 6 LM Sink Faucet	6:47
38	22-010G.ST40	DW	Boy's RR at Room 6 RM Sink Faucet	6:48

Comments: DW = Drinking Water RR = Restroom L = Left LM = Left Middle RM = Right Middle
 R = Right

U



Coleman Creek Consulting, Inc.

DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Stearns Elementary School
ADDRESS: 3641 Crest Street
Klamath Falls, Oregon

DATE: 03-11-22
SAMPLER: Bill Schroeder

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
39 40 41 42 43 44 45 46 47 48 49 50 22-010G.ST41	DW	Boy's RR at Room 6 R Sink Faucet	6:49
22-010G.ST42	DW	Room 8 Sink/Fountain	6:51
22-010G.ST43	DW	Room 7 Sink/Fountain	6:52
22-010G.ST44	DW	Girl's RR at Room 5 L Sink Faucet	6:57
22-010G.ST45	DW	Girl's RR at Room 5 LM Sink Faucet	6:57
22-010G.ST46	DW	Girl's RR at Room 5 RM Sink Faucet	6:57
22-010G.ST47	DW	Girl's RR at Room 5 R Sink Faucet	6:58
22-010G.ST48	DW	Room 5 Sink/Fountain	6:58
22-010G.ST49	DW	Room 3 Sink/Fountain	7:01
22-010G.ST50	DW	Girl's RR at Room 1 L Sink Faucet	7:01
22-010G.ST51	DW	Girl's RR at Room 1 R Sink Faucet	7:02
22-010G.ST52	DW	Room 1 Sink/Fountain	7:03

Comments: DW = Drinking Water RR = Restroom L = Left LM = Left Middle RM = Right Middle R = Right

M